

# Water Infrastructure Standard Details

## Connections and Developer Services

Construction Requirements for Self-Lay Developments  
July 2020 (Revision 4)

Document IW-CDS-5020-01



Part of **ervia** group

IW-CDS-5020-01

### Revision Log

<b>Date</b>	<b>Details of Revision</b>	<b>Revision</b>	<b>Author</b>	<b>Approver</b>
April 2016	General revisions & drawing added	01	T'OC	M'OD
August 2016	General revisions	02	TO'C	MO'D
December 2017	General revisions & drawing added	03	TO'C	MO'D
July 2020	General revisions & drawings added	04	TO'C	MO'D

## Background

Technical Documentation has been developed by Irish Water's Connections and Developer Services which outlines the requirements for water services infrastructure within developments.

These Standard Details have been developed to outline to developers Irish Water's requirements for the provision of water infrastructure that is to be installed in developments and that would be connected to Irish Water's networks and subsequently vested in Irish Water.

The aim is to provide details to developers for water infrastructure, which will outline design and construction requirements to ensure consistency in the provision of materials, equipment and workmanship, etc. The Standard Details will also provide the basis for developers' detailed design proposals for water infrastructure, leading to the provision of infrastructure that is suitable for connection to Irish Water's networks and easy operation and maintenance of the new infrastructure.

The Standard Details are based on best practice within the water industry. They take account of the experience of Local Authorities in the provision of these services to new developments. They have been successfully used by Irish Water's own internal functions for a variety of projects and they are in line with water utility industry norms.

There are 57 No Standard Details dealing with water infrastructure covering all aspects of such infrastructure.

These Standard Details are accompanied by a Design Risk Assessment (DRA) (document number IW-CDS-5020-02), which outlines the residual health and safety responsibilities of developers and their designers/contractors in the provision of such infrastructure.

The use of the Standard Details is mandatory in all new Irish Water Connection Agreement Offers issued after 1<sup>st</sup> June 2016.

# INDEX SHEET

Detail No.	Detail Title	Rev.
STD-W-01	Water service connection responsibility	1
STD-W-02	Typical layout for watermains within developments	2
STD-W-03	Customer connection and boundary box (25mm OD pipe)	4
STD-W-04	General pipe connections ( Sheet 1 of 7)	4
STD-W-05	General pipe connections ( Sheet 2 of 7)	3
STD-W-06	General pipe connections ( Sheet 3 of 7)	3
STD-W-07	General pipe connections ( Sheet 4 of 7)	2
STD-W-08	General pipe connections ( Sheet 5 of 7)	2
STD-W-09	General pipe connections ( Sheet 6 of 7)	2
STD-W-10	General pipe connections ( Sheet 7 of 7)	2
STD-W-11	Typical service layout indicating separation distances	2
STD-W-12	Restrictions on Water Infrastructure works adjacent to existing trees	2
STD-W-12A	Restrictions on new trees / shrubs planting adjacent to Water mains	0
STD-W-13	Trench Backfill / bedding & reduced cover protection slab detail	2
STD-W-14	Sluice valve for ductile iron (D.I.) pipe (<350mm dia.) (Sheet 1 of 2)	4
STD-W-15	Sluice valve for polyethylene (P.E.) pipe (<350mm dia.) (Sheet 2 of 2)	3
STD-W-16	On-line hydrant for ductile iron (D.I.) pipe (Sheet 1 of 4)	3
STD-W-17	Off-line hydrant for ductile iron (D.I.) pipe (Sheet 2 of 4)	4
STD-W-18	On-line hydrant for polyethylene (P.E.) pipe (Sheet 3 of 4)	3
STD-W-19	Off-line hydrant for polyethylene (P.E.) pipe (Sheet 4 of 4)	4
STD-W-20	On-line air valve for ductile iron (D.I.) pipe (Sheet 1 of 4)	3
STD-W-21	Off-line air valve for ductile iron (D.I.) pipe (Sheet 2 of 4)	4
STD-W-22	On-line air valve for polyethylene (P.E.) pipe (Sheet 3 of 4)	3
STD-W-23	Off-line air valve for polyethylene (P.E.) pipe (Sheet 4 of 4)	4
STD-W-24	Pressure reducing / sustaining valve chamber in-situ R.C. option	3
STD-W-25	Booster pump station arrangement	2
STD-W-26	Electromagnetic meter chamber (dn80 - dn250mm Dia.)	4
STD-W-26A	Chamber for flanged mech. meter without strainer (dn40 - dn250mm Dia.)	1
STD-W-26B	Chamber for flanged mech. meter (dn100 - dn250mm Dia.) with separate strainer chamber	0
STD-W-26C	Threaded rotary piston flow meter chamber (dn30 - dn40mm Dia.) In-situ Concrete Option	0
STD-W-26D	Threaded rotary piston flow meter chamber (dn30 - dn40mm Dia.) Precast Concrete Option	0
STD-W-26E	Threaded rotary piston flow meter chamber (dn30 - dn40mm Dia.) Blockwork Option	0
STD-W-26F	By-pass flow meter chamber (25-32mm O.D. Dia) For developments with <20m <sup>3</sup> /day water use	0
STD-W-26G	Flow meter chamber (25-32mm O.D. Dia.)	0
STD-W-27	Marker posts / plates	3
STD-W-28	Water main thrust and support blocks	1
STD-W-29	Duct chamber	3
STD-W-30	Scour chamber and head wall arrangements	4
STD-W-30A	Washout hydrant	3
STD-W-30B	Scour chamber to storm sewer arrangements	0
STD-W-31	Typical ditch / stream crossing for watermain ductile iron option	2
STD-W-31A	Typical ditch / stream crossing for watermain polyethylene option	0
STD-W-32	Typical bridge crossing for watermain (Sheet 1 of 2)	1
STD-W-33	Typical bridge crossing for watermain (Sheet 2 of 2)	2
STD-W-33A	Typical culvert and services crossing details for water main	0
STD-W-34	Security gate and fencing palisade option (preferred)	0
STD-W-34A	Security gate and fencing wire mesh option	3
STD-W-35	Pipe repair to existing mains	2
STD-W-36	Flow meter kiosk	3
STD-W-36A	PRV / PSV control kiosk	0
STD-W-37	Lamp bollard and lamp standard	2
STD-W-38	Watermain loop detail ductile iron option	0
STD-W-39	Watermain loop detail polyethylene option	0
STD-W-40	Section showing water services separation details in high density developments 2.5m wide footpaths with 6.0m wide carriageway	0
STD-W-41	Layout plan showing below ground services separation details in high density developments 2.5m wide footpaths with 6.0m wide carriageway	0
STD-W-42	Section showing water services separation details in high density developments 1.8m wide footpaths, 2.5m wide parallel parking bays with 6.0m wide carriageway.	0
STD-W-43	Layout plan showing below ground services separation details in high density developments 1.8m wide footpaths, 2.5m wide parallel parking bays with 6.0m wide carriageway.	0


These Standard Details show the acceptable typical details and outline the minimum standards that are required by Irish Water for the provision of water pipes and related infrastructure which are to be connected to the Irish Water Network. They shall be used in conjunction with the associated Design Risk Assessments that have been developed which identify the risks that designers shall take into account in the detailed design of the water pipes and related infrastructure to be connected to the Irish Water Network. The pipes and related infrastructure to be put in place within developments shall comply fully with these Standard Details. Ultimate responsibility (including, but not limited to, any losses, costs, demands, damages, actions, expenses, negligence and claims) for the detailed design, construction and provision of such pipes and related infrastructure shall rest entirely with the Developer, his/her Designer(s), Contractor(s) or other connected party. Irish Water assumes no responsibility for and gives no guarantees, undertakings or warranties in relation to the pipes and related infrastructure to be provided in accordance with these Standard Details.

No part of the Standard Details shall be reproduced or transmitted in any form or stored in any retrieval system of any nature without the prior written permission of Irish Water as copyright holder, except as agreed for use.

These Standard Details shall be used in conjunction with current Irish Water Code of Practice IW-CDS-5020-03, which will take precedence over the Standard Details.

These Standard Details may also be used for the installation of water infrastructure for Asset Delivery Works & Capital Project Works Programmes at the discretion of Irish Water.

**July 2020**

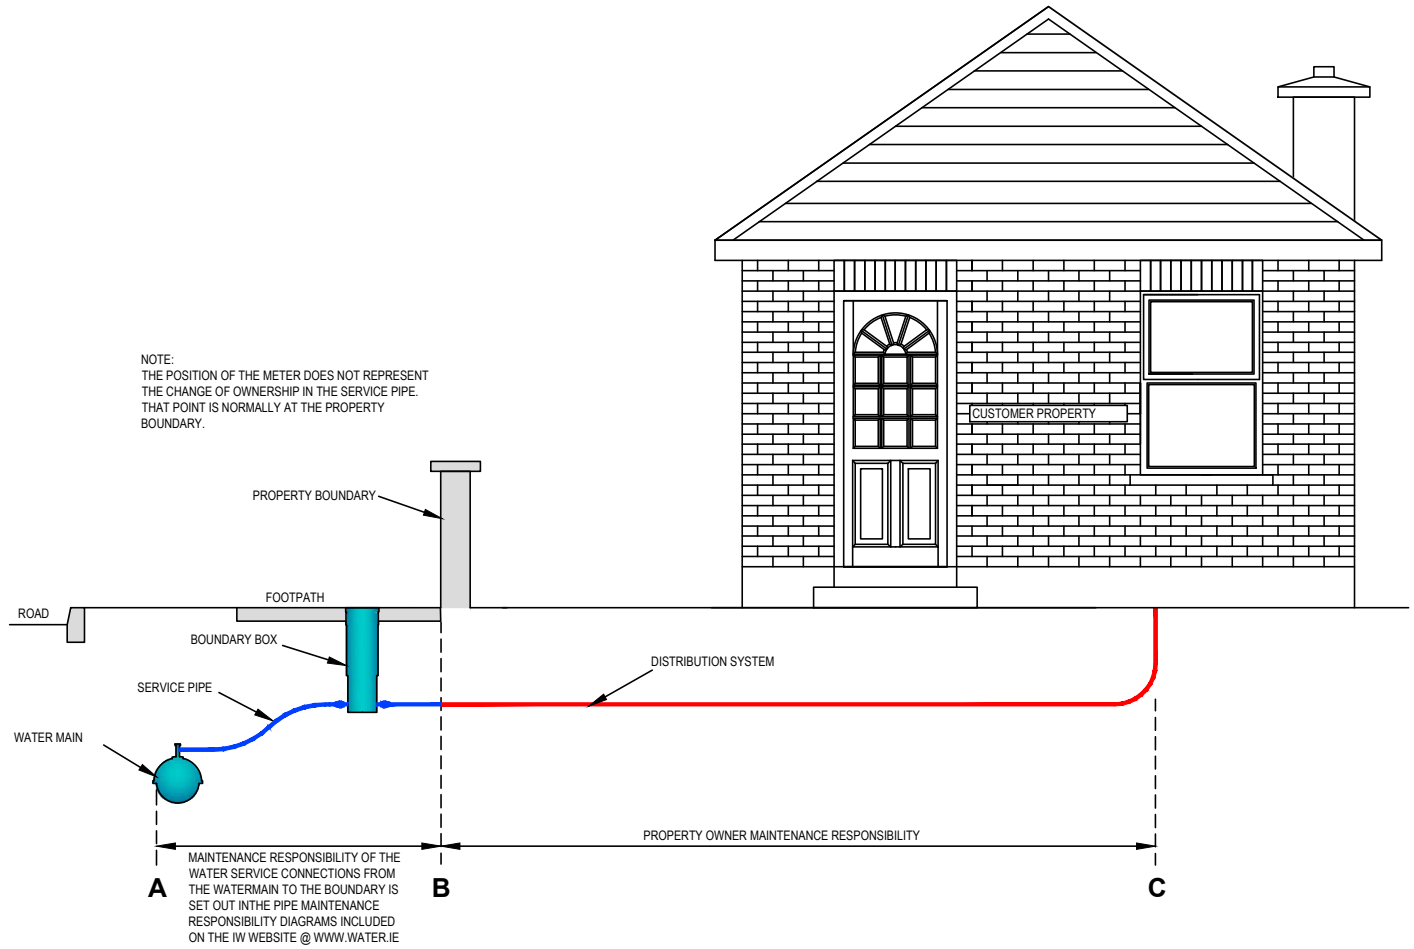

MAINTENANCE RESPONSIBILITY OF THE  
WATER SERVICE CONNECTIONS FROM  
THE WATERMAIN TO THE BOUNDARY IS  
SET OUT IN THE PIPE MAINTENANCE  
RESPONSIBILITY DIAGRAMS INCLUDED  
ON THE IW WEBSITE @ WWW.WATER.IE



	MAINTENANCE RESPONSIBILITY
A - B SERVICE PIPE	SEE NOTE ABOVE
METER / BOUNDARY BOX	IRISH WATER
B - C (DISTRIBUTION SYSTEM)	PROPERTY OWNER
INTERNAL PLUMBING	PROPERTY OWNER

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

							STANDARD DETAILS - WATER		SCALE NOT TO SCALE	DATE SEPT. 2015
							TITLE	DRAWING No.	REV	
							WATER SERVICE CONNECTION RESPONSIBILITY	STD-W-01	1	
	No	Date	Drn	Chk	Description	App				

1	07/20	RH	TOC	Responsibility Changed	MOD
0	09/15	JMC	TOC	Initial Issue	SL

1. WATER MAIN LAYOUTS SHALL BE ARRANGED IN LOOPS OR RINGS SO AS TO AVOID "DEAD ENDS" OR TERMINAL POINTS. ALL MAINS SHALL TERMINATE IN A LOOP OR RING TO ACCOMMODATE ONE-DIRECTIONAL FLUSHING OF THE NETWORK. LOOPS SHALL HAVE A MINIMUM OF 4 HOUSES AND 1 HYDRANT.
2. THE MINIMUM PIPE SIZE SHALL BE 100mm INTERNAL DIAMETER IN HOUSING DEVELOPMENTS OF 40 AND UP TO 100 HOUSES. DEVELOPMENTS OF 100 HOUSES AND ABOVE SHALL HAVE A MINIMUM PIPE SIZE OF 150mm INTERNAL DIAMETER SPINE AND 100mm BRANCH MAINS. NOMINAL INTERNAL DIAMETERS OF 80mm AND LESS MAY BE ALLOWED IN SMALLER DEVELOPMENTS BUT NOT WHERE HYDRANTS ARE LOCATED AND ONLY AFTER PRIOR WRITTEN AGREEMENT FROM IRISH WATER.
3. THE MINIMUM PIPE SIZE SHALL BE 150mm IN INDUSTRIAL OR COMMERCIAL DEVELOPMENTS.
4. EVERY PREMISE SHOULD HAVE A SEPARATE SERVICE CONNECTION. THE USE OF COMMON SERVICE PIPES IS NOT ALLOWED. SERVICE CONNECTIONS SHALL BE AS SHORT AS REASONABLY POSSIBLE. LONG SERVICE CONNECTIONS (IN EXCESS OF 15m) WILL NOT BE ALLOWED. A RIDER MAIN AT THE OPPOSITE SIDE OF THE ROAD TO THE MAIN WATER MAIN MAY BE REQUIRED SUBJECT TO APPROVAL FROM IRISH WATER. SERVICE CONNECTIONS SHALL BE A MINIMUM PIPE SIZE OF 25mm OUTSIDE DIAMETER, 20mm INTERNAL DIAMETER.
5. WATER MAINS SHOULD BE LAID TO PROVIDE THE OPTIMUM CIRCULATION IN THE LOCAL WATER NETWORK. WATER MAINS MAY TERMINATE IN A DEAD END ONLY WITH IRISH WATER APPROVAL, IN WHICH CASE AN ON-LINE WASHOUT HYDRANT SHALL BE PROVIDED AT THE DEAD END, LOCATED WITHIN A CHAMBER OR KIOSK.
6. VALVES SHALL BE ARRANGED IN SUCH A MANNER TO ALLOW THE NETWORK TO BE MANAGED TO ENSURE THAT NO MORE THAN 40 PROPERTIES LOSE WATER FROM A BURST ON THE SYSTEM, AT ANY ONE TIME.
7. NO DOMESTIC PROPERTY SHALL BE MORE THAN 46m FROM A HYDRANT. HYDRANT DETAILS AND LOCATIONS SHALL BE SUBJECT TO THE APPROVAL OF THE RELEVANT LOCAL AUTHORITY FIRE DEPARTMENT.
8. WATER SUPPLY MAINS SHALL BE LAID IN COMMON AREAS AND NOT THROUGH INDIVIDUAL PRIVATE GARDENS OR DRIVEWAYS ETC.
9. A THREE-WAY VALVE ARRANGEMENT SHALL BE PROVIDED AT ALL JUNCTIONS, AS A MINIMUM.
10. THE WATER MAIN PIPEWORK TO NEW DEVELOPMENTS SHOULD BE LOCATED AT THE RIGHT HAND SIDE OF THE ENTRANCE TO THE NEW DEVELOPMENT (FROM A VIEW FACING INTO THE DEVELOPMENT) IF POSSIBLE AND WHERE THE PROPERTIES ARE EQUALLY AND REASONABLY DISTRIBUTED AT BOTH SIDES OF THE ESTATE ROADWAY.
11. AIR VALVES TO BE LOCATED AT POINTS WHERE AIR IS LIKELY TO BUILD UP.
12. THE DEVELOPER IS TO LIAISE WITH THE FIRE SERVICES AUTHORITY IN ORDER TO ENSURE FIRE FLOWS ARE AVAILABLE THROUGHOUT THE DEVELOPMENT.
13. BULK FLOW METERS SHALL BE FITTED IN ALL DEVELOPMENTS WITH A DEMAND IN EXCESS OF 20m<sup>3</sup> PER DAY. BULK FLOW METERS SHALL HAVE A FACTORY FITTED AMR AND INSTALLED IN A SUITABLY SIZED CHAMBER. DEVELOPMENTS WITH DEMAND LESS THAN 20m<sup>3</sup> PER DAY SHALL BE PROVIDED WITH A DEDICATED BYPASS PIPEWORK AND CHAMBER IN ACCORDANCE WITH STD-W-26F TO ACCOMMODATE THE RECORDING OF NIGHT FLOWS.
14. WATERMANS TO BE LOCATED IN GRASS VERGE. IF GRASS VERGE IS NOT AVAILABLE, WATERMANS TO BE LOCATED UNDER FOOTPATH AWAY FROM KERB. REFER TO STD-W-11 FOR TYPICAL UTILITY LAYOUT.
15. WHERE A GRASS VERGE IS NOT AVAILABLE AND A FOOTPATH IS LESS THAN 1.2m WIDE, THE WATERMAIN IS PERMITTED ON THE ROADWAY.

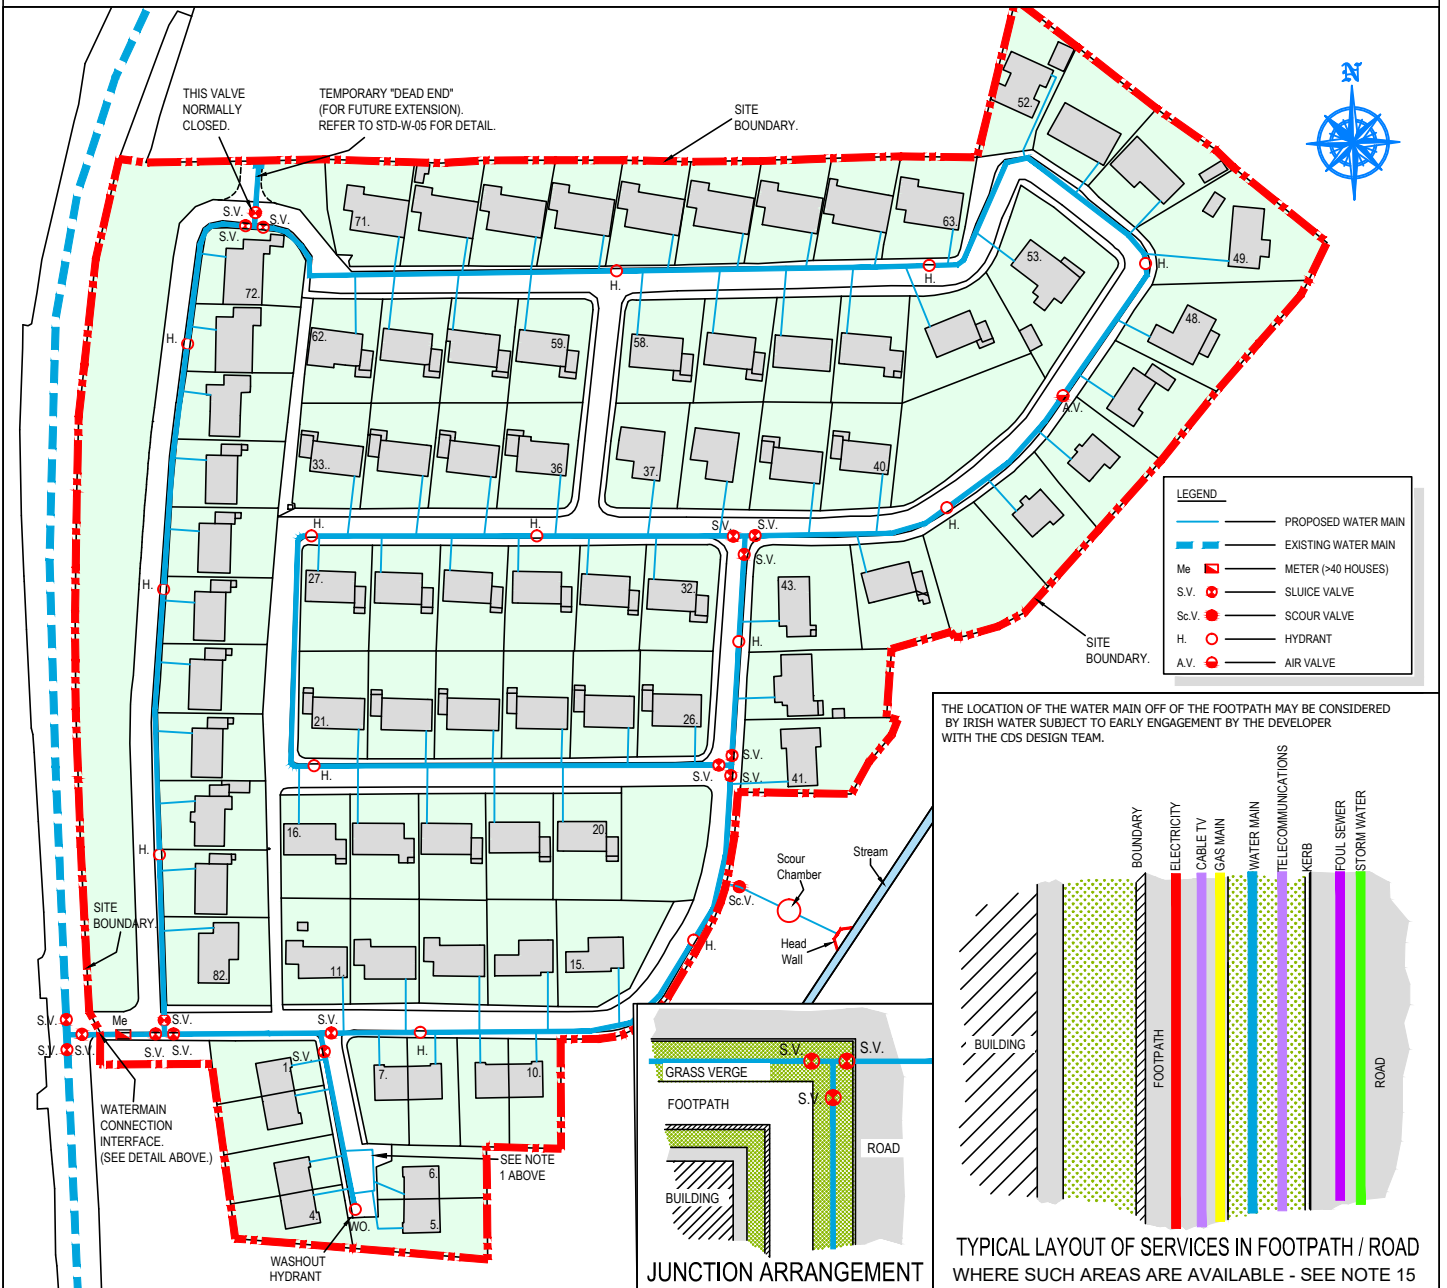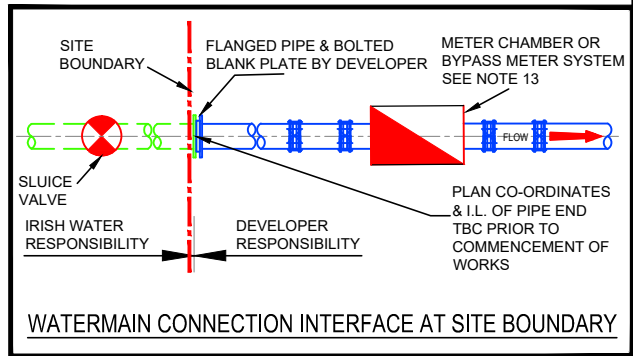


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT


					<b>STANDARD DETAILS - WATER</b>		SCALE	DATE
					TITLE		NOT TO SCALE	SEPT. 2015
	2	07/20	RH	TOC	Connection Interface Detail added, notes added		MOD	
1	11/17	JMC	TOC	Temp. "dead end" & note 1 ref. added		MOD		
0	09/15	JMC	TOC	Initial Issue		SL		
No.	Date	Drn	Chk	Description		App		
<b>TYPICAL LAYOUT FOR WATER MAINS WITHIN DEVELOPMENTS</b>							DRAWING No.	REV
							STD-W-02	2






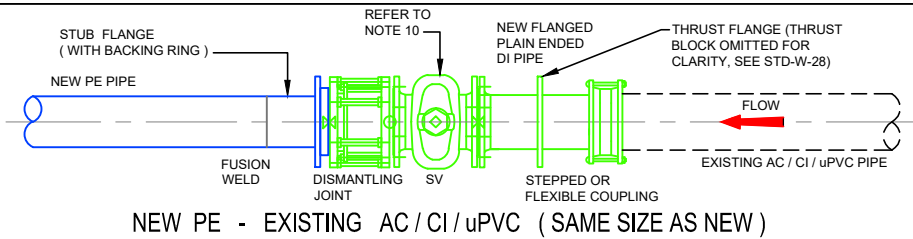


NEW PE - EXISTING AC / CI / uPVC ( SAME SIZE AS NEW )

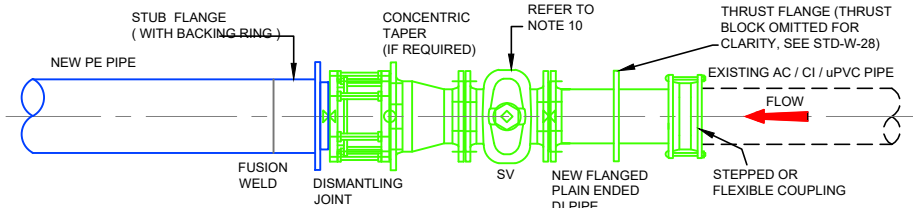


NEW PE - EXISTING AC / CI / uPVC ( DIFFERENT SIZE TO NEW )

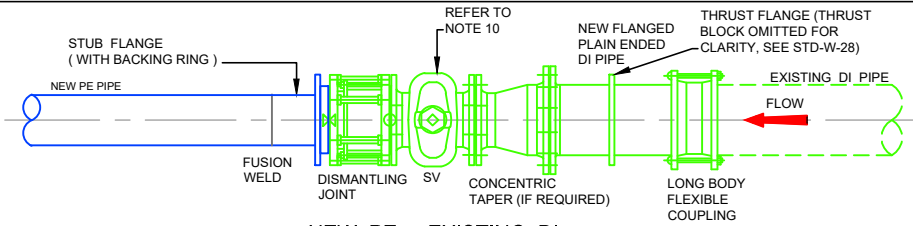


NEW PE - EXISTING DI

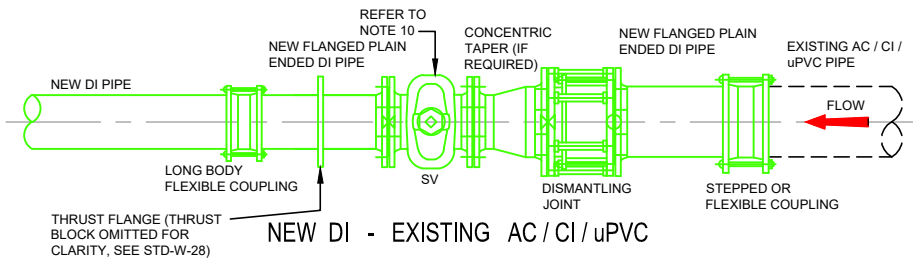


NEW DI - EXISTING AC / CI / uPVC

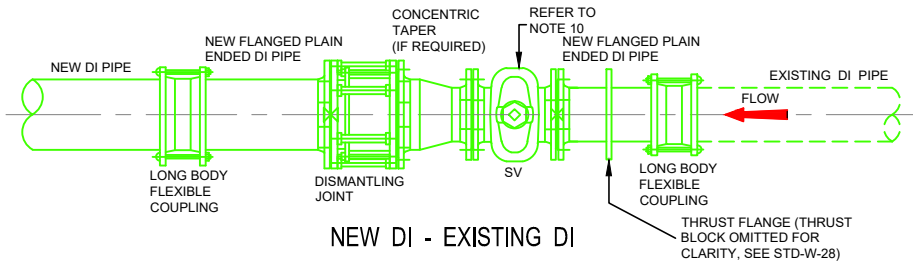

NEW DI - EXISTING DI

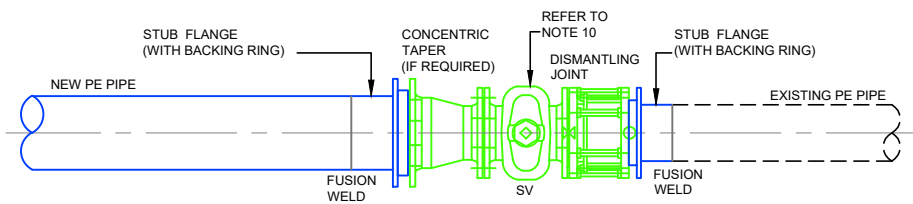

NEW PE - EXISTING PE

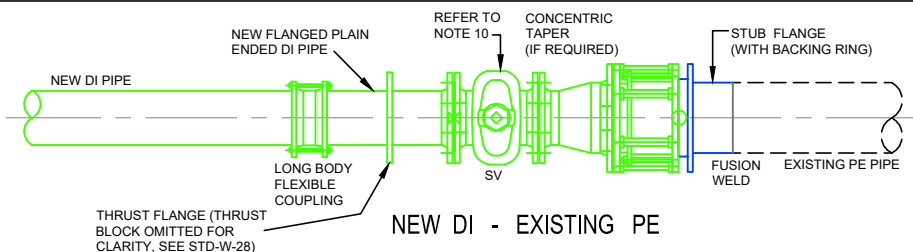

NEW DI - EXISTING PE

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. ALL BENDS, TEES, DEAD ENDS, ETC. OF PIPELINES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
3. BUTT FUSION WELDING AND ELECTRO FUSION JOINTING OF PIPES SHALL ONLY BE CARRIED OUT BY TRAINED OPERATIVES IN POSSESSION OF A CURRENT TRAINING CERTIFICATE, USING FULLY AUTOMATIC APPROVED JOINTING MACHINES/RIGS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE IDENTITY OF THE PE PIPELINE MANUFACTURER SHALL BE MADE KNOWN TO IRISH WATER PRIOR TO COMMENCEMENT OF THE INSTALLATION. CERTIFICATION AND TESTING (INCLUDING INDEPENDENT THIRD PARTY CERTIFICATION) SHALL BE PROVIDED TO CONFIRM QUALITY ASSURANCE COMPLIANCE. EACH JOINT SHALL BE CLEARLY MARKED WITH THE JOINT LOGGED AUTOMATICALLY ON THE JOINTING MACHINE. A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT, SHALL BE PROVIDED AND RETAINED FOR QUALITY ASSURANCE PURPOSES.
4. CONNECTING TO EXISTING MAINS IS TO BE CARRIED OUT BY IRISH WATER OR AN APPROVED IRISH WATER AGENT.
5. WHEN EXISTING AC WATERMAINS ARE PRESENT A SPECIFIC METHOD STATEMENT SHALL BE SUBMITTED TO IRISH WATER PRIOR TO WORKS TAKING PLACE AND SUBJECT TO WRITTEN APPROVAL, DETAILING THE PROTECTION TO BE PUT IN PLACE TO EXISTING MAINS, METHOD OF REMOVAL OF EXISTING AC, METHOD OF DISPOSAL OF EXISTING AC AND METHOD OF CONNECTION TO EXISTING AC.
6. PIPE MATERIAL REFERENCES AS FOLLOWS:  
AC - ASBESTOS CEMENT  
DI - DUCTILE IRON  
CI - CAST IRON  
PE - POLYETHYLENE  
uPVC - UNPLASTICISED POLY VINYL CHLORIDE  
ST - STEEL  
OTHER - REFERS TO ALL EXISTING PIPE MATERIALS OTHER THAN PE (TYPICALLY AC, DI, CI, uPVC & ST).
7. SLUDGE VALVE CHAMBERS TO BE IN ACCORDANCE WITH STD-W-14 (DI) AND STD-W-15 (PE), CHAMBERS NOT SHOWN FOR CLARITY.
8. ALL THRUST FLANGES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
9. A HIGH LEVEL OF HEALTH & SAFETY PROCEDURES IS REQUIRED WHEN WORKING ON AC MAINS, & THE OPERATION OF DISMANTLING/REMOVAL OF AC PIPES & JOINTS.
10. VALVES SHALL BE ARRANGED IN SUCH A MANNER TO ALLOW FOR THE NETWORK TO BE MANAGED TO ENSURE THAT NO MORE THAN 40 PROPERTIES LOSE WATER FROM A BURST ON THE SYSTEM AT ANY ONE TIME.






REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



No	Date	Drn	Chk	Description	App
4	07/20	RH	TOC	Dismantling joints relocated	MOD
3	11/17	JMC	TOC	Added 2 No. Extg. PE Details, updated details & added notes	MOD
2	08/16	JMC	TOC	Added Note 9	MOD
1	04/16	JMC	TOC	Added couplings (2 details)	MOD
0	09/15	JMC	TOC	Initial Issue	SL

STANDARD DETAILS - WATER	
TITLE	SCALE
GENERAL PIPE CONNECTIONS (Sheet 1 of 7)	NOT TO SCALE

DATE	REV
SEPT. 2015	
DRAWING No.	4
STD-W- 04	

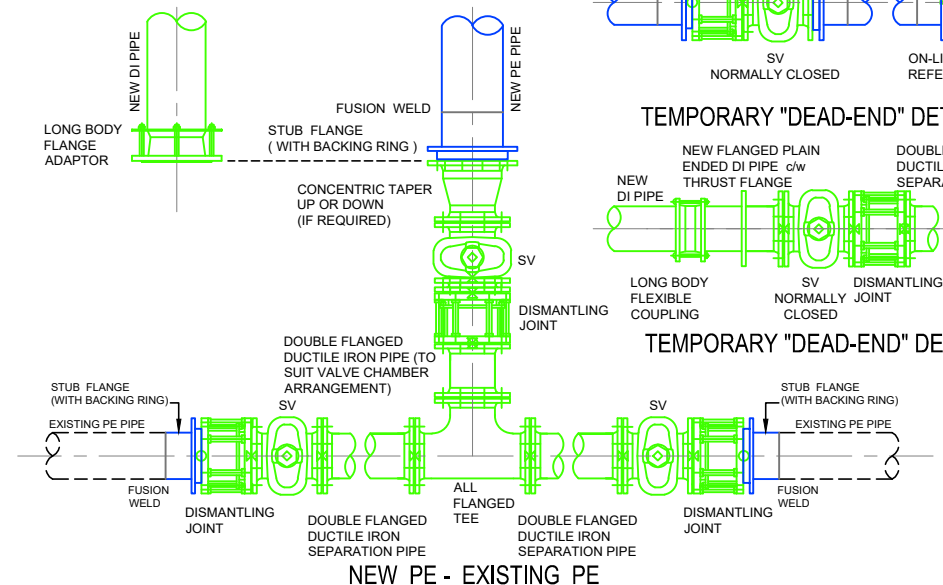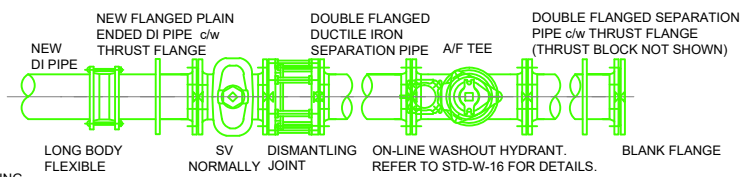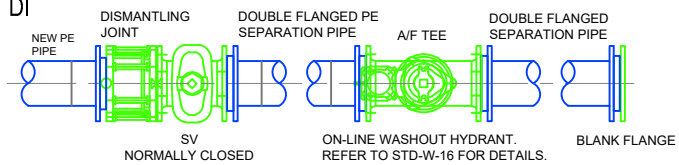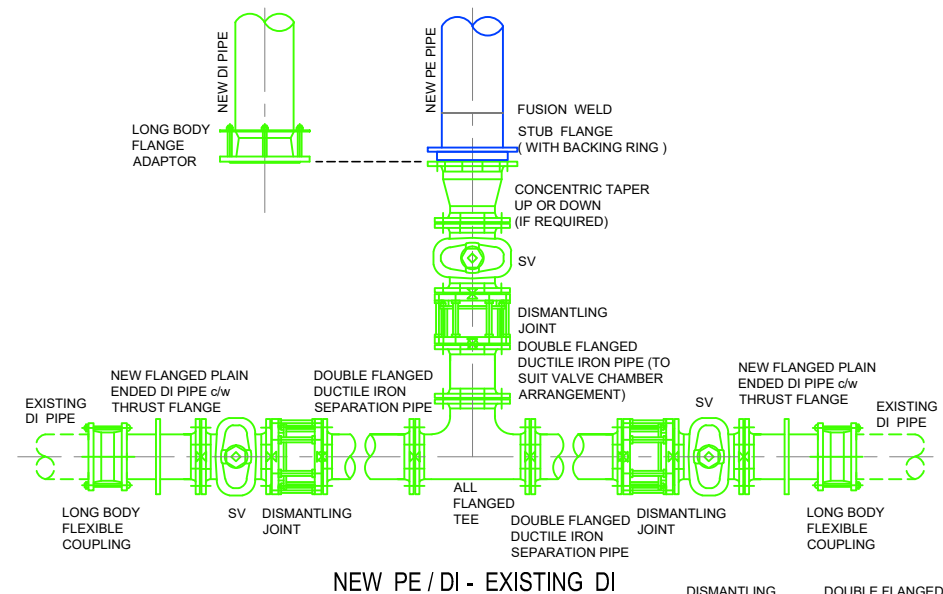
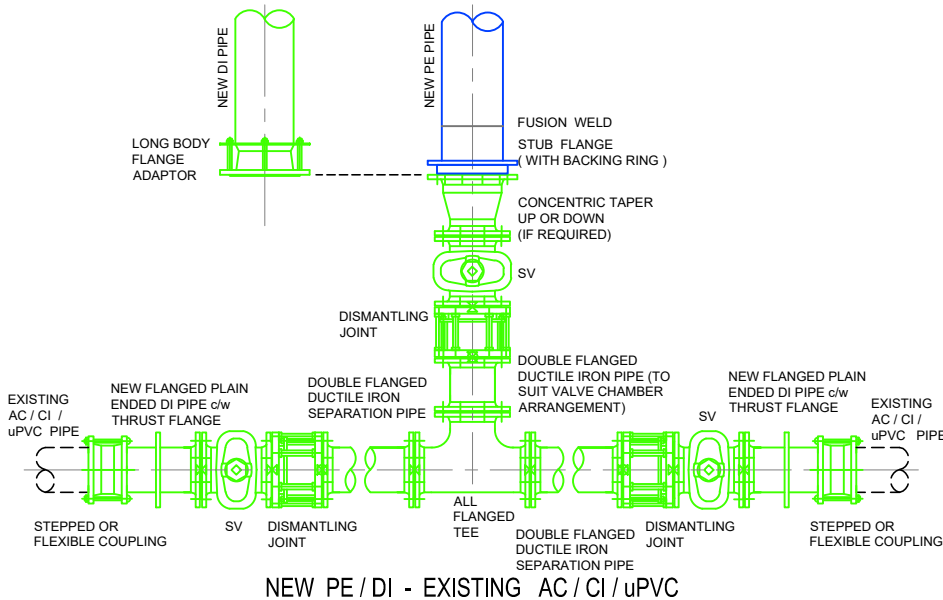


1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. ALL BENDS, TEES, DEAD ENDS, ETC. OF PIPELINES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
3. BUTT FUSION WELDING AND ELECTRO FUSION JOINTING OF PIPES SHALL ONLY BE CARRIED OUT BY TRAINED OPERATIVES IN POSSESSION OF A CURRENT TRAINING CERTIFICATE, USING FULLY AUTOMATIC APPROVED JOINTING MACHINE/RIGS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE IDENTITY OF THE PE PIPELINE MANUFACTURER SHALL BE MADE KNOWN TO IRISH WATER PRIOR TO COMMENCEMENT OF THE INSTALLATION. CERTIFICATION AND TESTING (INCLUDING INDEPENDENT THIRD PARTY CERTIFICATION) SHALL BE PROVIDED TO CONFIRM QUALITY ASSURANCE COMPLIANCE. EACH JOINT SHALL BE CLEARLY MARKED WITH THE JOINT LOGGED AUTOMATICALLY ON THE JOINTING MACHINE. A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT, SHALL BE PROVIDED AND RETAINED FOR QUALITY ASSURANCE PURPOSES.
4. CONNECTING TO EXISTING MAINS IS TO BE CARRIED OUT BY IRISH WATER OR AN APPROVED IRISH WATER AGENT.
5. WHEN EXISTING AC WATERMAINS ARE PRESENT A SPECIFIC METHOD STATEMENT SHALL BE SUBMITTED TO IRISH WATER PRIOR TO WORKS TAKING PLACE AND SUBJECT TO WRITTEN APPROVAL, DETAILING THE PROTECTION TO BE PUT IN PLACE TO EXISTING MAINS, METHOD OF REMOVAL OF EXISTING AC, METHOD OF DISPOSAL OF EXISTING AC AND METHOD OF CONNECTION TO EXISTING AC.
6. PIPE MATERIAL REFERENCES AS FOLLOWS:  
AC - ASBESTOS CEMENT  
DI - DUCTILE IRON  
CI - CAST IRON  
PE - POLYETHYLENE  
uPVC - UNPLASTICISED POLY VINYL CHLORIDE  
ST - STEEL  
OTHER - REFERS TO ALL EXISTING PIPE MATERIALS OTHER THAN PE (TYPICALLY AC, DI, CI, uPVC & ST).
7. VALVE CHAMBER TO BE IN ACCORDANCE WITH STD-W-14 (DI) AND STD-W-15 (PE), CHAMBER NOT SHOWN FOR CLARITY.
8. ALL THRUST FLANGES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
9. DOUBLE FLANGED SEPARATION PIPE, UP TO 5m IN LENGTH, MAY BE REQUIRED TO ALLOW SEPARATION DISTANCE BETWEEN VALVE CHAMBERS.
10. A HIGH LEVEL OF HEALTH & SAFETY PROCEDURES IS REQUIRED WHEN WORKING ON AC MAINS, & THE OPERATION OF DISMANTLING/ REMOVAL OF AC PIPES & JOINTS.
11. VALVES SHALL BE ARRANGED IN SUCH A MANNER TO ALLOW FOR THE NETWORK TO BE MANAGED TO ENSURE THAT NO MORE THAN 40 PROPERTIES LOSE WATER FROM A BURST ON THE SYSTEM AT ANY ONE TIME.
12. UNEQUAL TEES MAY BE USED INSTEAD OF CONCENTRIC TAPERS (WHERE APPLICABLE).

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

	3	07/20	RH	TOC	Added Note 12, separation pipe material added, dismantling joints relocated	MOD	<b>STANDARD DETAILS - WATER</b> TITLE <b>GENERAL PIPE CONNECTIONS</b> (Sheet 2 of 7)	SCALE	DATE
	2	11/17	JMC	TOC	Added new D.I. pipe to details, added 3 No. details & updated notes	MOD		NOT TO SCALE	SEPT. 2015
	1	08/16	JMC	TOC	Added Note 10	MOD		DRAWING No.	REV
	0	09/15	JMC	TOC	Initial Issue	SL		STD-W- 05	3
	No.	Date	Drn	Chk	Description	App			


- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- ALL BENDS, TEES, DEAD ENDS, ETC. OF PIPELINES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
- BUTT FUSION WELDING AND ELECTRO FUSION JOINTING OF PIPES SHALL ONLY BE CARRIED OUT BY TRAINED OPERATIVES IN POSSESSION OF A CURRENT TRAINING CERTIFICATE, USING FULLY AUTOMATIC APPROVED JOINTING MACHINE/RIGS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE IDENTITY OF THE PE PIPELINE MANUFACTURER SHALL BE MADE KNOWN TO IRISH WATER PRIOR TO COMMENCEMENT OF THE INSTALLATION. CERTIFICATION AND TESTING (INCLUDING INDEPENDENT THIRD PARTY CERTIFICATION) SHALL BE PROVIDED TO CONFIRM QUALITY ASSURANCE COMPLIANCE. EACH JOINT SHALL BE CLEARLY MARKED WITH THE JOINT LOGGED AUTOMATICALLY ON THE JOINTING MACHINE. A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT, SHALL BE PROVIDED AND RETAINED FOR QUALITY ASSURANCE PURPOSES.
- CONNECTING TO EXISTING MAINS IS TO BE CARRIED OUT BY IRISH WATER OR AN APPROVED IRISH WATER AGENT.
- WHEN EXISTING AC WATERMAINS ARE PRESENT A SPECIFIC METHOD STATEMENT SHALL BE SUBMITTED TO IRISH WATER PRIOR TO WORKS TAKING PLACE AND SUBJECT TO WRITTEN APPROVAL, DETAILING THE PROTECTION TO BE PUT IN PLACE TO EXISTING MAINS, METHOD OF REMOVAL OF EXISTING AC, METHOD OF DISPOSAL OF EXISTING AC AND METHOD OF CONNECTION TO EXISTING AC.
- PIPE MATERIAL REFERENCES AS FOLLOWS:  
AC - ASBESTOS CEMENT  
DI - DUCTILE IRON  
CI - CAST IRON  
PE - POLYETHYLENE  
uPVC - UNPLASTICISED POLY VINYL CHLORIDE  
ST - STEEL  
OTHER - REFERS TO ALL EXISTING PIPE MATERIALS OTHER THAN PE (TYPICALLY AC, DI, CI, uPVC & ST)
- SLUICE VALVE CHAMBERS TO BE IN ACCORDANCE WITH STD-W-14 (DI) AND STD-W-15 (PE). CHAMBERS NOT SHOWN FOR CLARITY.
- ALL THRUST FLANGES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
- DOUBLE FLANGED SEPARATION PIPE, UP TO 5m IN LENGTH, MAY BE REQUIRED TO ALLOW SEPARATION DISTANCE BETWEEN VALVE CHAMBERS.
- A HIGH LEVEL OF HEALTH & SAFETY PROCEDURES IS REQUIRED WHEN WORKING ON AC MAINS, & THE OPERATION OF DISMANTLING/ REMOVAL OF AC PIPES & JOINTS.
- VALVES SHALL BE ARRANGED IN SUCH A MANNER TO ALLOW FOR NETWORK TO BE MANAGED TO ENSURE THAT NO MORE THAN 40 PROPERTIES LOSE WATER FROM A BURST ON THE SYSTEM AT ANY ONE TIME.
- UNEQUAL TEES MAY BE USED INSTEAD OF CONCENTRIC TAPERS (WHERE APPLICABLE).

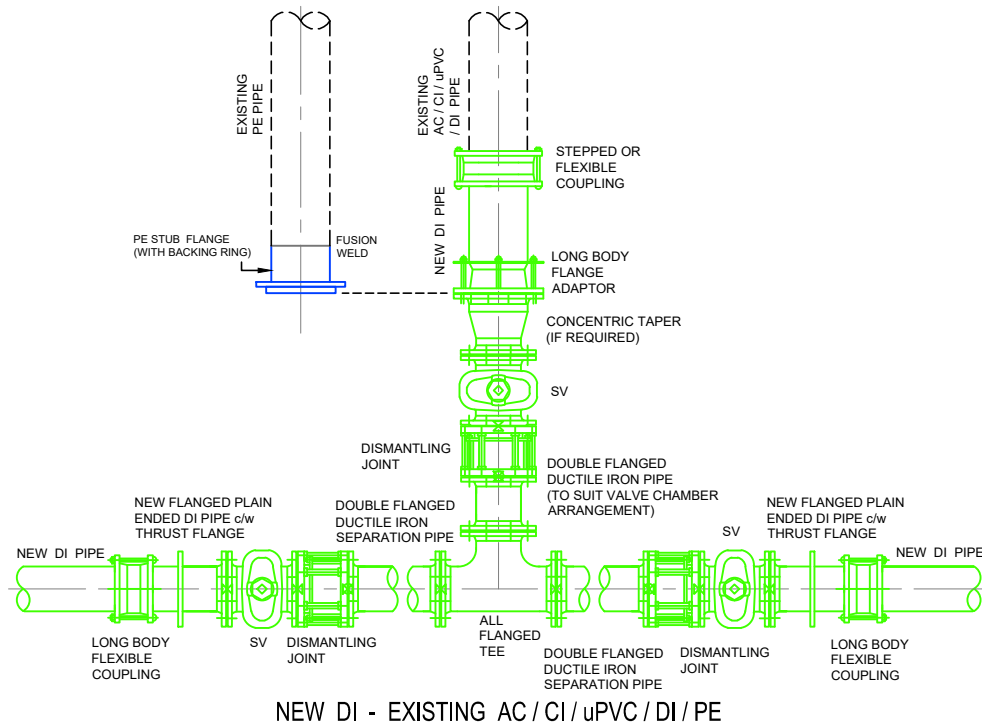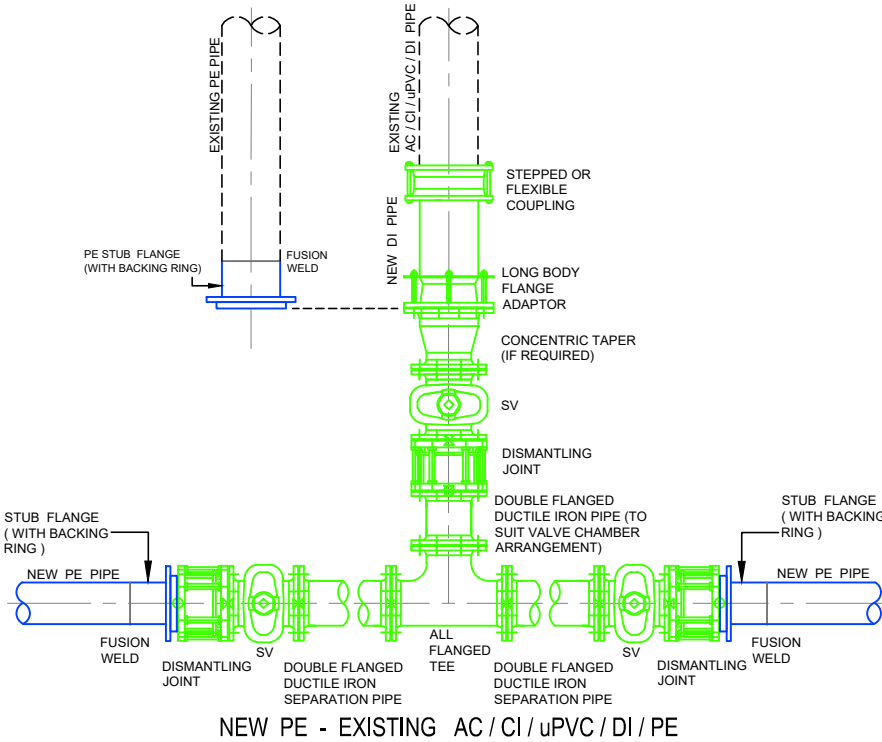


**REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT**

	3	07/20	RH	TOC	Added Note 12, separation pipe material added, dismantling joints relocated	MOD	<b>STANDARD DETAILS - WATER</b>  TITLE  <b>GENERAL PIPE CONNECTIONS</b> (Sheet 3 of 7)	SCALE NOT TO SCALE	DATE SEPT. 2015
	2	11/17	JMC	TOC	Added extg. PE pipe to details & updated notes	MOD		DRAWING No.	REV
	1	08/16	JMC	TOC	Added Note 10	MOD		<b>STD-W- 06</b>	<b>3</b>
	0	09/15	JMC	TOC	Initial Issue	SL			
	No.	Date	Drm	Chk	Description	App			

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. ALL BENDS, TEES, DEAD ENDS, ETC. OF PIPELINES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
3. BUTT FUSION WELDING AND ELECTRO FUSION JOINTING OF PIPES SHALL ONLY BE CARRIED OUT BY TRAINED OPERATIVES IN POSSESSION OF A CURRENT TRAINING CERTIFICATE, USING FULLY AUTOMATIC APPROVED JOINTING MACHINE/RIGS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE IDENTITY OF THE PE PIPELINE MANUFACTURER SHALL BE MADE KNOWN TO IRISH WATER PRIOR TO COMMENCEMENT OF THE INSTALLATION. CERTIFICATION AND TESTING (INCLUDING INDEPENDENT THIRD PARTY CERTIFICATION) SHALL BE PROVIDED TO CONFIRM QUALITY ASSURANCE COMPLIANCE. EACH JOINT SHALL BE CLEARLY MARKED WITH THE JOINT LOGGED AUTOMATICALLY ON THE JOINTING MACHINE. A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT, SHALL BE PROVIDED AND RETAINED FOR QUALITY ASSURANCE PURPOSES.
4. CONNECTING TO EXISTING MAINS IS TO BE CARRIED OUT BY IRISH WATER OR AN APPROVED IRISH WATER AGENT.
5. WHEN EXISTING AC WATERMAINS ARE PRESENT A SPECIFIC METHOD STATEMENT SHALL BE SUBMITTED TO IRISH WATER PRIOR TO WORKS TAKING PLACE AND SUBJECT TO WRITTEN APPROVAL, DETAILING THE PROTECTION TO BE PUT IN PLACE TO EXISTING MAINS, METHOD OF REMOVAL OF EXISTING AC, METHOD OF DISPOSAL OF EXISTING AC AND METHOD OF CONNECTION TO EXISTING AC.
6. PIPE MATERIAL REFERENCES AS FOLLOWS:  
AC - ASBESTOS CEMENT  
DI - DUCTILE IRON  
CI - CAST IRON  
PE - POLYETHYLENE  
uPVC - UNPLASTICISED POLY VINYL CHLORIDE  
ST - STEEL  
OTHER - REFERS TO ALL EXISTING PIPE MATERIALS OTHER THAN PE (TYPICALLY AC, DI, CI, uPVC & ST)
7. SLUICE VALVE CHAMBERS TO BE IN ACCORDANCE WITH STD-W-14 (DI) AND STD-W-15 (PE), CHAMBERS NOT SHOWN FOR CLARITY.
8. ALL THRUST FLANGES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
9. DOUBLE FLANGED SEPARATION PIPE, UP TO 5m IN LENGTH, MAY BE REQUIRED TO ALLOW SEPARATION DISTANCE BETWEEN VALVE CHAMBERS.
10. VALVES SHALL BE ARRANGED IN SUCH A MANNER TO ALLOW FOR NETWORK TO BE MANAGED TO ENSURE THAT NO MORE THAN 40 PROPERTIES LOSE WATER FROM A BURST ON THE SYSTEM AT ANY ONE TIME.
11. UNEQUAL TEES MAY BE USED INSTEAD OF CONCENTRIC TAPERS (WHERE APPLICABLE).

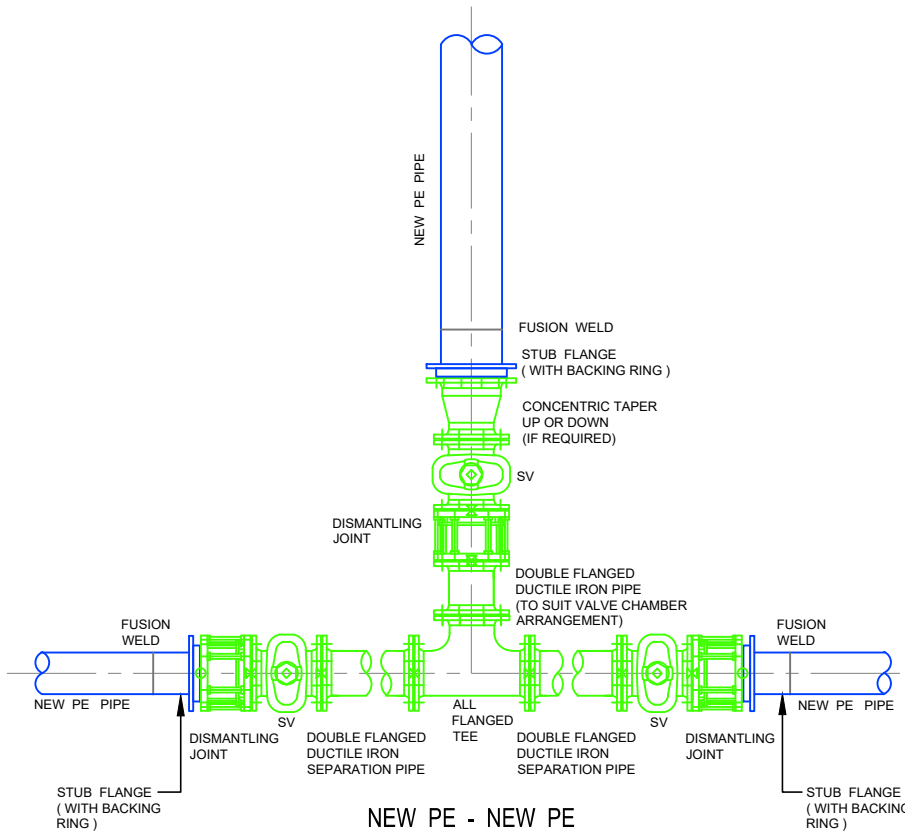

NEW PE - NEW PE

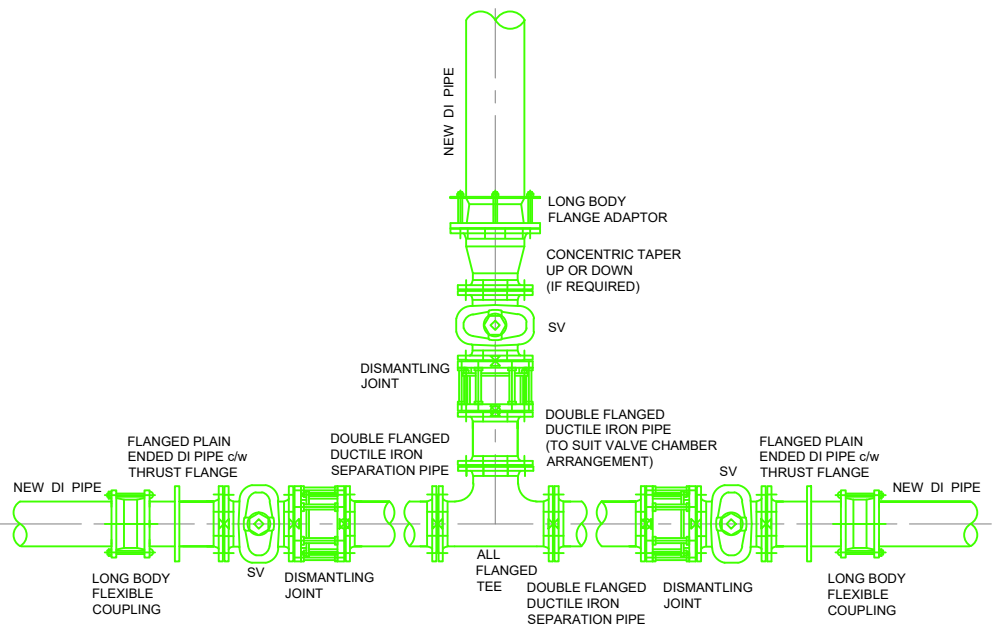


NEW DI - NEW DI

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						<b>STANDARD DETAILS - WATER</b>		SCALE NOT TO SCALE	DATE SEPT. 2015
						TITLE		DRAWING No.	REV
						GENERAL PIPE CONNECTIONS (Sheet 4 of 7)		STD-W-07	2
	2	07/20	RH	TOC	Added Note 11, separation pipe material added, dismantling joints relocated	MOD			
	1	11/17	JMC	TOC	Notes added & updated.	MOD			
0	09/15	JMC	TOC	Initial Issue	SL				
No.	Date	Drn	Chk	Description	App				

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- ALL BENDS, TEES, DEAD ENDS, ETC. OF PIPELINES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
- BUTT FUSION WELDING AND ELECTRO FUSION JOINTING OF PIPES SHALL ONLY BE CARRIED OUT BY TRAINED OPERATIVES IN POSSESSION OF A CURRENT TRAINING CERTIFICATE. USING FULLY AUTOMATIC APPROVED JOINTING MACHINE/RIGS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE IDENTITY OF THE PE PIPELINE MANUFACTURER SHALL BE MADE KNOWN TO IRISH WATER PRIOR TO COMMENCEMENT OF THE INSTALLATION. CERTIFICATION AND TESTING (INCLUDING INDEPENDENT THIRD PARTY CERTIFICATION) SHALL BE PROVIDED TO CONFIRM QUALITY ASSURANCE COMPLIANCE. EACH JOINT SHALL BE CLEARLY MARKED WITH THE JOINT LOGGED AUTOMATICALLY ON THE JOINTING MACHINE. A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT, SHALL BE PROVIDED AND RETAINED FOR QUALITY ASSURANCE PURPOSES.
- CONNECTING TO EXISTING MAINS IS TO BE CARRIED OUT BY IRISH WATER OR AN APPROVED IRISH WATER AGENT.
- WHEN EXISTING AC WATERMANS ARE PRESENT A SPECIFIC METHOD STATEMENT SHALL BE SUBMITTED TO IRISH WATER PRIOR TO WORKS TAKING PLACE AND SUBJECT TO WRITTEN APPROVAL, DETAILING THE PROTECTION TO BE PUT IN PLACE TO EXISTING MAINS. METHOD OF REMOVAL OF EXISTING AC, METHOD OF DISPOSAL OF EXISTING AC AND METHOD OF CONNECTION TO EXISTING AC.
- PIPE MATERIAL REFERENCES AS FOLLOWS:  
 AC - ASBESTOS CEMENT  
 DI - DUCTILE IRON  
 CI - CAST IRON  
 PE - POLYETHYLENE  
 uPVC - UNPLASTICISED POLY VINYL CHLORIDE  
 ST - STEEL  
 OTHER - REFERS TO ALL EXISTING PIPE MATERIALS OTHER THAN PE (TYPICALLY AC, DI, CI, uPVC & ST)
- SLUICE VALVE CHAMBERS TO BE IN ACCORDANCE WITH STD-W-14 (DI) AND STD-W-15 (PE). CHAMBERS NOT SHOWN FOR CLARITY
- ALL THRUST FLANGES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY
- DOUBLE FLANGED SEPARATION PIPE, UP TO 5m IN LENGTH, MAY BE REQUIRED TO ALLOW SEPARATION DISTANCE BETWEEN VALVE CHAMBERS
- UNEQUAL TEES MAY BE USED INSTEAD OF CONCENTRIC TAPERS (WHERE APPLICABLE).

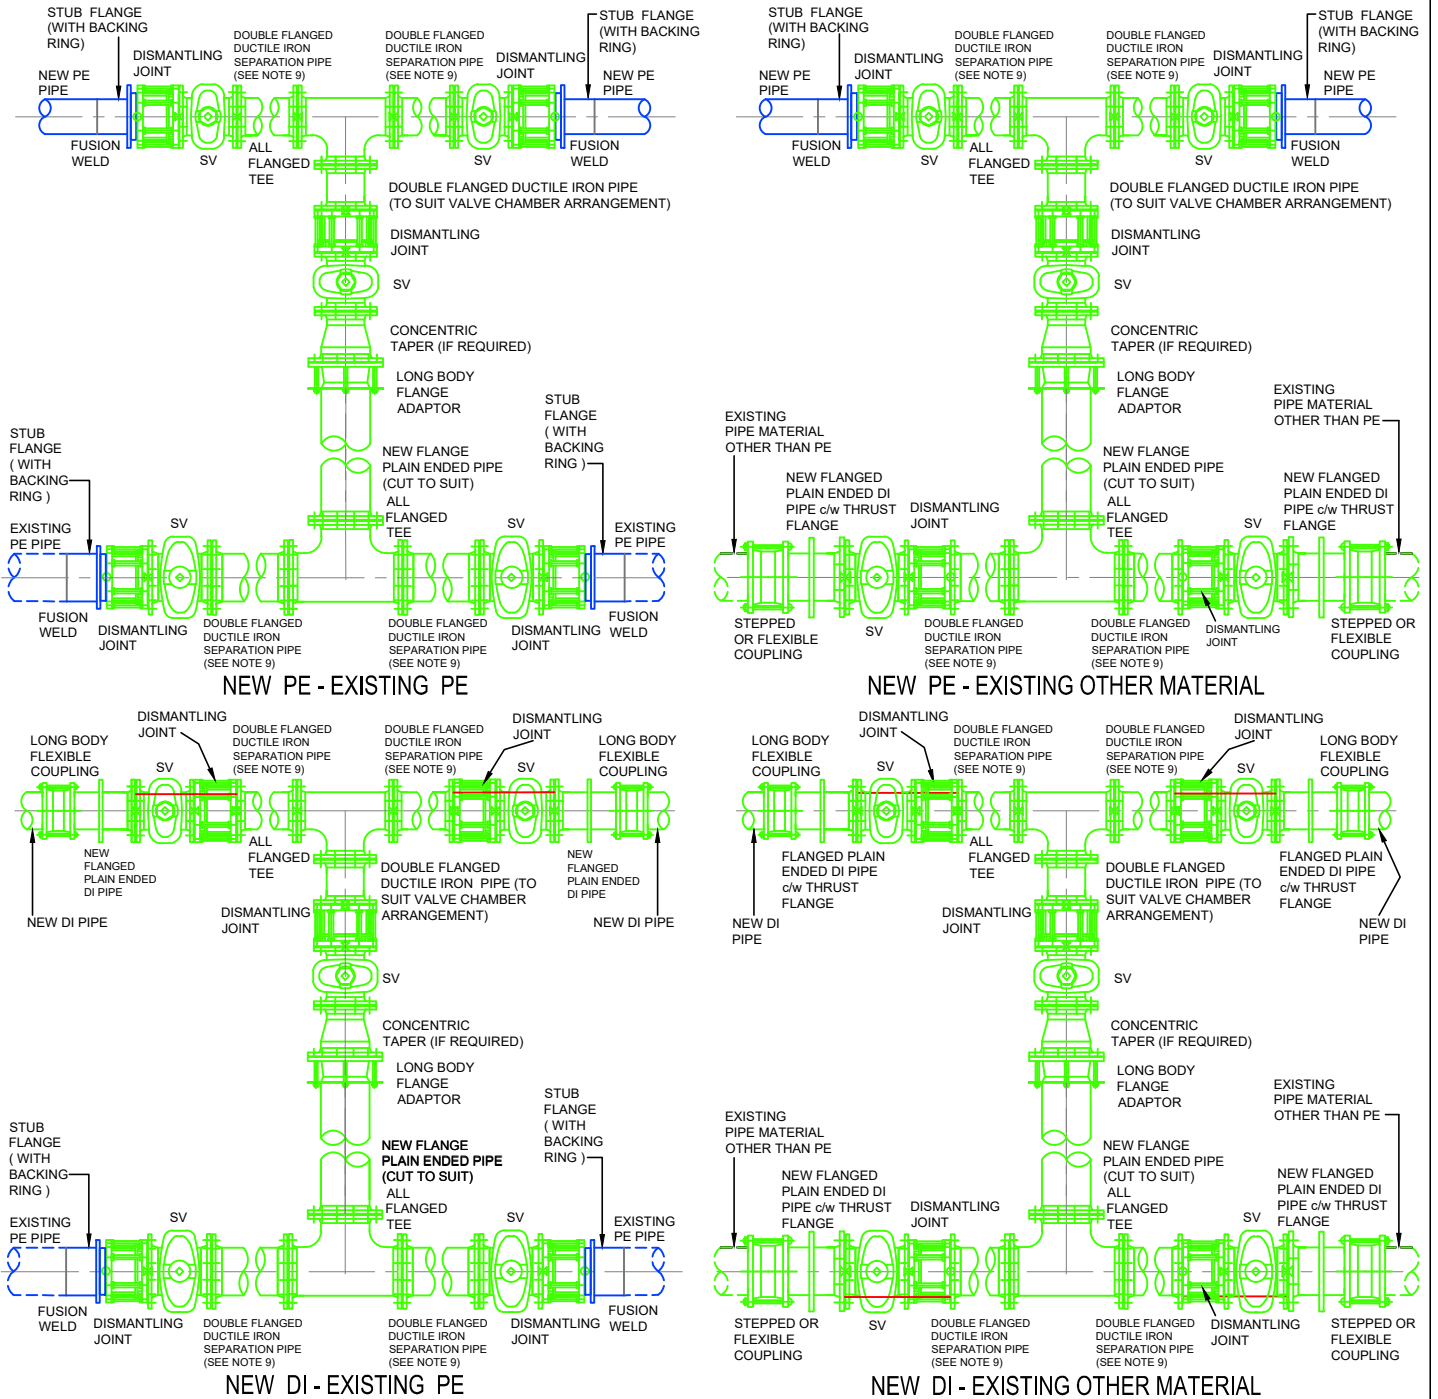


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						<b>STANDARD DETAILS - WATER</b> TITLE <b>GENERAL PIPE CONNECTIONS</b> (Sheet 5 of 7)	SCALE	DATE
							NOT TO SCALE	SEPT. 2015
							DRAWING No.	REV
							<b>STD-W- 08</b>	<b>2</b>
	No.	Date	Drn	Chk	Description	App		



1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. ALL BENDS, TEES, DEAD ENDS, ETC. OF PIPELINES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
3. BUTT FUSION WELDING AND ELECTRO FUSION JOINTING OF PIPES SHALL ONLY BE CARRIED OUT BY TRAINED OPERATIVES IN POSSESSION OF A CURRENT TRAINING CERTIFICATE, USING FULLY AUTOMATIC APPROVED JOINTING MACHINE/RIGS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE IDENTITY OF THE PE PIPELINE MANUFACTURER SHALL BE MADE KNOWN TO IRISH WATER PRIOR TO COMMENCEMENT OF THE INSTALLATION. CERTIFICATION AND TESTING (INCLUDING INDEPENDENT THIRD PARTY CERTIFICATION) SHALL BE PROVIDED TO CONFIRM QUALITY ASSURANCE COMPLIANCE. EACH JOINT SHALL BE CLEARLY MARKED WITH THE JOINT LOGGED AUTOMATICALLY ON THE JOINTING MACHINE. A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT, SHALL BE PROVIDED AND RETAINED FOR QUALITY ASSURANCE PURPOSES.
4. CONNECTING TO EXISTING MAINS IS TO BE CARRIED OUT BY IRISH WATER OR AN APPROVED IRISH WATER AGENT.
5. WHEN EXISTING AC WATERMAINS ARE PRESENT A SPECIFIC METHOD STATEMENT SHALL BE SUBMITTED TO IRISH WATER PRIOR TO WORKS TAKING PLACE AND SUBJECT TO WRITTEN APPROVAL, DETAILING THE PROTECTION TO BE PUT IN PLACE TO EXISTING MAINS, METHOD OF REMOVAL OF EXISTING AC, METHOD OF DISPOSAL OF EXISTING AC AND METHOD OF CONNECTION TO EXISTING AC.
6. PIPE MATERIAL REFERENCES AS FOLLOWS:  
 AC - ASBESTOS CEMENT  
 DI - DUCTILE IRON  
 CI - CAST IRON  
 PE - POLYETHYLENE  
 uPVC - UNPLASTICISED POLY VINYL CHLORIDE  
 ST - STEEL  
 OTHER - REFERS TO ALL EXISTING PIPE MATERIALS OTHER THAN PE (TYPICALLY AC, DI, CI, uPVC & ST)
7. SLUICE VALVE CHAMBERS TO BE IN ACCORDANCE WITH STD-W-14 (DI) AND STD-W-15 (PE). CHAMBERS NOT SHOWN FOR CLARITY.
8. ALL THRUST FLANGES TO BE ADEQUATELY RESTRAINED BY THRUST BLOCKS AS PER DRAWING No. STD-W-28. THRUST BLOCKS NOT SHOWN FOR CLARITY.
9. DOUBLE FLANGED SEPARATION PIPE, UP TO 5m IN LENGTH, MAY BE REQUIRED TO ALLOW SEPARATION DISTANCE BETWEEN VALVE CHAMBERS.
10. UNEQUAL TEES MAY BE USED INSTEAD OF CONCENTRIC TAPERS (WHERE APPLICABLE).

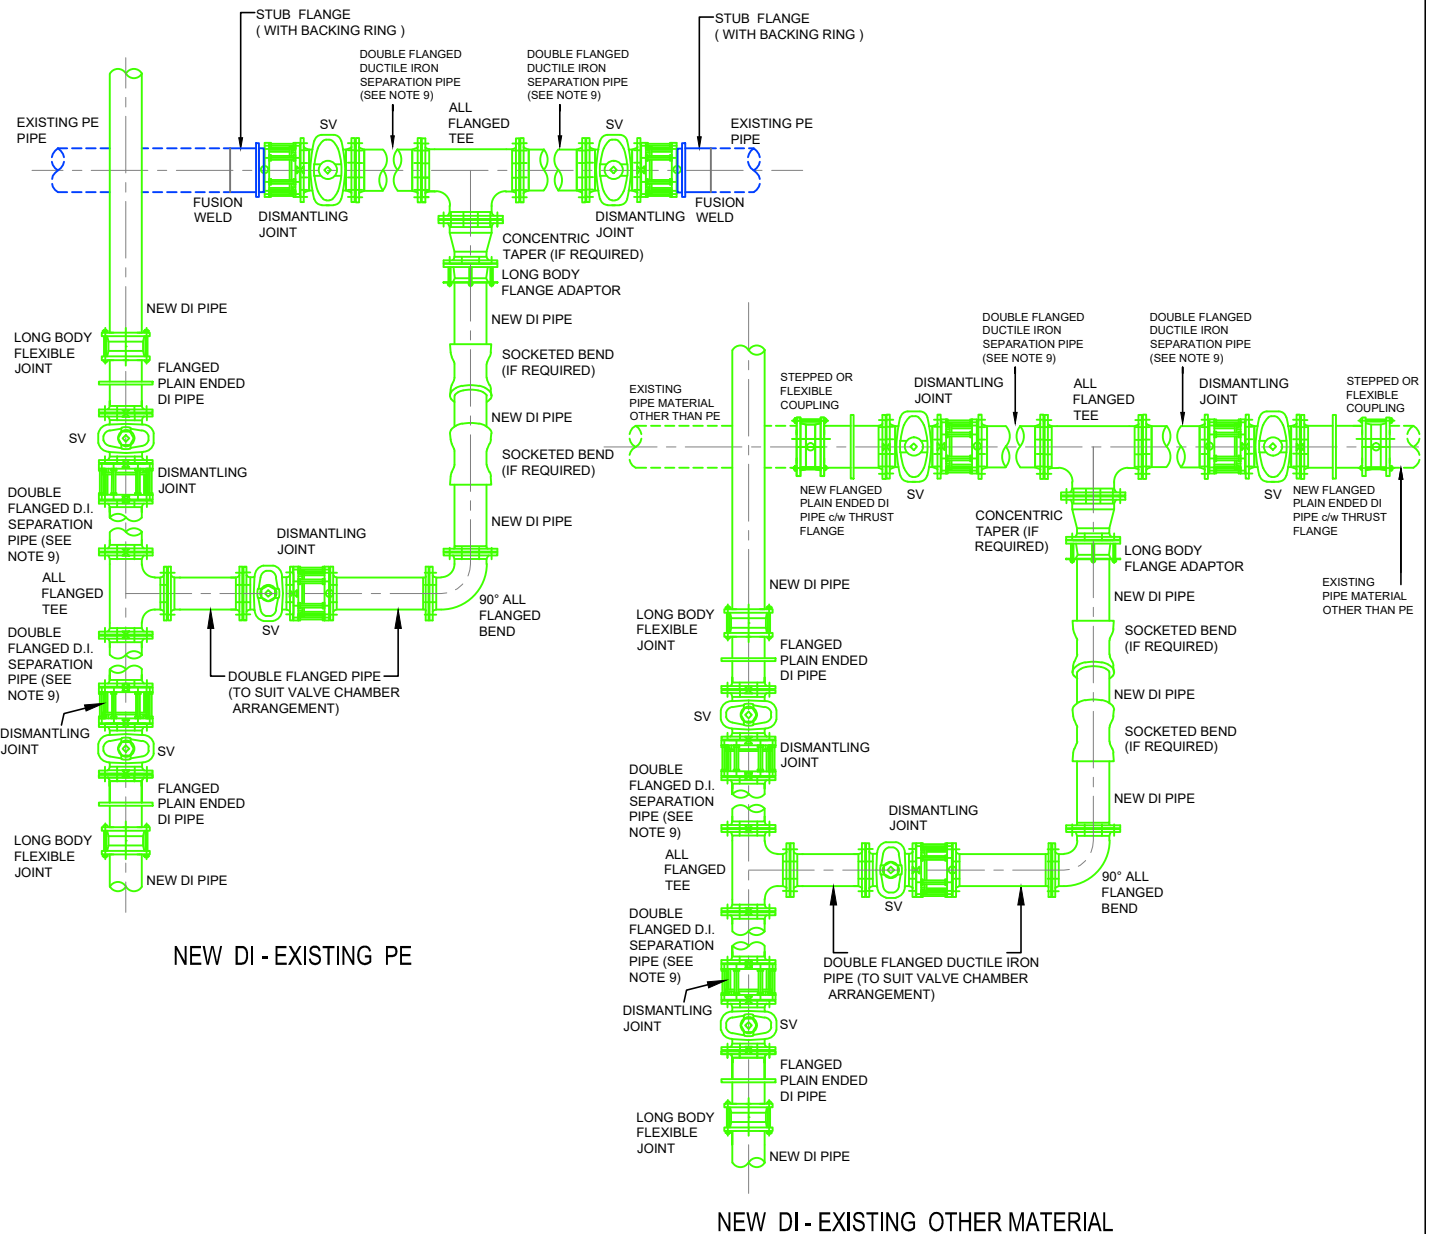


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						<b>STANDARD DETAILS - WATER</b> TITLE <b>GENERAL PIPE CONNECTIONS</b> (Sheet 7 of 7)	SCALE NOT TO SCALE	DATE SEPT. 2015	
	2	07/20	RH	TOC	Added Note 10, separation pipe material added, dismantling joints relocated		MOD	DRAWING No.	REV
	1	11/17	JMC	TOC	Notes added & updated		MOD	<b>STD-W- 10</b>	<b>2</b>
	0	09/15	JMC	TOC	Initial Issue		SL		
	No	Date	Drn	Chk	Description		App		

- SEPARATION DISTANCES BETWEEN WATERMANS ASSOCIATED WITH THE WORKS FROM OTHER UTILITY PIPES AND ACCESSORIES SHALL BE IN ACCORDANCE WITH SECTION 3.6 OF THE CODE OF PRACTICE. SEPARATION DISTANCES FOR ALL NEW INSTALLATIONS FROM EXISTING IRISH WATER PIPES SHALL BE AS OUTLINED IN SECTION 3.27 OF THE CODE OF PRACTICE. THE SEPARATION DISTANCES SPECIFIED ARE MINIMUM DISTANCES.
- SPECIFIC SEPARATION CLEARANCE DISTANCES IN EXCESS OF THESE MINIMA SHALL BE PROVIDED FOR SERVICES SUCH AS GAS, ELECTRICITY, FIBRE-OPTIC OR OIL FILLED CABLES AS THE CASE MAY BE. THE PARTICULAR UTILITY PROVIDERS SHALL BE CONSULTED TO DETERMINE THESE MINIMUM SEPARATION DISTANCES AND EVIDENCE OF THIS CONSULTATION, WITH THE SPECIFIED SEPARATION DISTANCES, SHALL BE PROVIDED TO IRISH WATER AT DESIGN STAGE.
- WATERMAIN (PROPOSED) SEPARATION DISTANCES**  
**HORIZONTAL**  
 300mm TO DISTRIBUTION MAINS OF LESS THAN 300mm DIAMETER.  
 500mm TO TRUNK MAINS BETWEEN 300mm AND 450mm DIAMETER.  
 3m TO ARTERIAL WATER MAINS OF GREATER THAN 450mm DIAMETER.  
**VERTICAL**  
 300mm TO DISTRIBUTION MAINS OF LESS THAN 300mm DIAMETER.  
 500mm TO TRUNK/ARTERIAL MAINS OF DIAMETER GREATER THAN 300mm.  
 ANY PROPOSED PIPE CROSSING SHOULD BE LOCATED MID-WAY BETWEEN THE WATER JOINTS WITH MINIMUM CLEAR DISTANCE OF 300mm AND UP TO 500mm. ALL CROSSINGS SHOULD BE AT LEAST 500mm AWAY FROM FITTINGS OR JOINTS
- WATERMAIN (EXISTING) SEPARATION DISTANCES**  
**HORIZONTAL**  
 IN THE CASE OF INSTALLATIONS IN CLOSE PROXIMITY TO EXISTING WATER MAINS AND SEWERS, THE FOLLOWING MINIMUM HORIZONTAL DISTANCES SHALL BE MAINTAINED BETWEEN PIPES/DUCTS, CABINETS, POLES, MANHOLES, JUNCTION BOXES, CHAMBERS, ETC. WHERE THE DEPTH OF THE EXISTING INFRASTRUCTURE DOES NOT EXCEED 1.5m  
 600mm AT EITHER SIDE OF MAINS UP TO AND INCLUDING 150mm DIAMETER;  
 1m AT EITHER SIDE OF MAINS OF 200mm TO 250mm DIAMETER;  
 2m AT EITHER SIDE OF MAINS OF 300mm AND 375mm DIAMETER;  
 5m AT EITHER SIDE OF MAINS OF 400mm AND 450mm DIAMETER;  
 SPECIFIC IRISH WATER ADVISED DISTANCES FOR MAINS IN EXCESS OF 450mm;  
 600mm AT EITHER SIDE OF GRAVITY SEWER UP TO AND INCLUDING 225mm DIAMETER;  
 1m AT EITHER SIDE OF GRAVITY SEWER OF 300mm AND UP TO 450mm DIAMETER;  
 1.5m AT EITHER SIDE OF GRAVITY SEWERS OF 600mm DIAMETER AND GREATER ;  
 NOTIFICATION IN WRITING IS REQUIRED SHOULD WORKS BE WITHIN THE FOLLOWING DISTANCES FROM AN EXISTING WATER MAIN OR WASTEWATER RISING MAIN WHERE THE DEPTH OF THE EXISTING INFRASTRUCTURE DOES NOT EXCEED 1.5m:-  
**HORIZONTAL**  
 1m AT EITHER SIDE OF EXISTING PIPES LESS THAN 200mm DIAMETER;  
 2m AT EITHER SIDE OF EXISTING PIPES OF 200mm TO 350mm DIAMETER;  
 5m AT EITHER SIDE OF EXISTING PIPES OF 350mm OR GREATER;  
 WHERE DUCTS OR PIPES ARE TO BE LAID CLOSE TO AN EXISTING WATERMAIN OR SEWER IN THE OWNERSHIP OF IRISH WATER. NOTIFICATION IN WRITING SHALL BE PROVIDED A MINIMUM OF 10 DAYS AHEAD OF ADVANCEMENT OF THE WORK. THIS ALSO APPLIES WHERE THE DEPTH OF THE IRISH WATER WATERMAIN OR SEWER EXCEEDS 1.5m. IN ALL OF THESE INSTANCES, SPECIFIC WRITTEN APPROVAL WILL BE REQUIRED FROM IRISH WATER BEFORE PROCEEDING WITH THE WORK. NOTIFICATION IN WRITING IS REQUIRED SHOULD WORKS BE WITHIN 1.5m DISTANCE OF A WASTEWATER SEWER. REQUIREMENTS SHALL ALSO APPLY TO TRIAL HOLES OR SLIT TRENCHES TO LOCATE THE MAIN OR GAIN GROUND INFO DATA. LARGER DIAMETERS >300mm DISTRIBUTION AND TRUNK MAINS. IRISH WATER MUST BE NOTIFIED AT LEAST 1 MONTH IN ADVANCE. DEVELOPERS SHALL ALSO COMPLY WITH ANY NOTIFICATION REQUIREMENTS OF OTHER UTILITY PROVIDERS (ESB, GAS MAIN, TELECOMMUNICATION ETC).  
 6. DETAILED PROPOSALS, INCLUDING WORK METHOD STATEMENTS, INSURANCE CONFIRMATION AND DETAILS OF WORK COMPLETED OF A SIMILAR NATURE MUST BE SUBMITTED TO IRISH WATER FOR ITS CONSIDERATION BEFORE AGREEMENT WILL ISSUE. ALL SUCH WORKS IN THE VICINITY OF ARTERIAL WATER MAINS AND SEWERS (MAINS GREATER THAN 400mm) SHALL BE SUBJECT TO WRITTEN AGREEMENT WITH IRISH WATER BEFORE CONSTRUCTION COMMENCES ON SITE. THIS AGREEMENT SHALL ALSO INCLUDE ANY NECESSARY PROTECTION FOR WATER MAINS.  
 7. ANY DAMAGE SHALL BE NOTIFIED IMMEDIATELY TO IRISH WATER. THE PERSON WHO CAUSES THE DAMAGE TO A WATER MAIN OR FITTING WILL BE DEEMED TO HAVE COMMITTED AN OFFENCE UNDER SECTION 45 OF THE WATER SERVICES ACT 2007.  
 8. WATERMANS OF ANY SIZE SHALL NOT BE WITHIN 1m OF THE BOUNDARY TO A PREMISES  
 9. UNDER NO CIRCUMSTANCES WILL IRISH WATER ACCEPT WATER MAIN INSTALLATIONS UNDER STRUCTURES, EXISTING OR PROPOSED, OR IN CLOSE PROXIMITY TO ANY EXISTING STRUCTURES OR FEATURES THAT WILL INHIBIT ACCESS FOR POST INSTALLATION MAINTENANCE AND ACCESS.  
 10. WHERE THE DESIGN DEVIATES FROM THIS STANDARD DETAIL, THE DESIGN SHALL BE SUBJECT TO THE REVIEW OF IRISH WATER.  
 11. SEPARATION DISTANCES BETWEEN UTILITIES MAY BE INCREASED TO PROVIDE FOR CHAMBER & THRUST BLOCKS AT BENDS.  
 12. WHERE A GRASS VERGE IS NOT AVAILABLE AND A FOOTPATH IS LESS THAN 1.5m WIDE, THE WATERMAIN IS PERMITTED ON THE ROADWAY.

DIAMETER (mm)	'C' (mm)
≤150	3000
200 - 600	5000
>600	8000

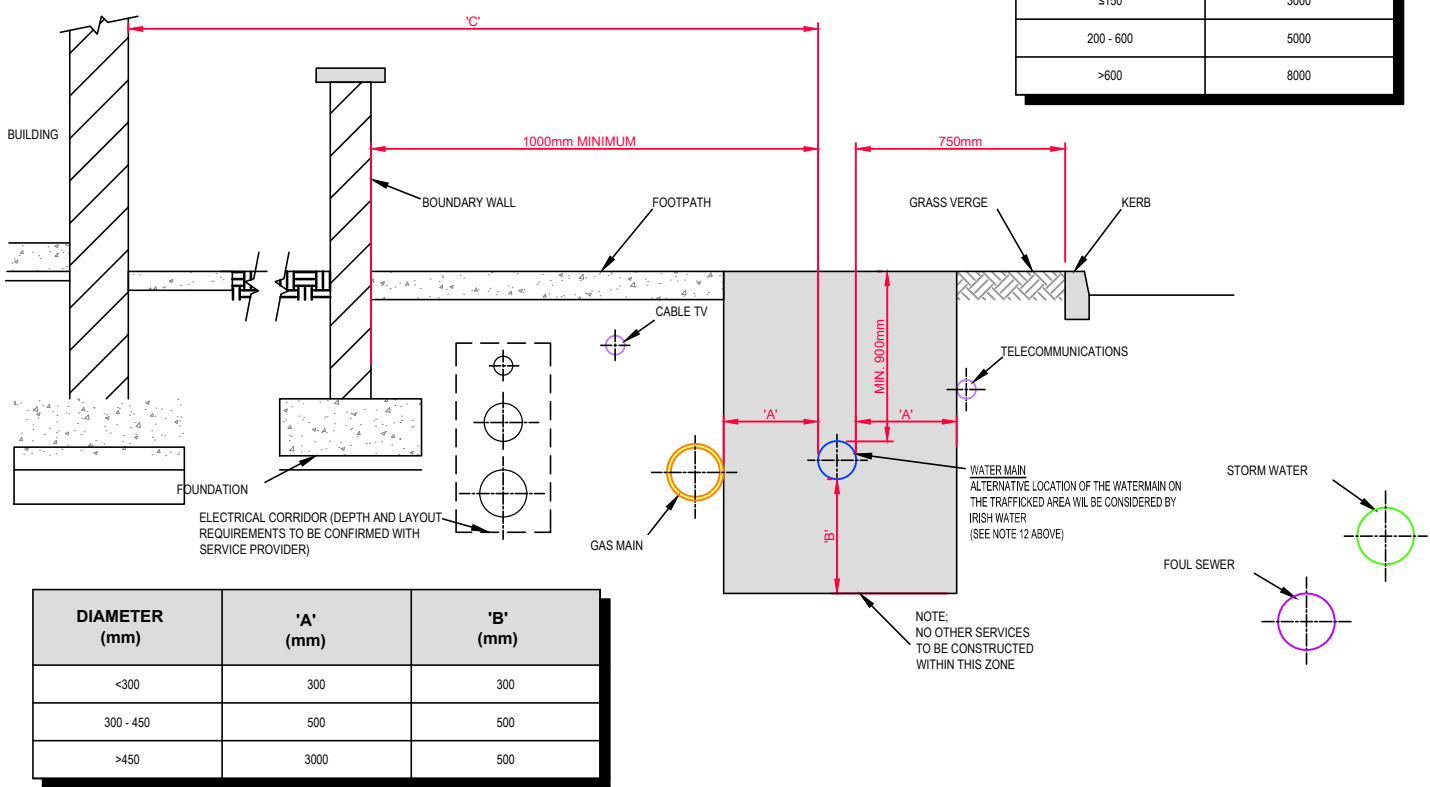

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



No.	Date	Drm	Chk	Description	App
2	07/20	RH	TOC	Notes added & updated	MOD
1	11/17	JMC	TOC	Notes added & updated	MOD
0	09/15	JMC	TOC	Initial Issue	SL

**STANDARD DETAILS - WATER**

TITLE

**TYPICAL SERVICE LAYOUT  
INDICATING SEPARATION DISTANCES**

SCALE NOT TO SCALE	DATE SEPT. 2015
DRAWING No. <b>STD-W- 11</b>	REV <b>2</b>



**METHOD STATEMENTS:**  
 ALL WORKS SHALL BE CARRIED  
 OUT IN ACCORDANCE WITH BS 5837 AND INFORMED BY  
 NJUG VOLUME 4

**PRECAUTION AREA:**

EXCAVATIONS FOR PIPEWORK SHOULD NOT BE  
 UNDERTAKEN WITHIN THIS AREA, UNLESS AGREED WITH  
 IRISH WATER.

WORKS WITHIN THE PRECAUTION ZONE MUST BE  
 SUPERVISED BY A QUALIFIED ARBORIST. WORKS SHALL BE  
 SUBJECT OF A CLEAR METHOD STATEMENT OUTLINING ALL  
 WORKS ADJACENT TO THE TREES/SHRUBS WHICH IS TO BE  
 PREPARED & AGREED IN ADVANCE OF THE WORKS.


MATERIAL, PLANT & SPOIL SHALL NOT BE STORED WITHIN  
 THIS ZONE.

**EXCLUSION AREA:**

WORKS IN THIS AREA ARE TO BE AVOIDED, UNLESS  
 ABSOLUTELY NECESSARY & AGREED WITH IRISH WATER.

EXCAVATIONS FOR PIPEWORK SHOULD NOT BE  
 UNDERTAKEN WITHIN THIS AREA, UNLESS NECESSARY AND  
 NO OTHER OPTIONS AVAILABLE. WORKS WITHIN THE  
 EXCLUSION ZONE MUST BE SUPERVISED BY A QUALIFIED  
 ARBORIST AND AGREED WITH IRISH WATER. WORKS SHALL  
 BE SUBJECT OF AN ARBORICULTURAL IMPACT  
 ASSESSMENT AS PER BS 5837 & A CLEAR METHOD  
 STATEMENT OUTLINING ALL WORKS ADJACENT TO THE  
 TREES/SHRUBS IS TO BE PREPARED AND AGREED IN  
 ADVANCE OF THE WORKS.

MATERIAL, PLANT & SPOIL SHALL NOT BE STORED WITHIN  
 THIS ZONE.

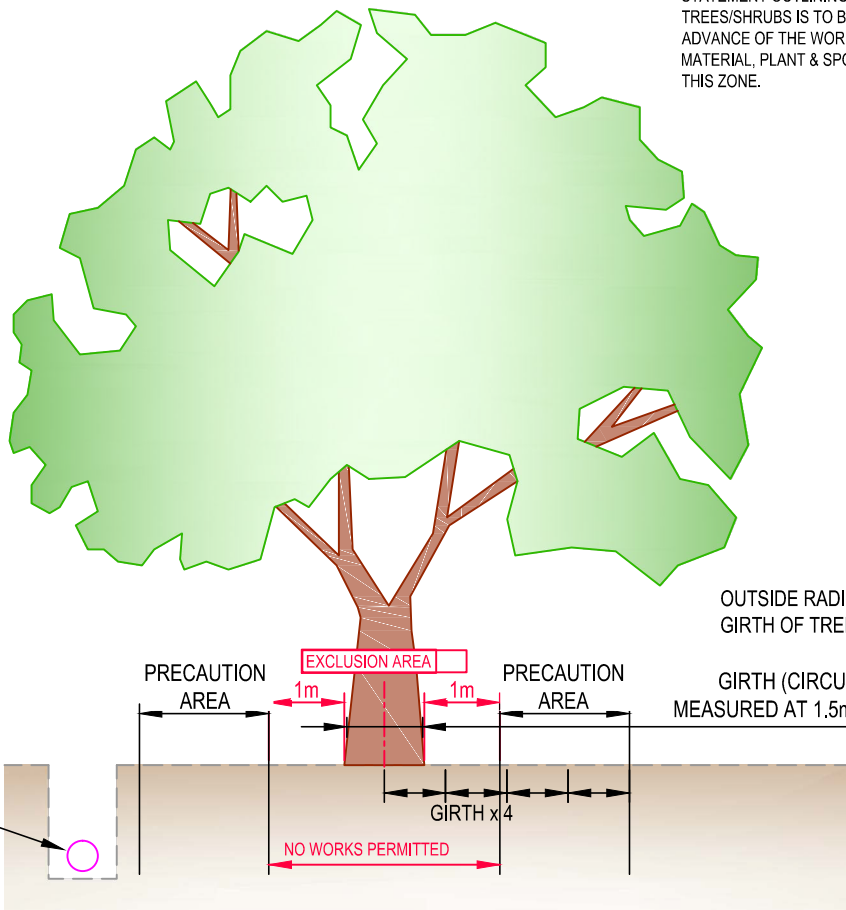

OUTSIDE RADIUS OF PRECAUTION AREA = 4 x  
 GIRTH OF TREE

GIRTH (CIRCUMFERENCE OF TREE  
 MEASURED AT 1.5m ABOVE GROUND LEVEL)


PREVENTION MEASURES  
 REQUIRED IN LINE WITH  
 LANDSCAPING DESIGN & SPECIAL  
 PROTECTION REQUIRED. (e.g. BY  
 USE OF APPROPRIATE BARRIERS,  
 HIGH PERFORMANCE JOINTS, OR  
 BY USE OF POLYETHYLENE WITH  
 WELDED JOINTS). THE LANDSCAPE  
 DESIGN AND DETAILS OF THE  
 SPECIAL PROTECTION MEASURES  
 MUST BE AGREED WITH IRISH  
 WATER

# EXISTING PLANTING:

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						STANDARD DETAILS - WATER		SCALE NOT TO SCALE	DATE SEPT. 2015
						TITLE	DRAWING No.	REV	
	2	11/17	JMC	TOC	Revised to suit ILL recommendations & changed drawing title	MOD	RESTRICTIONS ON WATER INFRASTRUCTURE WORKS ADJACENT TO EXISTING TREES	STD-W- 12	2
	1	08/16	JMC	TOC	Added new section & notes	MOD			
0	09/15	JMC	TOC	Initial Issue	SL				
No.	Date	Drn	Chk	Description	App				

## DIAGRAM 1: DECISION FLOW CHART

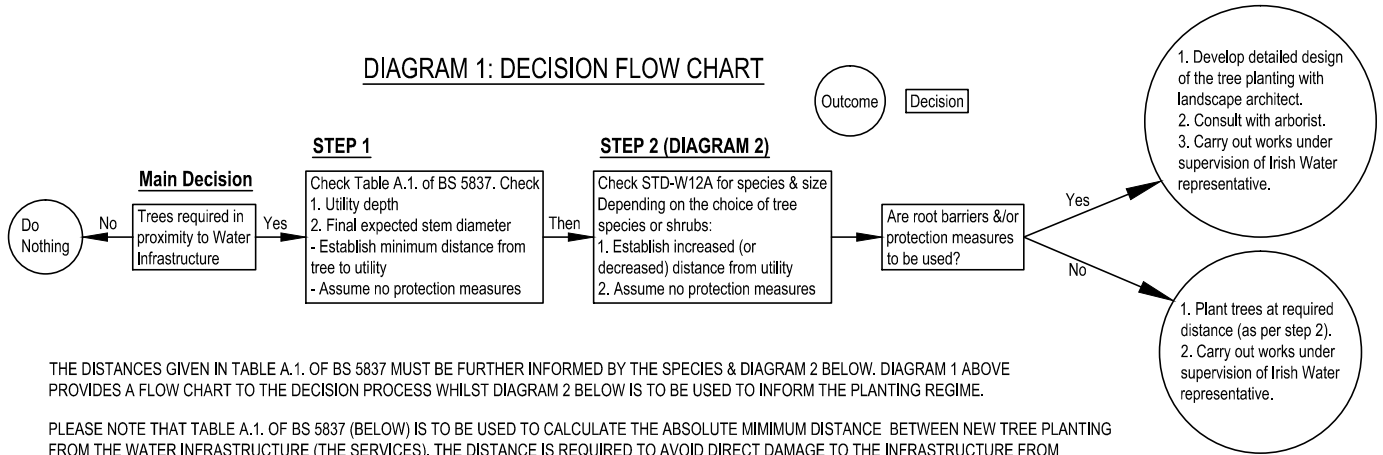

THE DISTANCES GIVEN IN TABLE A.1. OF BS 5837 MUST BE FURTHER INFORMED BY THE SPECIES & DIAGRAM 2 BELOW. DIAGRAM 1 ABOVE PROVIDES A FLOW CHART TO THE DECISION PROCESS WHILST DIAGRAM 2 BELOW IS TO BE USED TO INFORM THE PLANTING REGIME.

PLEASE NOTE THAT TABLE A.1. OF BS 5837 (BELOW) IS TO BE USED TO CALCULATE THE ABSOLUTE MINIMUM DISTANCE BETWEEN NEW TREE PLANTING FROM THE WATER INFRASTRUCTURE (THE SERVICES). THE DISTANCE IS REQUIRED TO AVOID DIRECT DAMAGE TO THE INFRASTRUCTURE FROM FUTURE GROWTH. THE DISTANCE IS A FUNCTION OF THE DEPTH OF THE SERVICES AND THE (FINAL EXPECTED) STEM DIAMETER OF THE TREE AT MATURITY (i.e. FINAL EXPECTED GROWTH).

TABLE A.1. BS 5837	Minimum distance between young trees or new planting & structures, in metres (m)		
	Final stem dia. < 300mm	Final stem dia. 300mm to 600mm	Final stem dia. > 600mm
Services			
< 1m deep	0.5	1.5	3.0
> 1m deep	--	1.0	2.0

THUS FOR EXAMPLE:

- FOR A SERVICE LESS THAN 1 METRE DEEP, THE MINIMUM DISTANCE IS TO BE 1.5m FOR A TREE BETWEEN 300 AND 600mm STEM DIAMETER AT MATURITY.
- FOR A SERVICE GREATER THAN 1 METRE DEEP, THE MINIMUM DISTANCE IS TO BE 1.0m FOR A TREE BETWEEN 300 AND 600mm STEM DIAMETER AT MATURITY.


### NOTE: RESTRICTIONS RELATE TO INFRASTRUCTURE WITHOUT ROOT INTRUSION PROTECTION.

THE DESIGN OF LANDSCAPING SHALL BE UNDERTAKEN IN CONJUNCTION WITH THE DESIGN OF WATER INFRASTRUCTURE, ETC. THE TREE/BUSH/SHRUB SHALL NOT BE LOCATED CLOSER TO THE WATER INFRASTRUCTURE THAN INDICATED ABOVE, EXCEPT WHERE SPECIAL PROTECTION MEASURES ARE PROVIDED. WHERE THERE IS A RISK OF TREE/ROOT INTRUSION, THE WATER INFRASTRUCTURE SHALL BE RESISTANT TO TREE ROOT INGRESS (e.g. BY USE OF APPROPRIATE BARRIERS, HIGH PERFORMANCE JOINTS, OR BY USE OF POLYETHYLENE WITH WELDED JOINTS). THE LANDSCAPE DESIGN AND DETAILS OF THE SPECIAL PROTECTION MEASURES MUST BE AGREED WITH IRISH WATER

A TREE SHALL NOT BE PLANTED DIRECTLY OVER WATER INFRASTRUCTURE WHERE EXCAVATION OF THE INFRASTRUCTURE WOULD REQUIRE REMOVAL OF THE TREE UNLESS SUCH PLANTING IS AGREED WITH IRISH WATER AND IN GENERAL ONLY SHALLOW ROOTING SHRUBS SHALL BE PLANTED CLOSE TO WATER INFRASTRUCTURE.

PLEASE ENSURE THAT THESE DISTANCES ARE ADHERED TO IN ORDER TO PROTECT THE TREES FROM ANY FUTURE MAINTENANCE. REFERENCE SHOULD ALSO BE MADE TO BS 5837, BS 8545 AND THE NJUG GUIDELINES VOLUME 4 FOR FURTHER INFORMATION.

## DIAGRAM 2: PLANTING DISTANCES FOR DIFFERENT SPECIES WITHOUT BARRIER PROTECTION

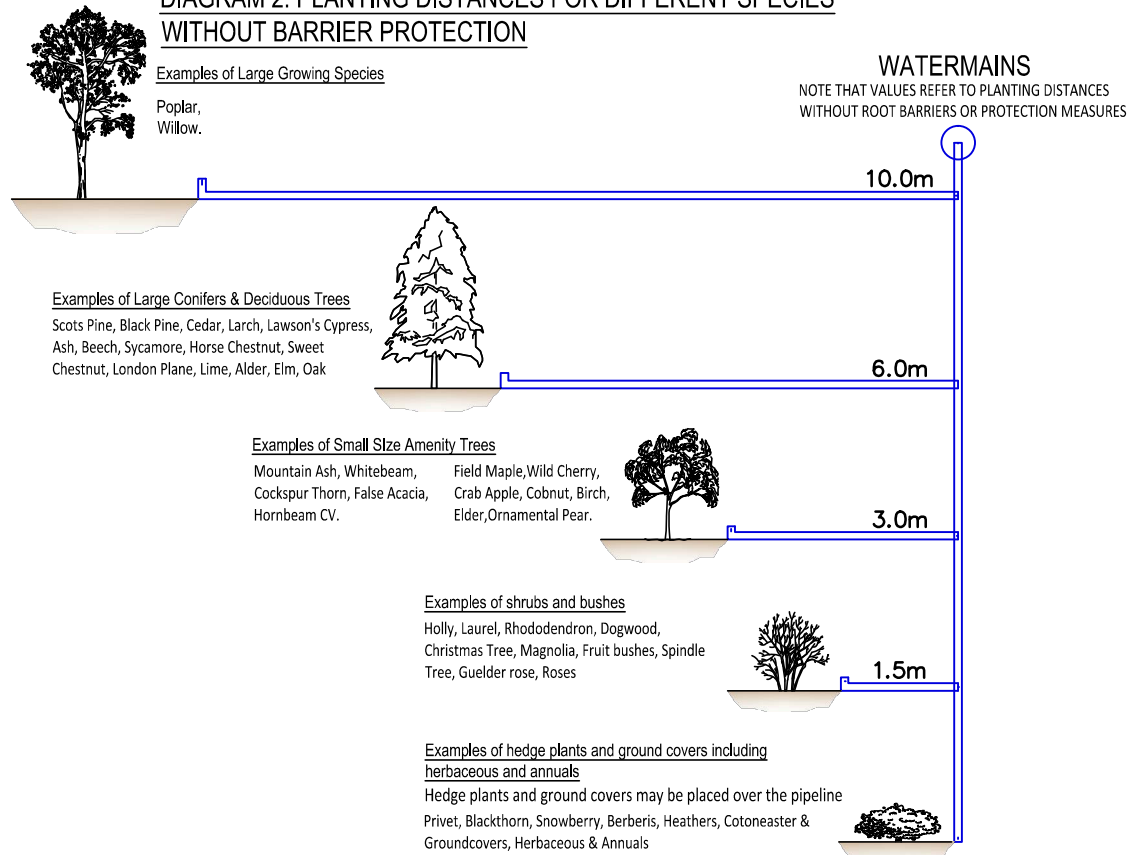


NOTE: OTHER SPECIES NOT NAMED TO BE PLANTED TO THE SAME SPACINGS DEPENDING ON ROOT FORMATION.


### REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

					STANDARD DETAILS - WATER		SCALE NOT TO SCALE	DATE JUL. 2017
	TITLE RESTRICTIONS ON NEW TREES / SHRUBS PLANTING ADJACENT TO WATER MAINS						DRAWING No. STD-W-12A	REV 0
0	11/17	JMC	TOC	Initial Issue	MOD			
No.	Date	Drm	Chk	Description	App			

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- THE MINIMUM DEPTH OF COVER FROM THE FINISHED GROUND LEVEL TO THE EXTERNAL CROWN OF THE PIPE SHALL BE 900mm WHERE THE PIPE IS TO BE LOCATED IN HOUSING ESTATE ROADS. GREATER DEPTHS OF COVER AND/OR PIPE STRENGTH AND/OR A HIGHER CLASS OF BEDDING MATERIAL MAY BE REQUIRED WHERE HIGH TRAFFIC LOADING IS ANTICIPATED. THE DESIRABLE COVER FOR A WATERMAIN SHOULD BE 1200mm, WHERE PRACTICABLE & SHOULD NOT EXCEED 3.0m.
- CLAUSE 804 / 808 MATERIAL IN ACCORDANCE WITH THE NATIONAL ROADS AUTHORITY SPECIFICATION FOR ROAD WORKS IS TO BE USED AS BACKFILL MATERIAL WHERE THE WATER MAIN IS LOCATED IN ROADS, FOOTPATHS OR WHEN THE NEAREST PART OF THE TRENCH IS WITHIN 1m OF THE PAVED EDGE OF THE ROADWAY. CLAUSE 804 / 808 IS TO BE COMPACTED AS PER CLAUSE 802 OF THE NATIONAL ROADS AUTHORITY SPECIFICATION FOR ROAD WORKS. CLAUSE 808 IS TO BE USED WITHIN 500mm OF CEMENT BOUND MATERIALS, CONCRETE PAVEMENTS, CONCRETE STRUCTURES OR CONCRETE PRODUCTS. OTHERWISE CLAUSE 804 MAY BE USED. ALTERNATIVE BACKFILL MATERIAL TO THAT DESCRIBED ABOVE (CLAUSE 804 OR CLAUSE 808) OF THE PIPE TRENCH WILL ONLY BE ALLOWED BY IRISH WATER WHERE THE ROADS AUTHORITY IN WHOSE FUNCTIONAL AREA THE DEVELOPMENT IS LOCATED, PROVIDES **WRITTEN APPROVAL** TO THE DEVELOPER TO THE USE SUCH ALTERNATIVE MATERIAL.
- SELECTED EXCAVATED MATERIAL MAY BE USED IN GREEN-FIELD AREAS ABOVE GRANULAR PIPE SURROUND MATERIAL SUBJECT TO REVIEW BY IRISH WATER.
- PIPE BEDDING SHALL COMPLY WITH WIS 4-08-02 AND IGN 4-08-01 GRANULAR MATERIAL SHALL BE 14mm TO 5mm (  $\frac{3}{4}$  ) GRADED AGGREGATE OR 10mm (  $\frac{3}{4}$  ) SINGLE SIZED AGGREGATE TO IS EN 13242.
- IN SOFT GROUND CONDITIONS (CBR < 5) THE MATERIAL SHOULD BE EXCAVATED OUT AND DISPOSED OF IN ACCORDANCE WITH THE WASTE MANAGEMENT ACT AND CLAUSE 804 / 808 MATERIAL IN ACCORDANCE WITH THE NATIONAL ROADS AUTHORITY SPECIFICATION FOR ROAD WORKS SHALL REPLACE THE EXCAVATED MATERIAL, WRAPPED IN GEO-TEXTILE WRAPPING. ALTERNATIVELY, SPECIAL PIPE SUPPORT ARRANGEMENTS, INCLUDING PILING ETC. MAY BE REQUIRED WHERE THE DEPTH OF SOFT MATERIAL IS EXCESSIVE. SUCH ARRANGEMENTS SHALL BE SUBJECT TO ASSESSMENT BY IRISH WATER BEFORE ADVANCING WITH THE WORK.
- PIPES SHALL NOT BE SUPPORTED ON STONES OR ROCKS, OR ANY HARD OBJECT AT ANY POINT ALONG THE TRENCH. ROCK SHALL BE EXCAVATED TO A DEPTH OF 150mm BELOW THE ACTUAL DEPTH OF THE TRENCH WITH THE VOID FILLED WITH CLAUSE 804 / 808 MATERIAL IN ACCORDANCE WITH THE NATIONAL ROADS AUTHORITY SPECIFICATION FOR ROAD WORKS. THE GRANULAR MATERIAL SHALL BE LAID ABOVE THIS VOID BACKFILL MATERIAL.
- SHOULD MINIMUM COVER NOT BE ACHIEVABLE, CONCRETE GRADE C8/10 SHALL BE USED AS BACKFILL MATERIAL.
- MARKER TAPE TO BE 400mm WIDE BLUE POLYETHYLENE MATERIAL IN ACCORDANCE WITH EN 12163. PLASTIC PIPES SHALL HAVE WARNING TAPE INCORPORATED A REINFORCED BAND BRACING WIRE. SERVICE PIPES SHALL HAVE 200mm WIDE MESH TAPE. MARKER TAPE TO BE LAID AT TOP OF PIPE BEDDING LAYER.
- TRENCH WIDTHS FOR PIPE SIZES  $\leq 80$ mm MAY BE  $< 500$ mm, SUBJECT TO CONSIDERATION BEING GIVEN TO THE TRENCH DEPTH, HEALTH & SAFETY & CONSTRUCTION ACCESS REQUIREMENTS.
- NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
- EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.

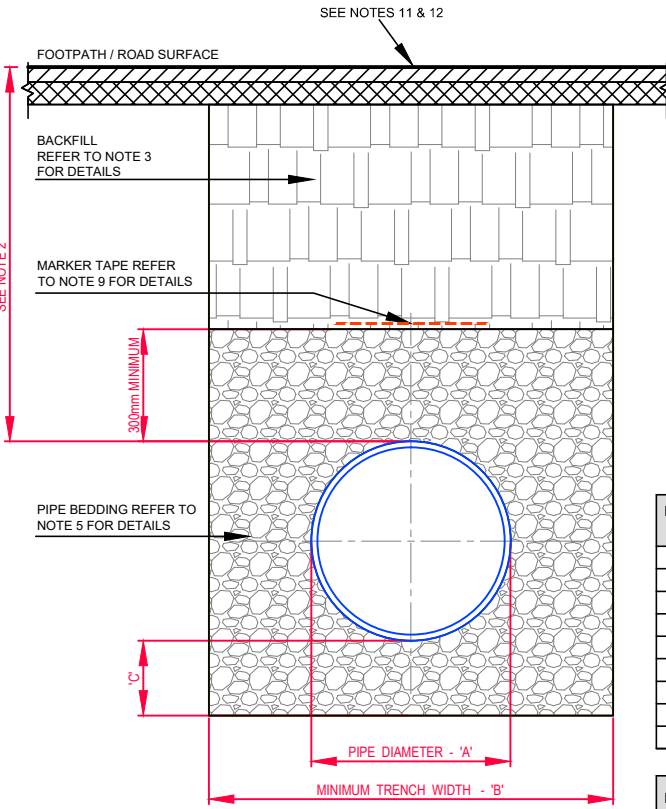


**CROSS SECTION IN ROADWAYS**

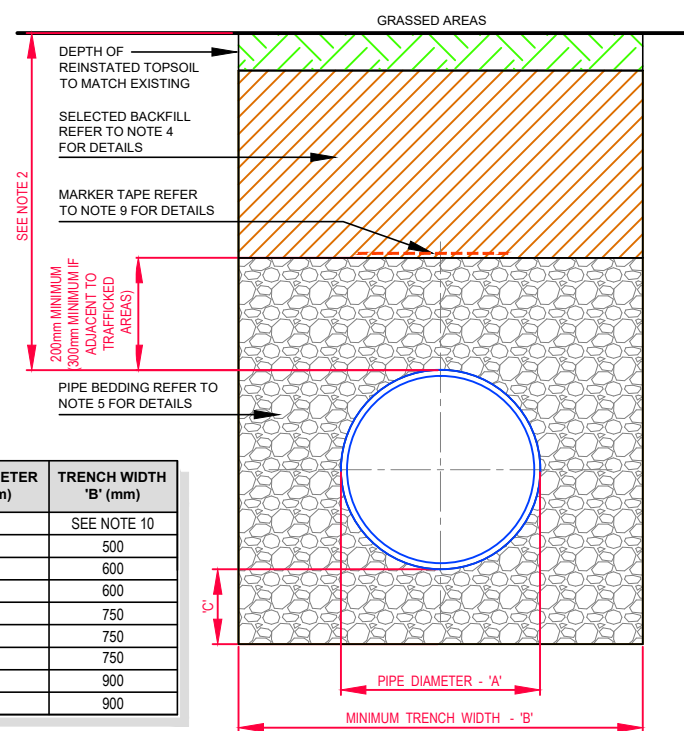

**CROSS SECTION IN GRASSED AREAS**

PIPE DIAMETER 'A' (mm)	TRENCH WIDTH 'B' (mm)
$\leq 80$	SEE NOTE 10
100	500
150	600
200	600
250	750
300	750
350	750
400	900
450	900

PIPE DIAMETER 'A' (mm)	DEPTH OF BEDDING 'C' (mm)
$\leq 200$	150
$\geq 250$	200

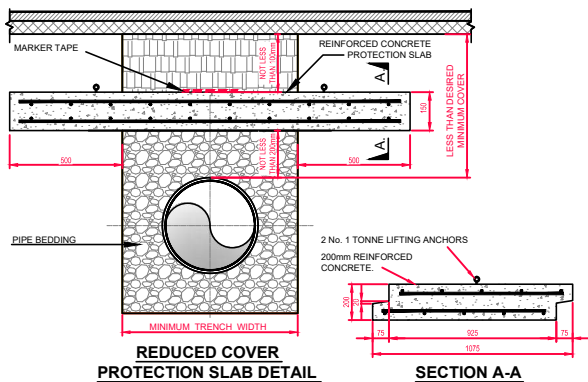

**REDUCED COVER PROTECTION SLAB DETAIL**


**SECTION A-A**

- FOR ANY SLABBING WORKS TO BE CARRIED OUT WITHIN THE VICINITY OF THE PIPELINE, A METHOD STATEMENT IS TO BE SUBMITTED FOR APPROVAL BY IRISH WATER.
  - MARKER TAPE TO BE PLACED ABOVE THE PROTECTION SLAB ALONG THE DIRECTION OF THE PIPELINE
  - CONCRETE TO BE GRADE C30/35
  - MINIMUM COVER TO STEEL REINFORCEMENT = 40mm
  - SLABS TO BE DESIGNED FOR USE UNDER A HB25 LOAD IN ACCORDANCE WITH BS5400-2. DESIGN TO BE SUBMITTED TO IRISH WATER FOR ASSESSMENT PRIOR TO INSTALLATION
  - THE SOIL ON WHICH THE SLAB RESTS MUST HAVE A CBR OF 4% OR GREATER. WHERE THE CBR IS LESS THAN 4% THE MATERIAL SHALL BE REMOVED AND REPLACED WITH IMPORTED GRANULAR MATERIAL AS APPROVED BY IRISH WATER.
  - IF DIRECTION OF PIPELINE AND DIRECTION OF TRAFFIC FLOW ARE PARALLEL, THE DIRECTION OF LAY OF THE SLAB IS TO BE AGAINST THE DIRECTION OF TRAFFIC FLOW.
- 
- IF PIPELINE PROTECTION SLAB IS TO BE USED SOLELY FOR IMPACT PROTECTION & OVERALL DEPTH OF COVER IS GREATER THAN 1.2m, THE DISTANCE BETWEEN UNDERSIDE OF SLAB & TOP OF PIPE MAY BE INCREASED AFTER CONSULTATION WITH IRISH WATER.

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT


UISCE ÉIREANN : IRISH WATER						STANDARD DETAILS - WATER		SCALE	DATE
No	Date	Drn	Chk	Description	App	TITLE		NOT TO SCALE	SEPT. 2015
2	07/20	RH	TOC	Minor edit to note 5 Protection slab detail added Title amended.	MOD	TRENCH BACKFILL / BEDDING & REDUCED COVER PROTECTION SLAB DETAIL		DRAWING No.	REV
1	11/17	JMC	TOC	Added & updated notes	MOD			STD-W- 13	2
0	09/15	JMC	TOC	Initial Issue	SL				



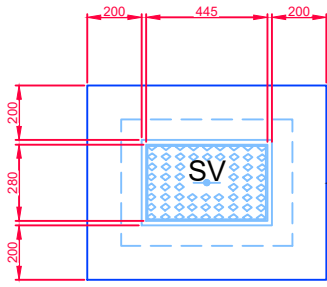


**PLINTH DETAIL IN GRASS AREA**

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. SLUICE VALVE CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 OR BS 5834. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
3. SLUICE VALVES SHALL BE RESILIENT SEATED AND SHALL COMPLY WITH BS 5163-1, BS 5163-2, IS EN 1074-1, IS EN 1074-2, OR EQUIVALENT E.U. SPECIFICATIONS.
4. ALL SLUICE VALVES SHALL BE ANTI-CLOCKWISE CLOSING.
5. VALVE CHAMBER TO BE CONSTRUCTED OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK, ALTERNATIVELY PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1917 & IS 420. PCC CHAMBER RISER UNITS SHOULD BE INTERLOCKING WHEN STACKED TO PREVENT LATERAL MOVEMENT OF INDIVIDUAL UNITS.
6. CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
7. DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
8. 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
9. THURST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
10. ANTI-CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
11. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
12. 450 x 450mm INTERNAL DIMENSION CHAMBERS MAY BE PROVIDED SUBJECT TO REVIEW BY IW. SUCH CHAMBERS SHALL BE PROVIDED WITH GRADE "A" HEAVY DUTY COVER & FRAME & STAMPED "SV" BEARING SLABS TO BE 900 x 900mm IN ALL CASES.
13. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
14. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
15. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.

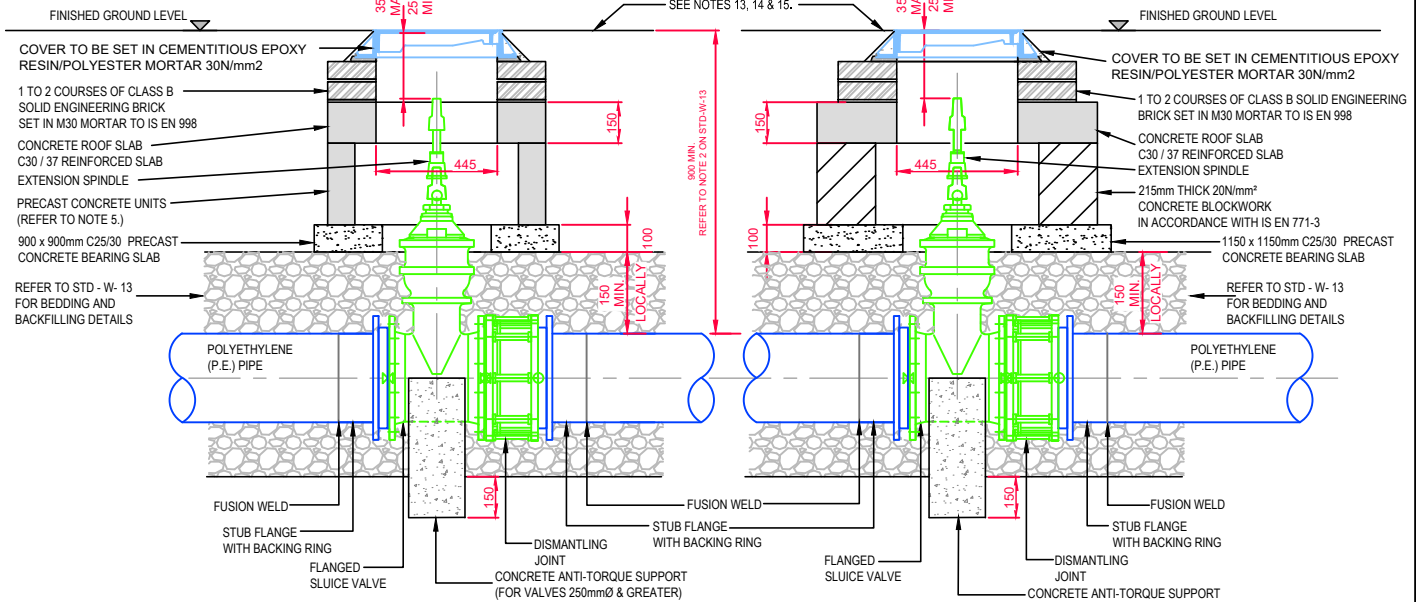


**SECTION**


**SECTION**

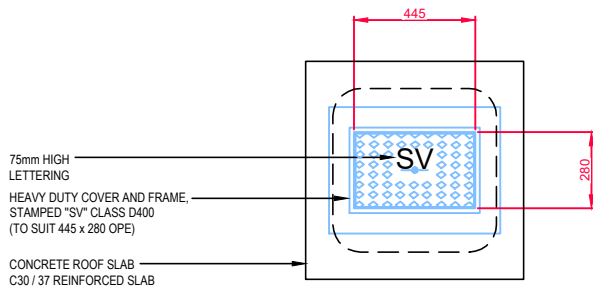


**ROOF PLAN**

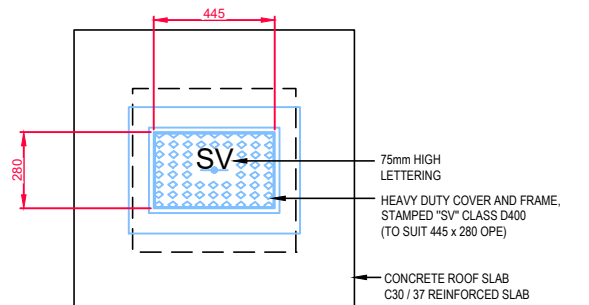

**ROOF PLAN**

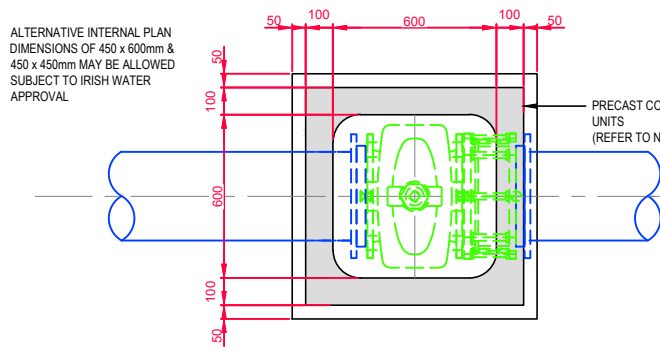


**FLOOR PLAN  
SLUICE VALVE CHAMBER  
(PRECAST CONCRETE CONSTRUCTION)**

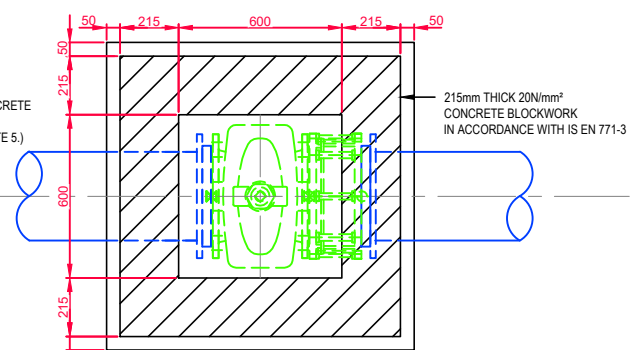

**FLOOR PLAN  
SLUICE VALVE CHAMBER  
(BLOCKWORK CONSTRUCTION)**


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

UISCE ÉIREANN : IRISH WATER							STANDARD DETAILS - WATER		SCALE	DATE
3	07/20	RH	TOC	Updated Anti-Torque Support Note & added plan dimensions note	MOD	TITLE	NOT TO SCALE	SEPT. 2015		
2	11/17	JMC	TOC	Revised & Added Notes	MOD	SLUICE VALVE FOR POLYETHYLENE (P.E.) PIPE (< 350mm DIA.) (Sheet 2 of 2)	DRAWING No.	REV	3	
1	08/16	JMC	TOC	Revised notes 2, 3 & 6	MOD					
0	09/15	JMC	TOC	Initial Issue	SL					
No	Date	Drn	Chk	Description	App					

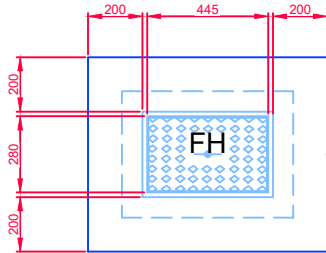


**PLINTH DETAIL IN GRASS AREA**

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. HYDRANT CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 OR BS 5834 COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
3. ALL HYDRANTS, SURFACE BOX FRAMES & COVERS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF IS EN 14339, IS EN 1074-6 & BS 750. FIRE HYDRANTS SHALL BE TYPE 2. THE HYDRANT INLET SHALL BE 80mm DIAMETER WITH PN16.
4. ALL HYDRANTS SHALL BE CLOCKWISE CLOSING.
5. HYDRANT CHAMBER TO BE CONSTRUCTED OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVELY PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1917 & IS 420. PCC CHAMBER RISER UNITS SHOULD BE INTERLOCKING WHEN STACKED TO PREVENT LATERAL MOVEMENT OF INDIVIDUAL UNITS.
6. CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
7. DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545.
8. 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
9. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
10. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
11. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
12. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
13. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
14. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
15. THE FIRE HYDRANT OUTLET TYPE SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE FIRE OFFICER FOR THE AREA AND SHALL BE AGREED PRIOR TO THE COMMENCEMENT OF WORKS.
16. THE HYDRANT SHALL BE DOUBLE FLANGED DRILLED TO PN 16. THEY SHALL COMPLY WITH IS EN 14339, IS EN 1074 PART 6 AND BS 750: 2012. THE HYDRANT SHALL INCORPORATE A SCREW DOWN GATE VALVE, UNDERGROUND "GUIDE TO HEAD" TYPE WITH A FALSE SPINDLE CAP. THE OUTLET SHALL BE IN ACCORDANCE WITH ITEM 15 ABOVE.
17. 450 x 600mm INTERNAL DIMENSION CHAMBERS MAY BE PROVIDED SUBJECT TO REVIEW BY IW. SUCH CHAMBERS SHALL BE PROVIDED WITH GRADE "A" HEAVY DUTY COVER & FRAME & STAMPED "SV". BEARING SLABS TO BE 900 x 900mm IN ALL CASES.

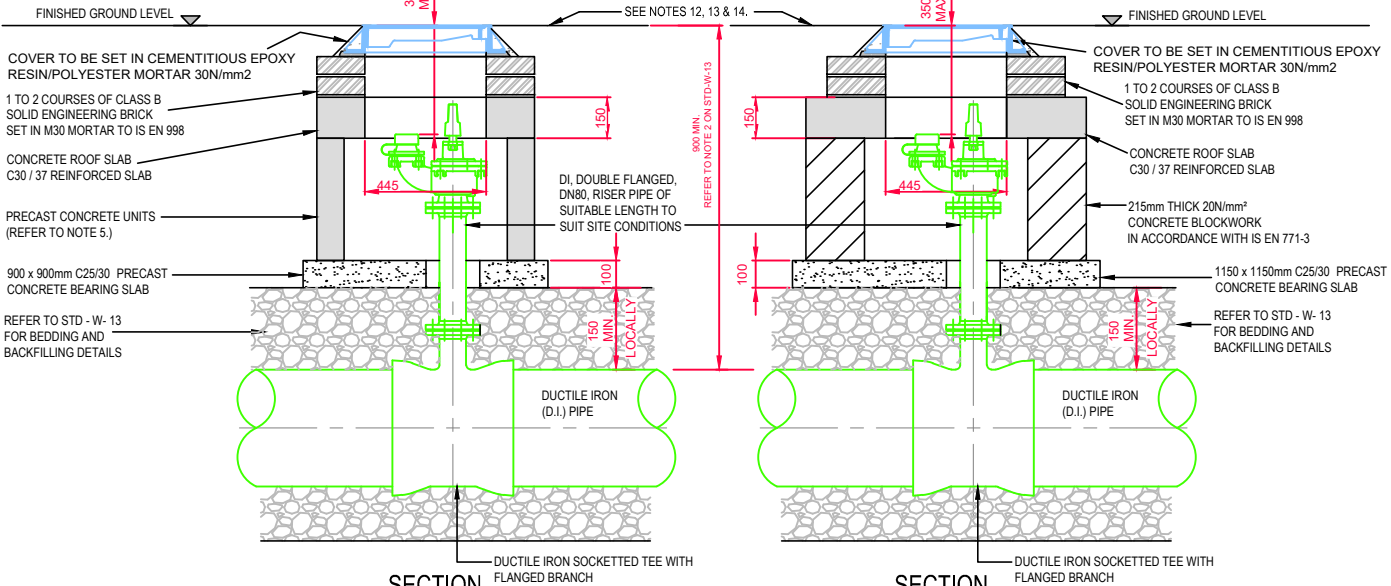


**SECTION**


**SECTION**

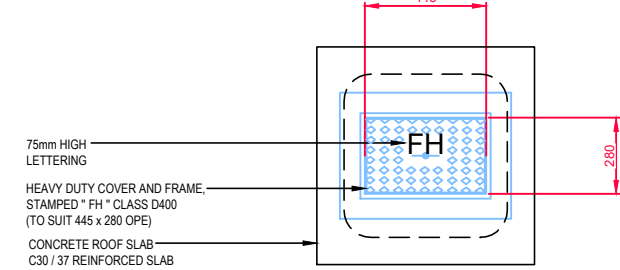


**ROOF PLAN**

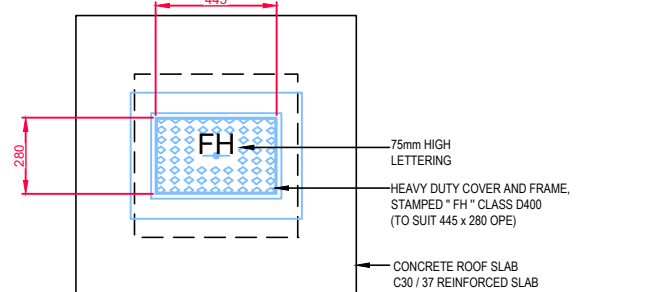

**ROOF PLAN**

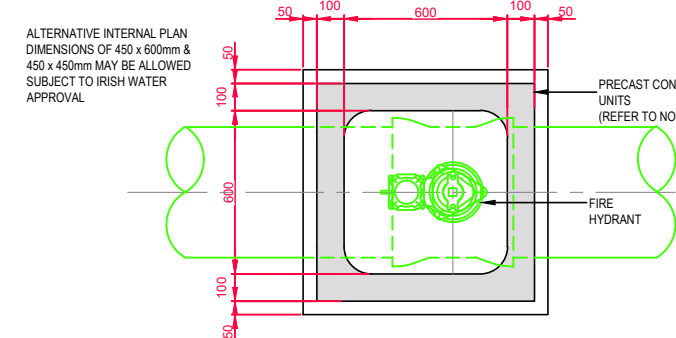


**FLOOR PLAN  
FIRE HYDRANT CHAMBER  
(PRECAST CONCRETE CONSTRUCTION)**

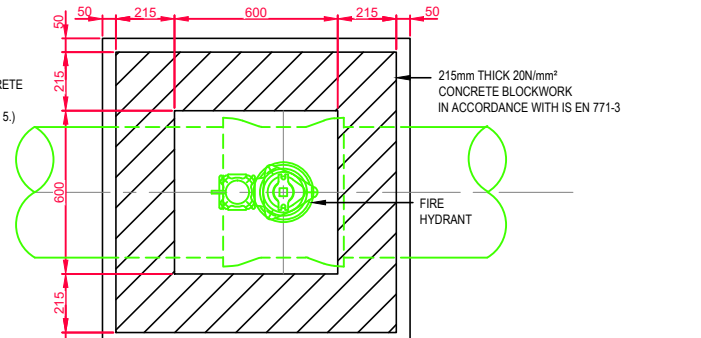

**FLOOR PLAN  
FIRE HYDRANT CHAMBER  
(BLOCKWORK CONSTRUCTION)**


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

					<b>STANDARD DETAILS - WATER</b>		SCALE NOT TO SCALE	DATE SEPT. 2015	
	3	07/20	RH	TOC	Added notes re. hydrant outlet & plan dimensions	MOD	TITLE	DRAWING No.	
	2	11/17	JMC	TOC	Revised & added notes	MOD	<b>ON - LINE HYDRANT FOR DUCTILE IRON (D.I.) PIPE (Sheet 1 of 4)</b>	<b>STD-W- 16</b>	
	1	08/16	JMC	TOC	Revised notes 2,3 & 6	MOD			<b>3</b>
	0	09/15	JMC	TOC	Initial Issue	SL			
No.	Date	Drn	Chk	Description	App				

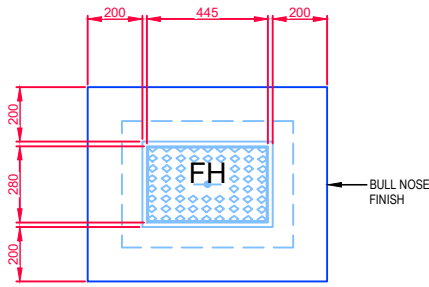


**PLINTH DETAIL  
IN GRASS AREA**

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. HYDRANT CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 OR BS 5834 COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
3. ALL HYDRANTS, SURFACE BOX FRAMES & COVERS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF IS EN 14339, IS EN 1074-6 & BS 750. FIRE HYDRANTS SHALL BE TYPE 2. THE HYDRANT INLET SHALL BE 80mm DIAMETER WITH PN16.
4. ALL HYDRANTS SHALL BE CLOCKWISE CLOSING.
5. HYDRANT CHAMBER TO BE CONSTRUCTED OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVELY PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1917 & IS 420. PCC CHAMBER RISER UNITS SHOULD BE INTERLOCKING WHEN STACKED TO PREVENT LATERAL MOVEMENT OF INDIVIDUAL UNITS
6. CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
7. DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545.
8. 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
9. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
10. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
11. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
12. TEE BRANCH, IF DEPTH OF TAKE-OFF PIPEWORK < 900mm, TAKE-OFF TEE MAY BE ROTATED TO ENSURE MIN. DEPTH OF COVER IS MAINTAINED, OR ALTERNATIVELY, PROVIDE PROTECTION TO TAKE-OFF PIPE.
13. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
14. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
15. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
16. THE FIRE HYDRANT OUTLET TYPE SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE FIRE OFFICER FOR THE AREA AND SHALL BE AGREED PRIOR TO THE COMMENCEMENT OF WORKS.
17. THE HYDRANT SHALL BE DOUBLE FLANGED DRILLED TO PN 16. THEY SHALL COMPLY WITH IS EN 14339, IS EN 1074 PART 6 AND BS 750: 2012. THE HYDRANT SHALL INCORPORATE A SCREW DOWN GATE VALVE, UNDERGROUND "GUIDE TO HEAD" TYPE WITH A FALSE SPINDLE CAP. THE OUTLET SHALL BE IN ACCORDANCE WITH ITEM 16 ABOVE.
18. 450 x 600mm INTERNAL DIMENSION CHAMBERS MAY BE PROVIDED SUBJECT TO REVIEW BY IW. SUCH CHAMBERS SHALL BE PROVIDED WITH GRADE "A" HEAVY DUTY COVER & FRAME & STAMPED "SV". BEARING SLABS TO BE 900 x 900mm IN ALL CASES.

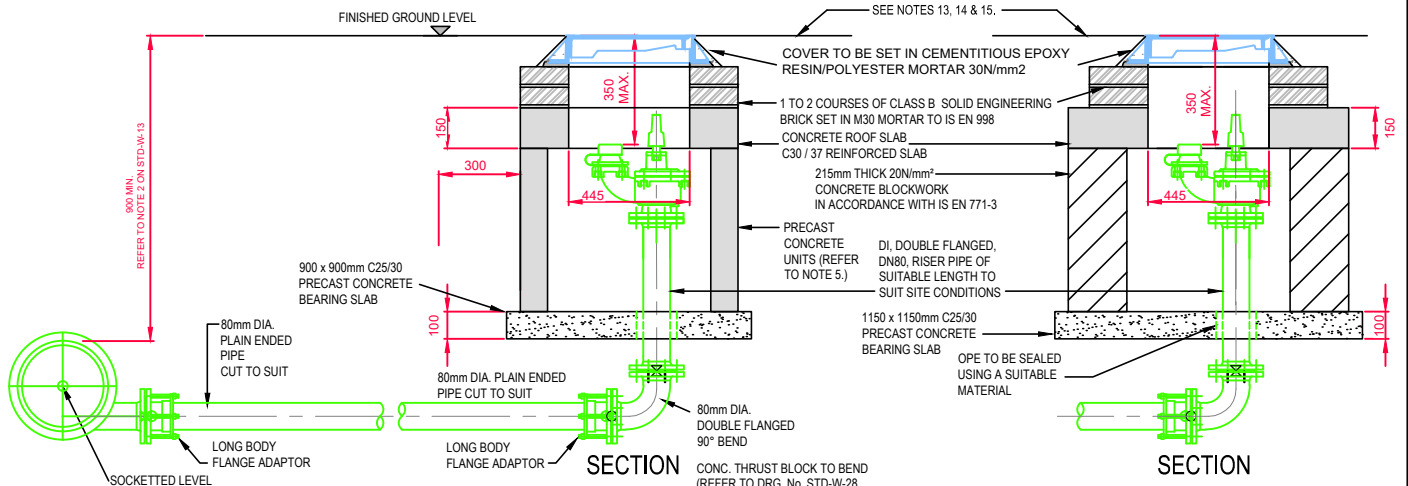


**SECTION**


**SECTION**

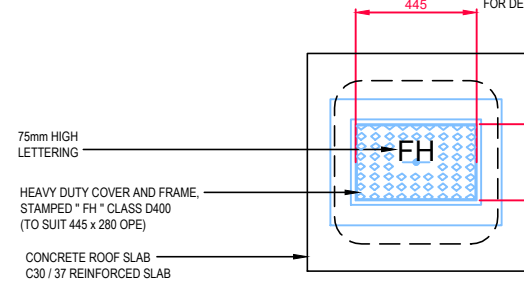

**ROOF PLAN**

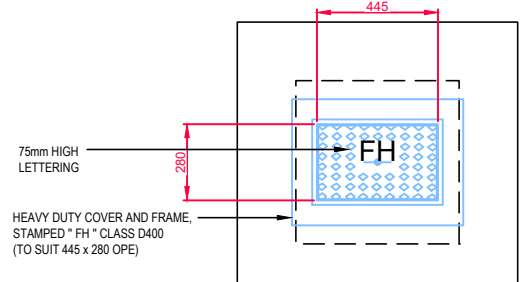

**ROOF PLAN**

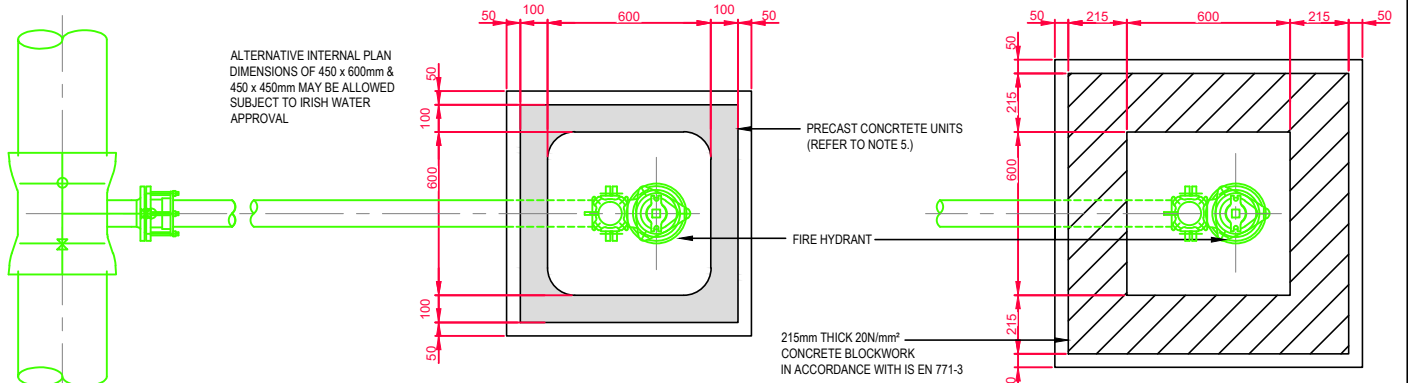

**FLOOR PLAN**


**FLOOR PLAN**

**FIRE HYDRANT CHAMBER  
(PRECAST CONCRETE CONSTRUCTION)**

**FIRE HYDRANT CHAMBER  
(BLOCKWORK CONSTRUCTION)**


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

	4	07/20	RH	TOC	Added notes re. hydrant outlet & plan dimensions	MOD	<b>STANDARD DETAILS - WATER</b>  <b>OFF - LINE HYDRANT FOR DUCTILE IRON (D.I.) PIPE (Sheet 2 of 4)</b>	SCALE	DATE	
	3	11/17	JMC	TOC	Revised & added notes, & revised pipework	MOD		TITLE	NOT TO SCALE	SEPT. 2015
	2	08/16	JMC	TOC	Revised notes 2,3 & 6	MOD		DRAWING No.	REV	
	1	04/16	JMC	TOC	Added thrust blocks	MOD				
	0	09/15	JMC	TOC	Initial Issue	SL				
No.	Date	Drn	Chk	Description	App					

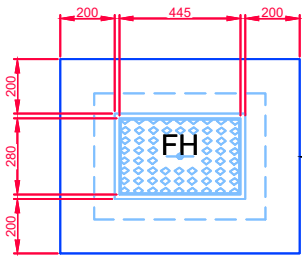


**PLINTH DETAIL  
IN GRASS AREA**

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. HYDRANT CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 OR BS 5834 COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
3. ALL HYDRANTS, SURFACE BOX FRAMES & COVERS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF IS EN 14339, IS EN 1074-6 & BS 750. FIRE HYDRANTS SHALL BE TYPE 2. THE HYDRANT INLET SHALL BE 80mm DIAMETER WITH PN16.
4. ALL HYDRANTS SHALL BE CLOCKWISE CLOSING.
5. HYDRANT CHAMBER TO BE CONSTRUCTED OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVELY PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1917 & IS 420. PCC CHAMBER RISER UNITS SHOULD BE INTERLOCKING WHEN STACKED TO PREVENT LATERAL MOVEMENT OF INDIVIDUAL UNITS.
6. CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLASS 808 MATERIAL AS PER STD-W-13.
7. DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
8. 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
9. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
10. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
11. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
12. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
13. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
14. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
15. THE FIRE HYDRANT OUTLET TYPE SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE FIRE OFFICER FOR THE AREA AND SHALL BE AGREED PRIOR TO THE COMMENCEMENT OF WORKS.
16. THE HYDRANT SHALL BE DOUBLE FLANGED DRILLED TO PN 16. THEY SHALL COMPLY WITH IS EN 14339, IS EN 1074 PART 6 AND BS 750:2012. THE HYDRANT SHALL INCORPORATE A SCREW DOWN GATE VALVE, UNDERGROUND "GUIDE TO HEAD" TYPE WITH A FALSE SPINDLE CAP. THE OUTLET SHALL BE IN ACCORDANCE WITH ITEM 15 ABOVE.
17. 450 x 600mm INTERNAL DIMENSION CHAMBERS MAY BE PROVIDED SUBJECT TO REVIEW BY IW. SUCH CHAMBERS SHALL BE PROVIDED WITH GRADE "A" HEAVY DUTY COVER & FRAME & STAMPED "S/V".

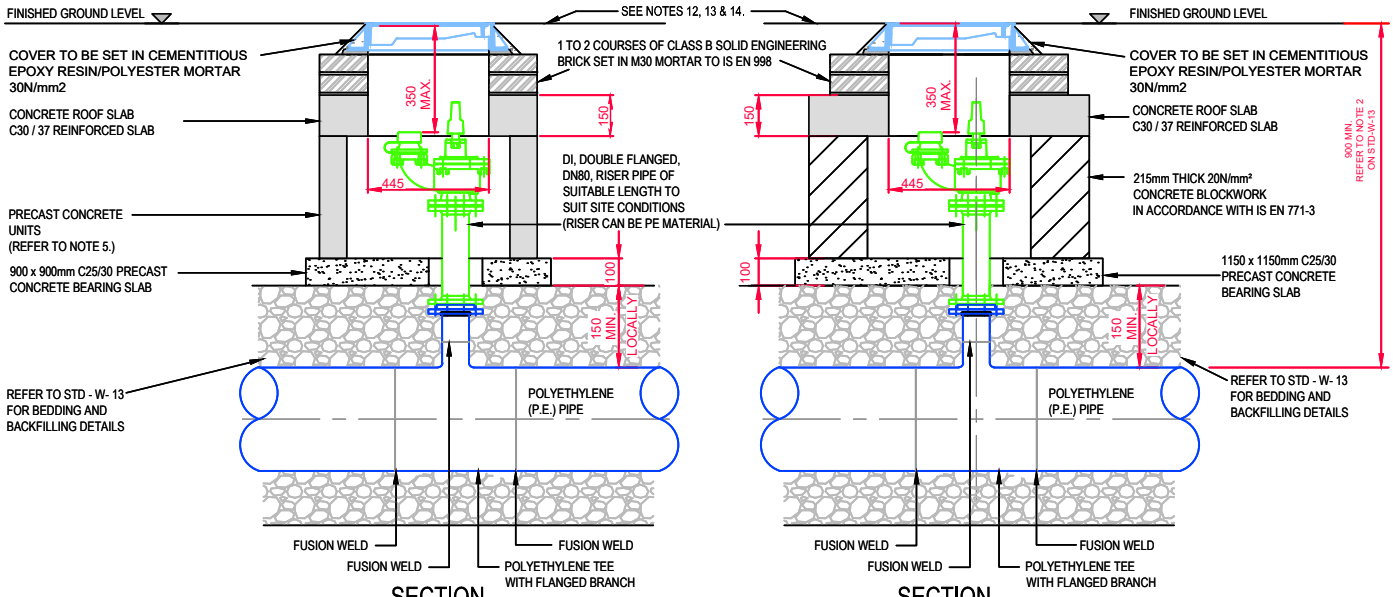


**SECTION**


**SECTION**

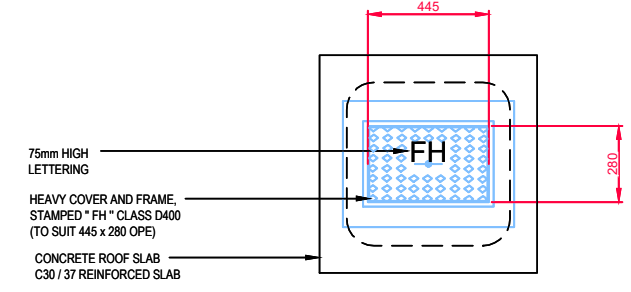


**ROOF PLAN**

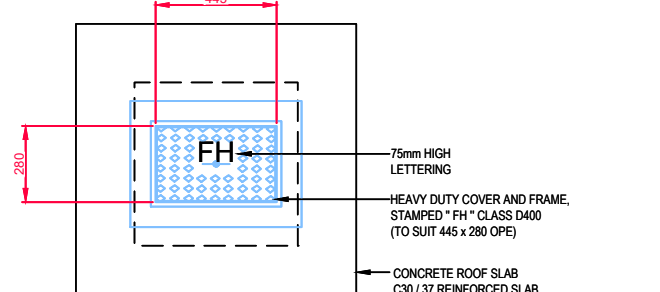

**ROOF PLAN**

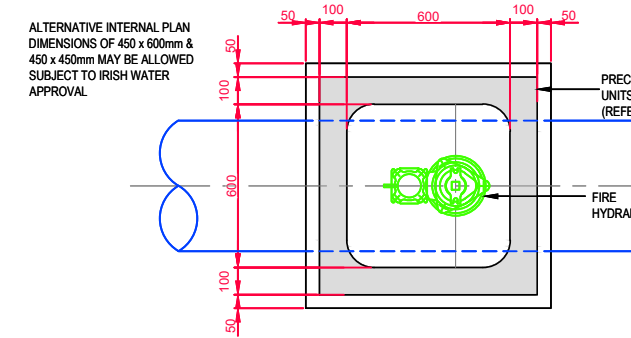

**FLOOR PLAN  
FIRE HYDRANT CHAMBER  
(PRECAST CONCRETE CONSTRUCTION)**

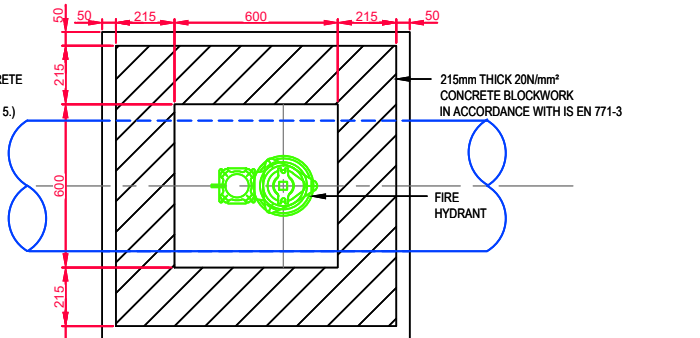

**FLOOR PLAN  
FIRE HYDRANT CHAMBER  
(BLOCKWORK CONSTRUCTION)**

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT


							<b>STANDARD DETAILS - WATER</b>		SCALE NOT TO SCALE	DATE SEPT. 2015
	3	07/20	RH	TOC	Added notes re. hydrant outlet & plan dimensions	MOD	TITLE	DRAWING No.	REV	
	2	11/17	JMC	TOC	Revised & added notes	MOD	<b>ON - LINE HYDRANT FOR POLYETHYLENE (P.E.) PIPE (Sheet 3 of 4)</b>	<b>STD-W- 18</b>	<b>3</b>	
	1	08/16	JMC	TOC	Revised notes 2,3 & 6	MOD				
	0	09/15	JMC	TOC	Initial Issue	SL				
No.	Date	Drn	Chk	Description	App					






DIAMETER OF MAIN	UP TO 250 (mm)	250 TO 350 (mm)
DIAMETER OF BRANCH	80mm	100mm
BORE OF VALVE INLET	80mm	100mm


- ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- AIR VALVE CHAMBERS SHALL BE COVERED WITH APPROVED VENTILATED HEAVY DUTY DUCTILE IRON COVERS TO IS EN 124 RATING D400. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
- AIR VALVES SHALL COMPLY WITH THE REQUIREMENTS OF IS EN 1074-4. AIR VALVES SHALL BE DOUBLE ORIFICE TYPE AND SHALL INCLUDE AN ISOLATING VALVE. THE ISOLATING VALVE SHALL BE EITHER A GATE VALVE CONFORMING TO IS EN 1074-2 & SHALL BE OF A BOLTLESS BONNET DESIGN, OR A BUTTERFLY VALVE TO IS EN 1074-2.
- SERVICE CONNECTIONS SHALL NOT BE PROVIDED WITHIN 2m OF THE AIR VALVE LOCATION.
- AIR VALVE CHAMBERS TO BE OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVE PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER.
- PRECAST CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
- DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545.
- 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
- THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
- ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
- THE LOCATION OF THE AIR VALVE SHALL BE THE SUBJECT OF PARTICULAR AGREEMENT WITH IRISH WATER TO ENSURE THAT THE RISK OF CONTAMINATION THROUGH THE VALVE IS ELIMINATED.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
- ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
- NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
- EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.

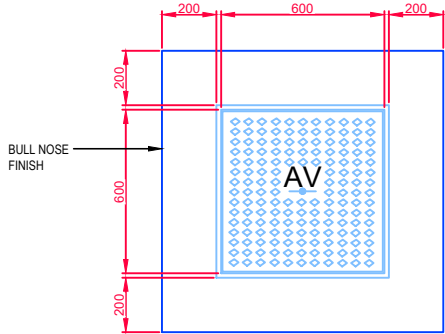


PLINTH DETAIL IN GRASS AREA

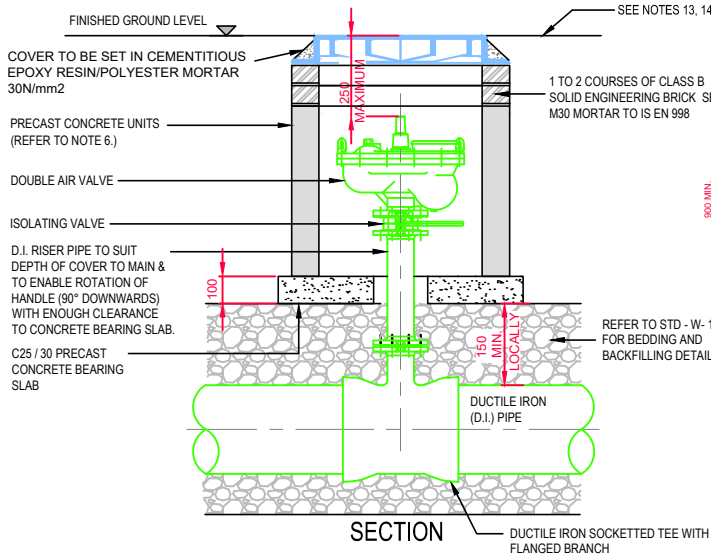


SECTION

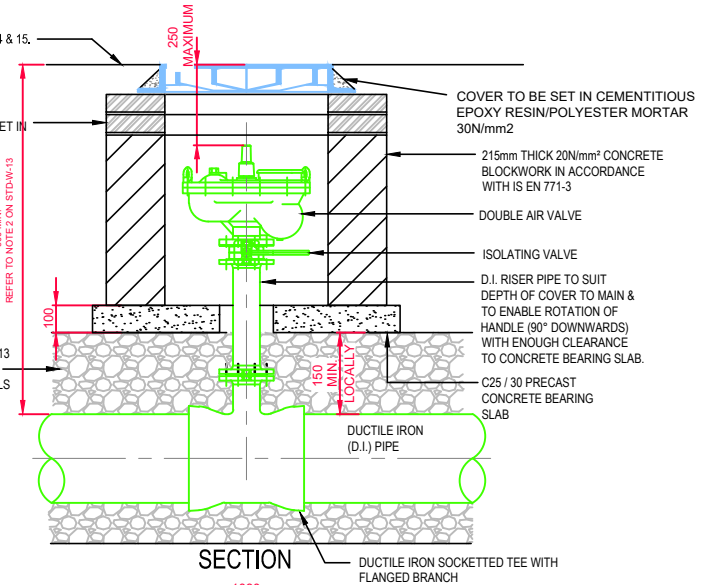


SECTION

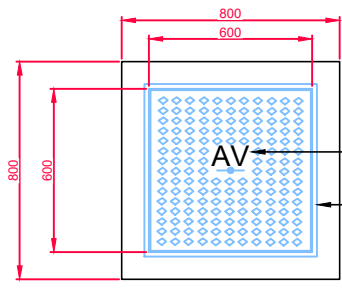


ROOF PLAN

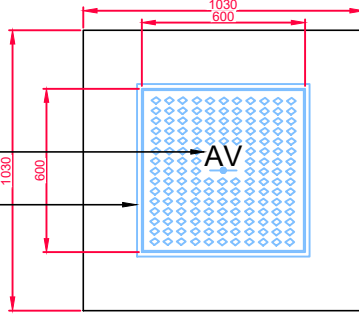

ROOF PLAN

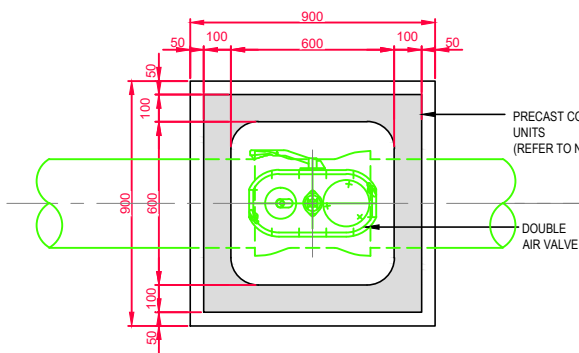

FLOOR PLAN  
DOUBLE AIR VALVE  
(PRECAST CONCRETE CONSTRUCTION)

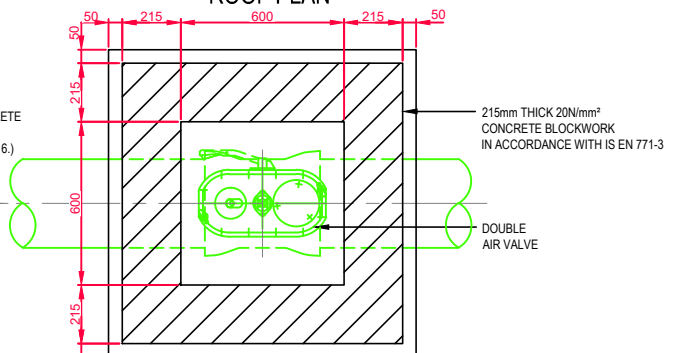

FLOOR PLAN  
DOUBLE AIR VALVE  
(BLOCKWORK CONSTRUCTION)

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT









No.	Date	Drn	Chk	Description	App
3	07/20	RH	TOC	Updated & revised notes	MOD
2	11/17	JMC	TOC	Updated & revised notes	MOD
1	08/16	JMC	TOC	Revised notes 2,3,4 & 7	MOD
0	09/15	JMC	TOC	Initial Issue	SL

STANDARD DETAILS - WATER		SCALE	DATE
TITLE		NOT TO SCALE	SEPT. 2015
ON - LINE AIR VALVE FOR DUCTILE IRON (D.I.) PIPE (Sheet 1 of 4)		DRAWING No.	REV
		STD-W- 20	3

DIAMETER OF MAIN	UP TO 250 (mm)	250 TO 350 (mm)
DIAMETER OF BRANCH	80mm	100mm
BORE OF VALVE INLET	80mm	100mm

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. AIR VALVE CHAMBERS SHALL BE COVERED WITH APPROVED VENTILATED HEAVY DUTY DUCTILE IRON COVERS TO IS EN 124 RATING D400. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
3. AIR VALVES SHALL COMPLY WITH THE REQUIREMENTS OF IS EN 1074-4. AIR VALVES SHALL BE DOUBLE ORIFICE TYPE AND SHALL INCLUDE AN ISOLATING VALVE. THE ISOLATING VALVE SHALL BE EITHER A GATE VALVE CONFORMING TO IS EN 1074-2 & SHALL BE OF A BOLTLESS BONNET DESIGN, OR A BUTTERFLY VALVE TO IS EN 1074-2.
4. SERVICE CONNECTIONS SHALL NOT BE PROVIDED WITHIN 2m OF THE AIR VALVE LOCATION.
5. AIR VALVE CHAMBERS TO BE OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVE PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER.
6. PRECAST CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
7. DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545.
8. 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
9. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
10. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
11. THE LOCATION OF THE AIR VALVE SHALL BE THE SUBJECT OF PARTICULAR AGREEMENT WITH IRISH WATER TO ENSURE THAT THE RISK OF CONTAMINATION THROUGH THE VALVE IS ELIMINATED.
12. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
13. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
14. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
15. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.

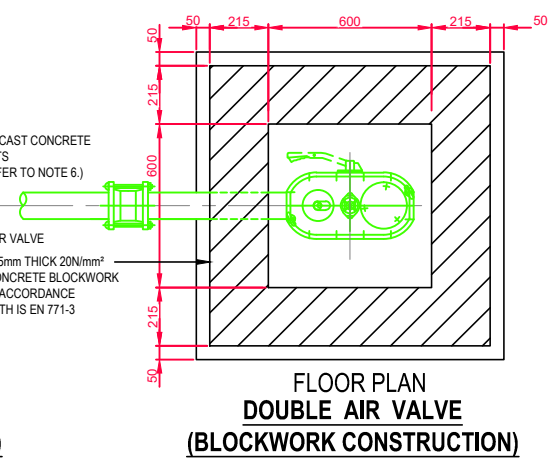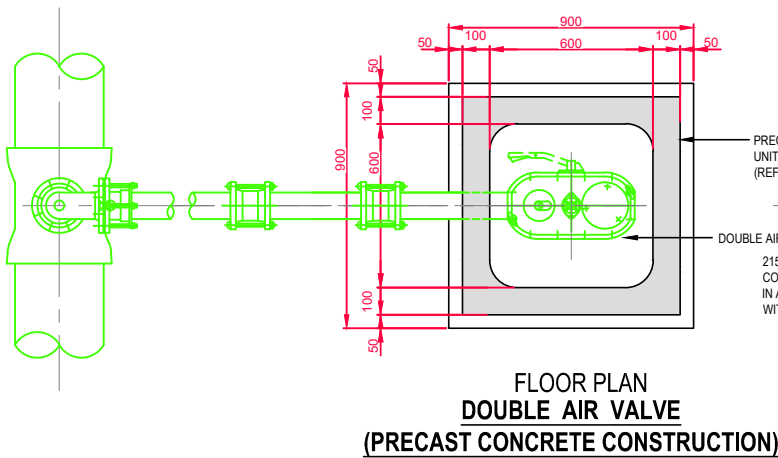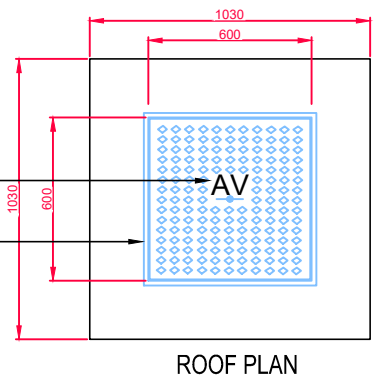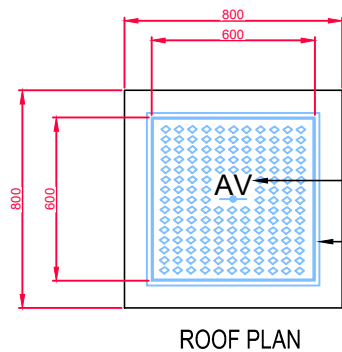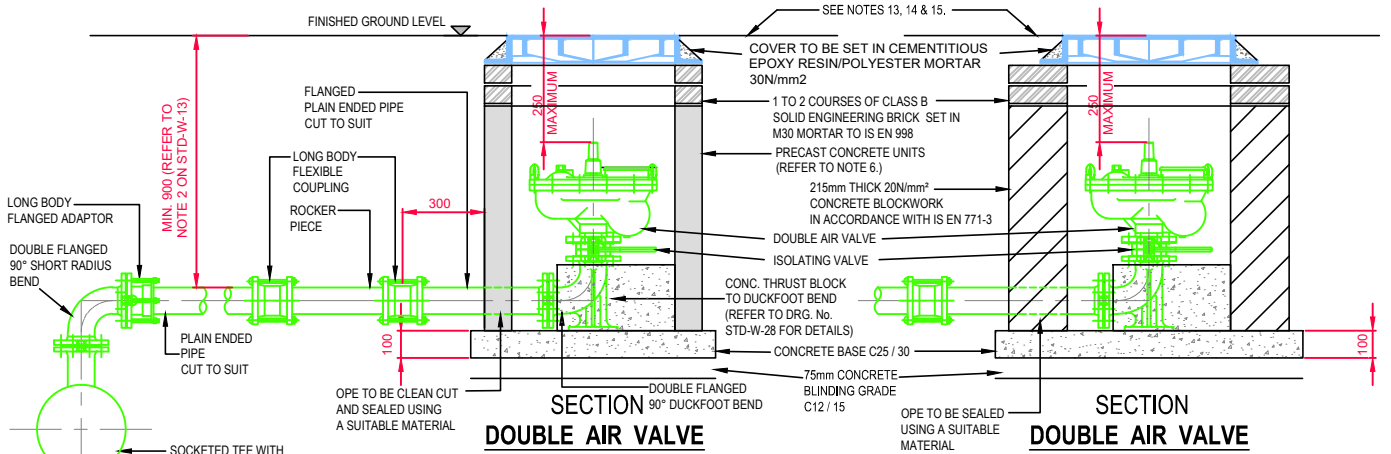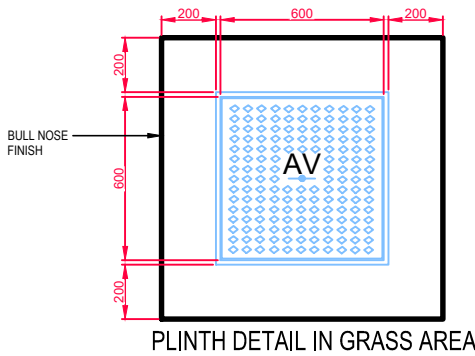

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



No.	Date	Drn	Chk	Description	App
4	07/20	RH	TOC	Updated brickwork bedding mortar spec.	MOD
3	11/17	JMC	TOC	Added & updated Notes	MOD
2	08/16	JMC	TOC	Revised notes 2,3,4 & 7	MOD
1	04/16	JMC	TOC	Added thrust blocks	MOD
0	09/15	JMC	TOC	Initial Issue	SL


STANDARD DETAILS - WATER	
TITLE	SCALE
OFF - LINE AIR VALVE FOR DUCTILE IRON (D.I.) PIPE (Sheet 2 of 4)	NOT TO SCALE

DATE	REV
SEPT. 2015	4


DRAWING No. **STD-W- 21**

DIAMETER OF MAIN	UP TO 250 (mm)	250 TO 350 (mm)
DIAMETER OF BRANCH	80mm	100mm
BORE OF VALVE INLET	80mm	100mm


- ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- AIR VALVE CHAMBERS SHALL BE COVERED WITH APPROVED VENTILATED HEAVY DUTY DUCTILE IRON COVERS TO IS EN 124 RATING D400. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
- AIR VALVES SHALL COMPLY WITH THE REQUIREMENTS OF IS EN 1074-4. AIR VALVES SHALL BE DOUBLE ORIFICE TYPE AND SHALL INCLUDE AN ISOLATING VALVE. THE ISOLATING VALVE SHALL BE EITHER A GATE VALVE CONFORMING TO IS EN 1074-2 & SHALL BE OF A BOLTSLESS BONNET DESIGN, OR A BUTTERFLY VALVE TO IS EN 1074-2.
- SERVICE CONNECTIONS SHALL NOT BE PROVIDED WITHIN 2m OF THE AIR VALVE LOCATION.
- AIR VALVE CHAMBERS TO BE OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVE PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER.
- PRECAST CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
- DUCTILE IRON PIPES / FITTINGS AND PE PIPES / FITTINGS TO BE IN ACCORDANCE WITH IS EN 545 AND IS EN 12201:2011.
- 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
- THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
- ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
- THE LOCATION OF THE AIR VALVE SHALL BE THE SUBJECT OF PARTICULAR AGREEMENT WITH IRISH WATER TO ENSURE THAT THE RISK OF CONTAMINATION THROUGH THE VALVE IS ELIMINATED.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
- ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
- NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
- EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.

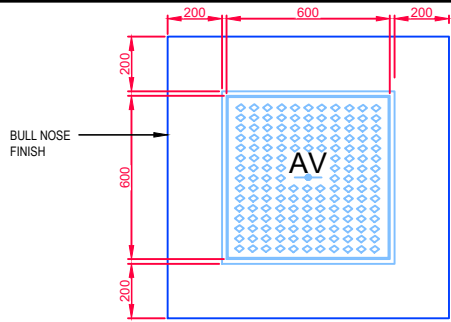


PLINTH DETAIL IN GRASS AREA

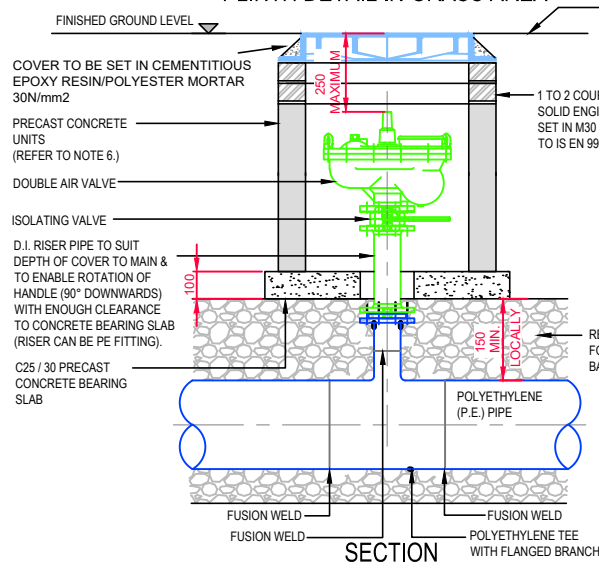


SECTION

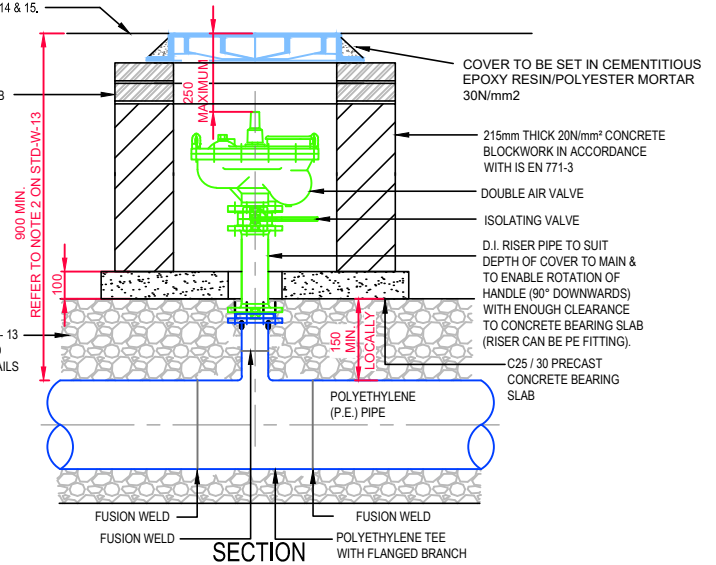


SECTION

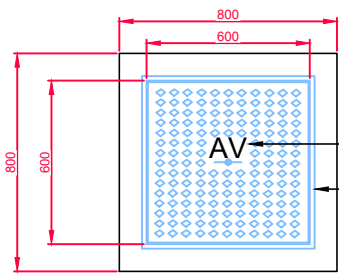


ROOF PLAN

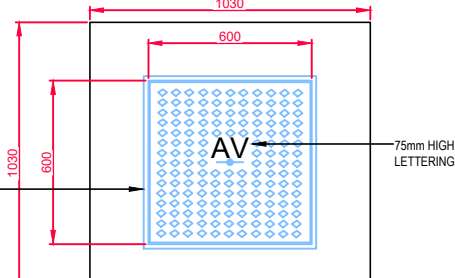

ROOF PLAN

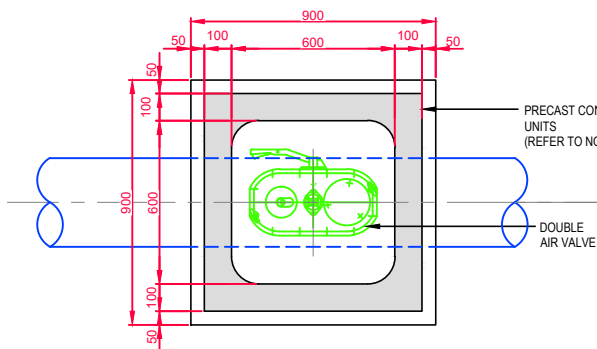

FLOOR PLAN  
DOUBLE AIR VALVE  
(PRECAST CONCRETE CONSTRUCTION)

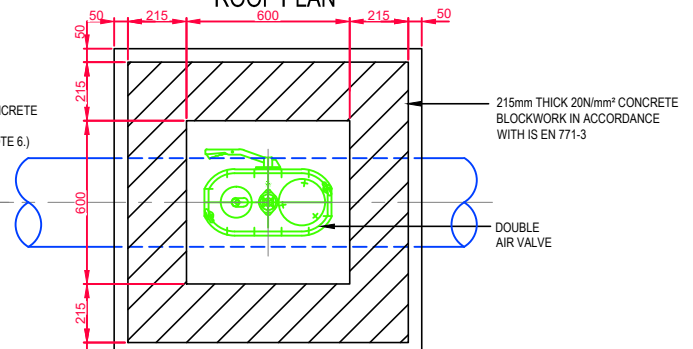



FLOOR PLAN  
DOUBLE AIR VALVE  
(BLOCKWORK CONSTRUCTION)

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

UISCE ÉIREANN : IRISH WATER						STANDARD DETAILS - WATER		SCALE	DATE
3	07/20	RH	TOC	Updated brickwork bedding mortar spec.	MOD	TITLE		NOT TO SCALE	SEPT. 2015
2	11/17	JMC	TOC	Added & updated notes	MOD	ON - LINE AIR VALVE FOR POLYETHYLENE (P.E.) PIPE (Sheet 3 of 4)		DRAWING No.	REV
1	08/16	JMC	TOC	Revised notes 2,3,4 & 7	MOD				
0	09/15	JMC	TOC	Initial Issue	SL				
No.	Date	Drn	Chk	Description	App			STD-W- 22	3

DIAMETER OF MAIN	UP TO 250 (mm)	250 TO 350 (mm)
DIAMETER OF BRANCH	80mm	100mm
BORE OF VALVE INLET	80mm	100mm


1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. AIR VALVE CHAMBERS SHALL BE COVERED WITH APPROVED VENTILATED HEAVY DUTY DUCTILE IRON COVERS TO IS EN 124 RATING D400. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
3. AIR VALVES SHALL COMPLY WITH THE REQUIREMENTS OF IS EN 1074-4. AIR VALVES SHALL BE DOUBLE ORIFICE TYPE AND SHALL INCLUDE AN ISOLATING VALVE. THE ISOLATING VALVE SHALL BE EITHER A GATE VALVE CONFORMING TO IS EN 1074-2 & SHALL BE OF A BOLTLESS BONNET DESIGN, OR A BUTTERFLY VALVE TO IS EN 1074-2.
4. SERVICE CONNECTIONS SHALL NOT BE PROVIDED WITHIN 2m OF THE AIR VALVE LOCATION.
5. AIR VALVE CHAMBERS TO BE OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVE PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW BY IRISH WATER.
6. PRECAST CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
7. DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
8. 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
9. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
10. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
11. THE LOCATION OF THE AIR VALVE SHALL BE THE SUBJECT OF PARTICULAR AGREEMENT WITH IRISH WATER TO ENSURE THAT THE RISK OF CONTAMINATION THROUGH THE VALVE IS ELIMINATED.
12. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
13. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
14. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
15. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.

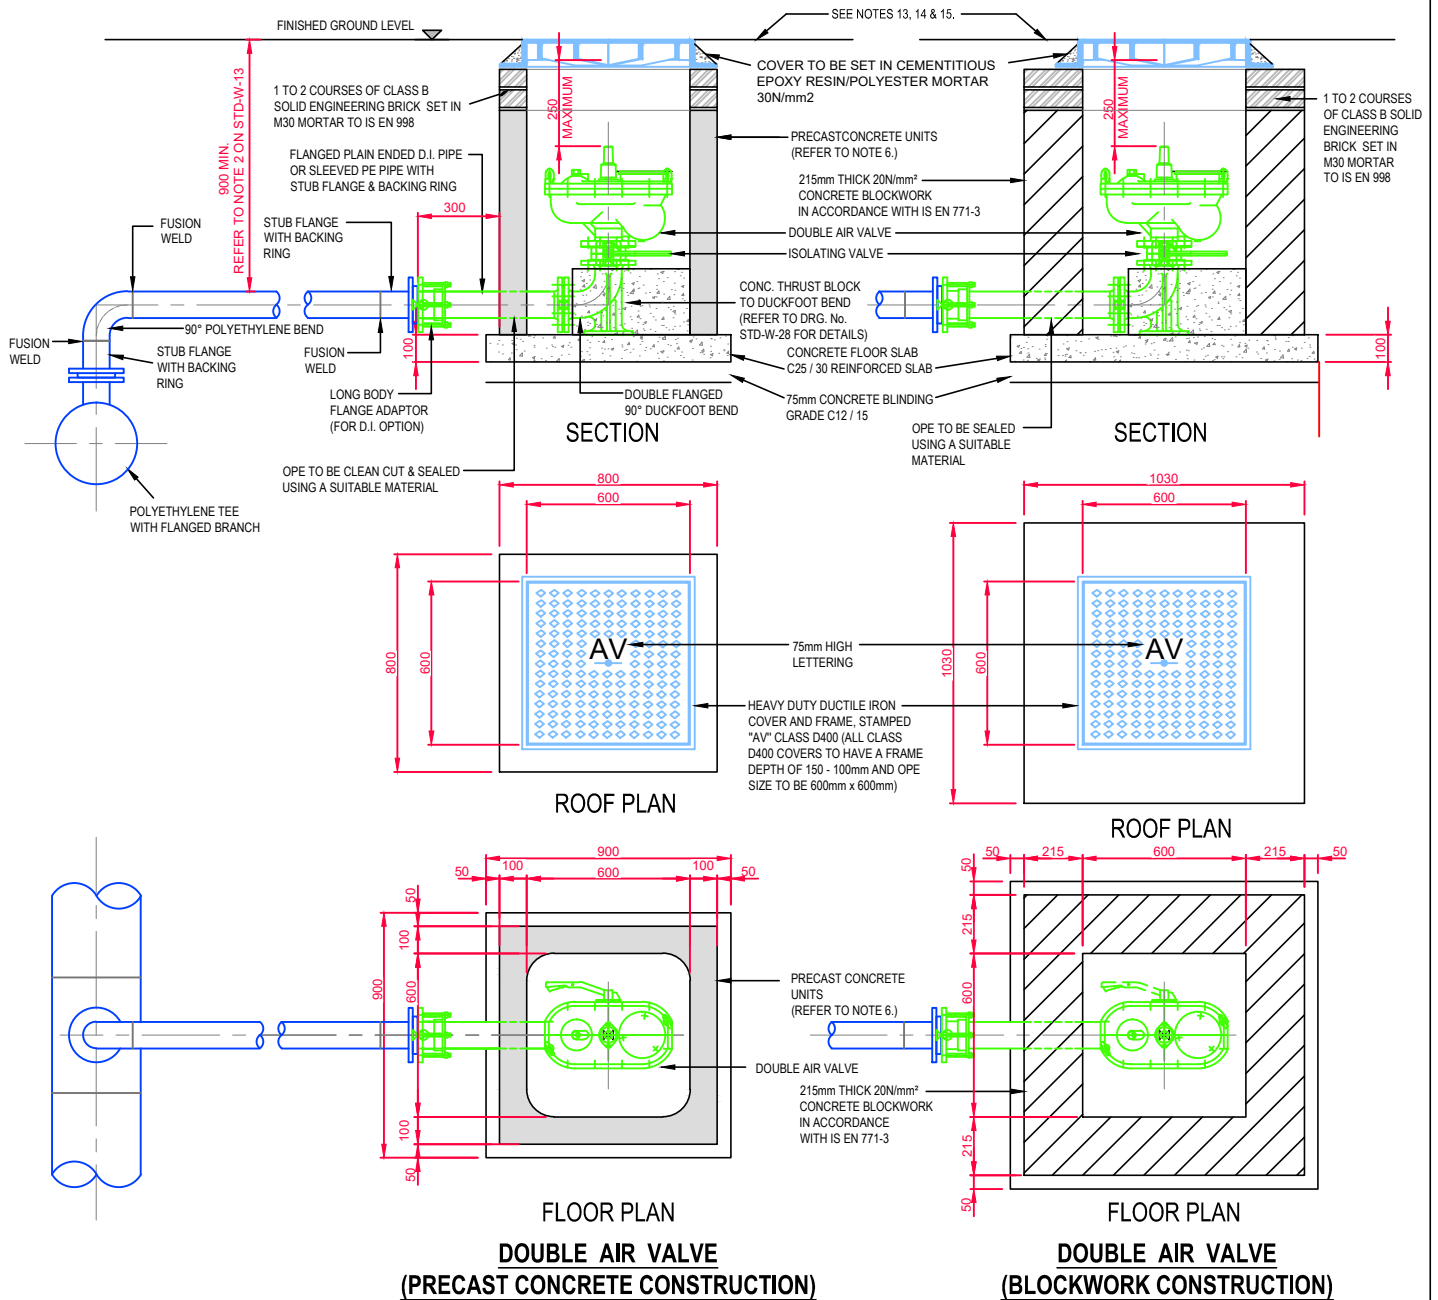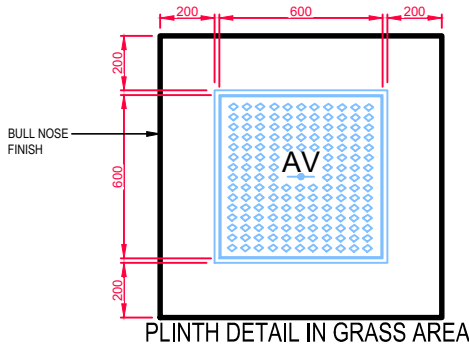


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

UISCE EIREANN : IRISH WATER						STANDARD DETAILS - WATER		SCALE	DATE
4	07/20	RH	TOC	Updated brickwork bedding mortar spec. Added & updated notes	MOD	TITLE		NOT TO SCALE	SEPT. 2015
3	11/17	JMC	TOC	Added & updated notes	MOD	OFF - LINE AIR VALVE FOR POLYETHYLENE (P.E.) PIPE (Sheet 4 of 4)		DRAWING No.	REV
2	08/16	JMC	TOC	Revised notes 2,3,4 & 7	MOD				
1	04/16	JMC	TOC	Added thrust blocks	MOD				
0	09/15	JMC	TOC	Initial Issue	SL	STD-W- 23		4	
No.	Date	Drn	Chk	Description	App				




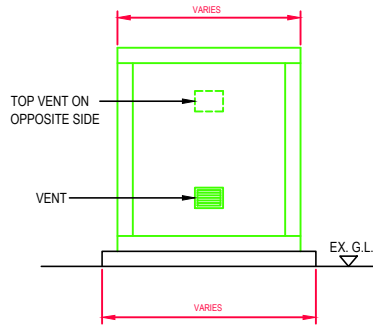


END ELEVATION

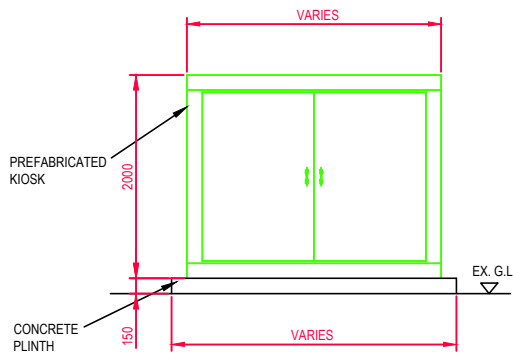

FRONT ELEVATION

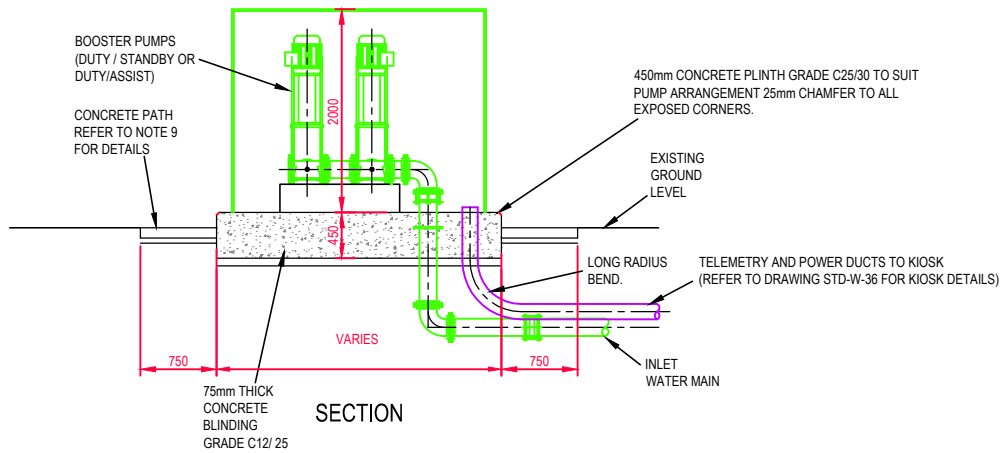

SECTION

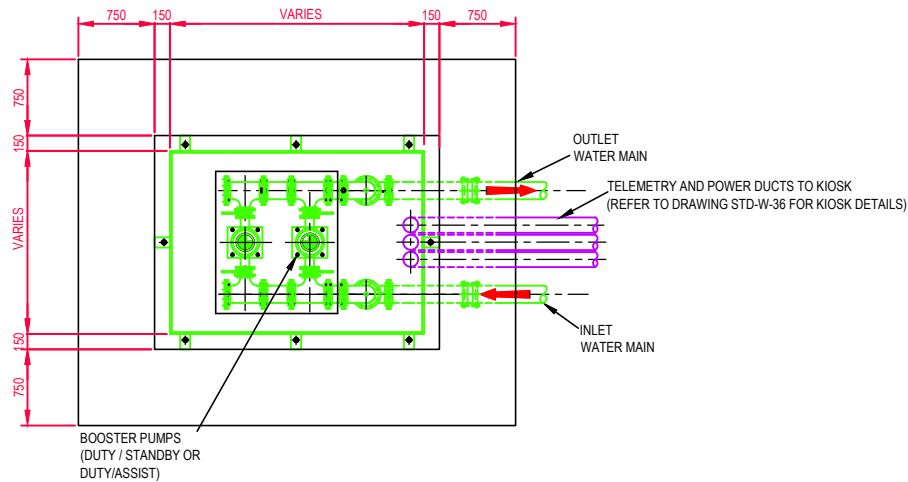

FLOOR PLAN

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. DETAILS OF THE PROPOSED BOOSTING ARRANGEMENT SHALL BE PROVIDED TO IRISH WATER AT CONNECTION APPLICATION STAGE AND AT THE DETAILED DESIGN STAGE OF THE DEVELOPMENT FOR ASSESSMENT.
3. KIOSK TO BE CONSTRUCTED FROM THERMOSETTING U.V. & WEATHER RESISTANT PLASTIC POWDER COATED & HOT DIPPED GALVANISED STEEL (MINIMUM 3mm THICKNESS) IN ACCORDANCE WITH BS EN 1461. STAINLESS STEEL MAY BE USED AS AN ALTERNATIVE KIOSK MATERIAL, PARTICULARLY IN SEVERE ENVIRONMENTS, SUBJECT TO AGREEMENT WITH IRISH WATER.
4. KIOSK TO HAVE SINGLE OR DOUBLE STEEL DOORS WITH MULTIPLE LOCKS TO LPS 1175 SR3 OR EN 1627. MINIMUM DOUBLE LOCKS WITH BOLTS THAT ENGAGE INTO THE SILL & HEADER AS WELL AS BETWEEN THE TWO LEAVES OR LEAF & FRAME. LEADING EDGE OF LEAVES TO HAVE EITHER REBATED EDGES OR FITTED WITH ASTRAGALS.
5. COLOUR TO BE HOLLY GREEN 14 C 39 IN ACCORDANCE WITH BS 4800:2011.
6. THE QUALITY OF KIOSK CONSTRUCTION SHALL ENSURE THAT THE FOLLOWING IS ACHIEVED:
  - (a) A THERMAL TRANSMITTANCE OF 1.5W PER m<sup>2</sup>K.
  - (b) A FIRE RESISTANCE (RETENTION OF STABILITY, INTEGRITY AND INSULATION) EQUIVALENT TO CLASS 2 OF BS 476, WHEN TESTED IN ACCORDANCE WITH BS 476 FOR A PERIOD EXCEEDING 30 MINUTES.
  - (c) AN IP RATING OF IP55 OR EQUIVALENT.
7. ALL DUCTING TO BE INSTALLED WITH DRAW CORDS.
8. WATER TIGHT SEALS TO BE PROVIDED AROUND ALL DUCTING ENTERING/EXITING THE BOOSTER PUMP STATION.
9. A 750mm WIDE x 100mm THICK FOOTPATH OF C25/30 CONCRETE ON 50mm SAND BLINDING ON 300mm CLAUSE 804 GRANULAR MATERIAL TO BE PROVIDED AROUND KIOSK.
10. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
11. BOOSTER PUMPS TO BE LOCATED IN AREA THAT IS NOT PRONE TO FLOODING.
12. PROVISION TO BE MADE IN THE SIZING OF THE KIOSK FOR THE SAFE REPAIR/MAINTENANCE OF THE BOOSTER PUMPS & FOR THEIR REMOVAL IF REQUIRED.

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT




No.	Date	Drn	Chk	Description	App
2	07/20	RH	TOC	Notes Updated	MOD
1	08/16	JMC	TOC	Added note 4	MOD
0	09/15	JMC	TOC	Initial Issue	SL

STANDARD DETAILS - WATER	
TITLE	SCALE
BOOSTER PUMP STATION ARRANGEMENT	NOT TO SCALE

DATE	REV
SEPT. 2015	
DRAWING No.	STD-W- 25
	2

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- STRUCTURAL DESIGN AND REINFORCEMENT DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 225mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1917 & IS 420
- CONCRETE FOR FLOW METER CHAMBER TO BE C30 / 37.
- PRECAST UNITS COMPLETED WITH RUBBER SEALING GASKET BETWEEN UNITS, COMPLYING WITH THE REQUIREMENTS OF IS EN 1917 AND IS 420, COMPLETE WITH 150mm CONCRETE SURROUND MAY BE USED AS AN ACCEPTABLE ALTERNATIVE. CONCRETE SURROUND TO BE GRADE C20/25 IN ACCORDANCE WITH IS EN 206.
- METER CHAMBER SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS EN 124 RATING D400. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
- 200mm ALL ROUND, 100mm DEEP CONCRETE PLINTH AROUND COVER IN GRASS AREAS.
- ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
- DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
- ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO REVIEW BY IRISH WATER.
- PIPEWORK TO BE DOWNSIZED TO ACCOMMODATE THE REQUIRED RANGE OF THE FLOW METER. STRAIGHT PIPE LENGTHS UPSTREAM AND DOWNSTREAM OF THE METER TO BE PROVIDED. THE METER SHALL BE CAPABLE OF ACCURATE NIGHT FLOW MEASUREMENTS.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
- ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
- NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
- EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
- DEVELOPER TO PROVIDE SPOOL PIECE, IRISH WATER TO PROVIDE METER. (SEE TABLE BELOW FOR SPOOL PIECE LENGTHS)

ELECTROMAGNETIC WATER METER SPOOL PIECE LENGTHS							
Ø mm	DN50	DN80	DN100	DN125	DN150	DN200	DN250
Length mm	200		250		300	350	450

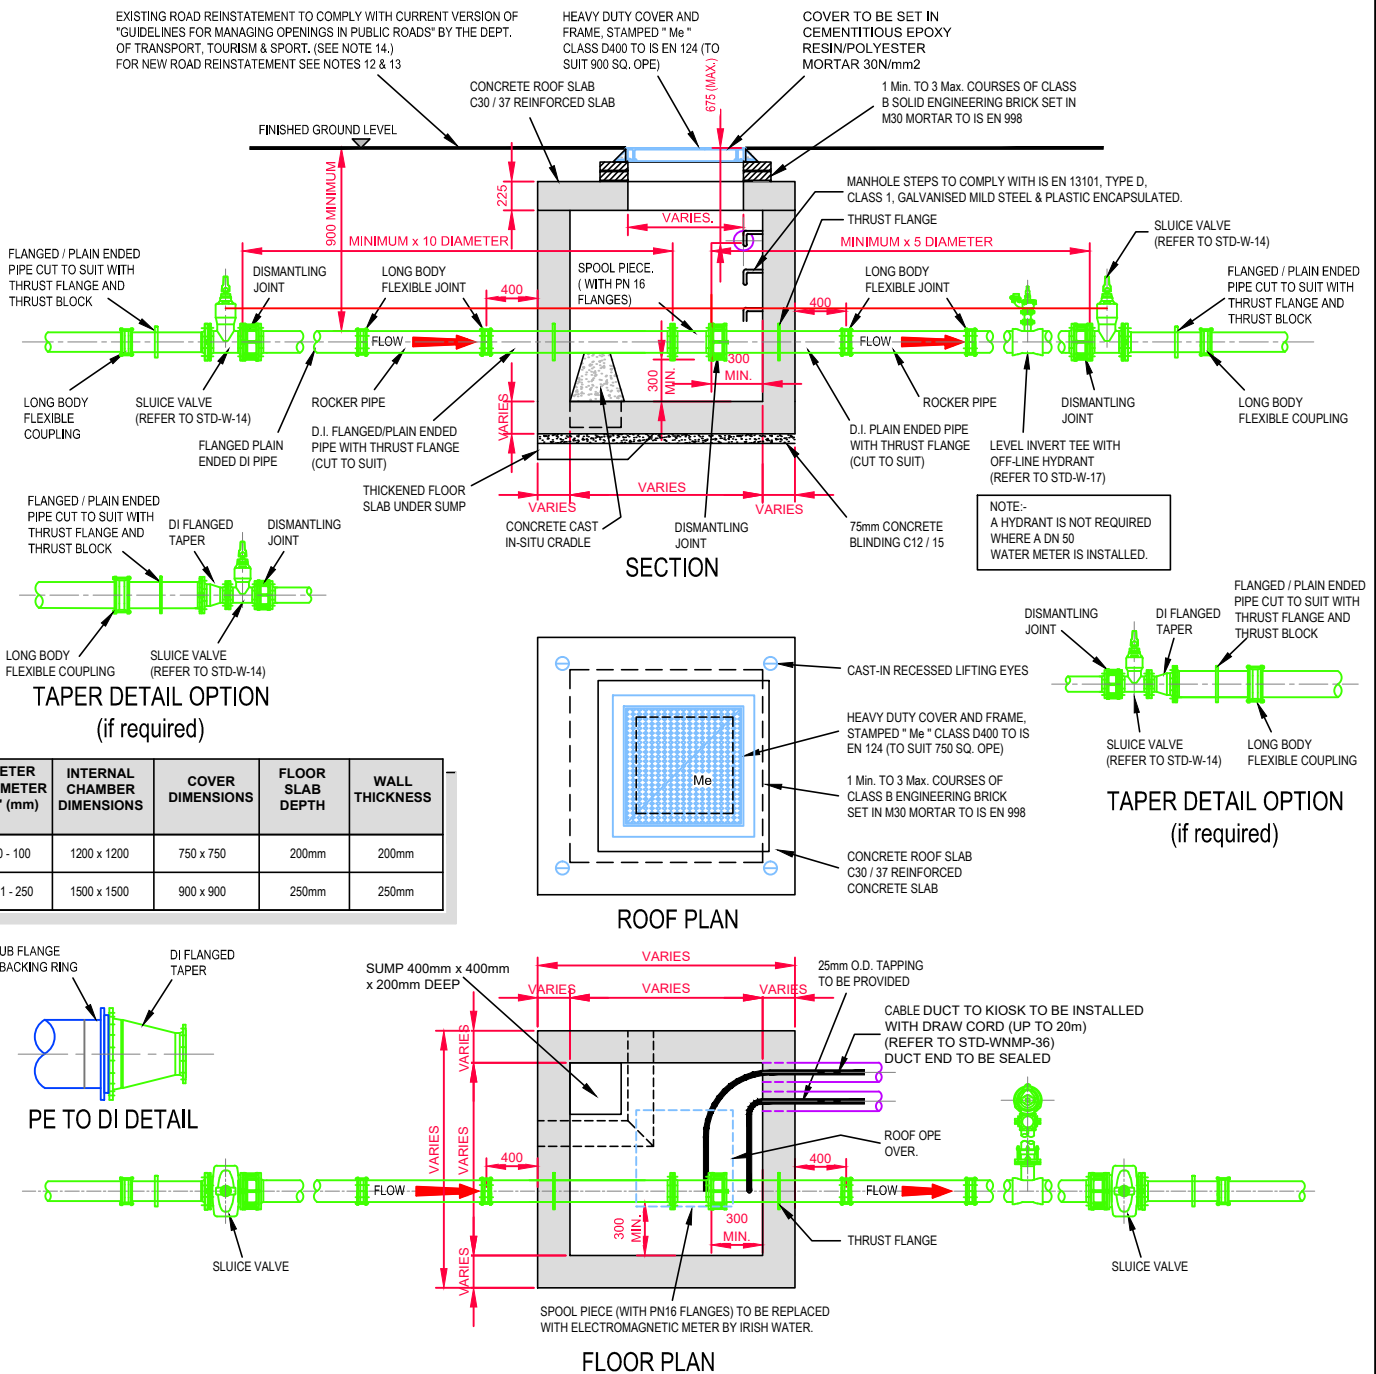

METER DIAMETER 'A' (mm)	INTERNAL CHAMBER DIMENSIONS	COVER DIMENSIONS	FLOOR SLAB DEPTH	WALL THICKNESS
50 - 100	1200 x 1200	750 x 750	200mm	200mm
101 - 250	1500 x 1500	900 x 900	250mm	250mm

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT


	4	07/20	RH	TOC	Notes Updated, spool lengths table included	MOD	<b>STANDARD DETAILS - WATER</b>  TITLE  <b>ELECTROMAGNETIC METER CHAMBER (80 - 250mm DIA.)</b>	SCALE	DATE
	3	11/17	JMC	TOC	Revised notes & added table & hydrant	MOD		NOT TO SCALE	SEPT. 2015
	2	08/16	JMC	TOC	Added steps & revised cover notes	MOD		DRAWING No.	REV
	1	04/16	JMC	TOC	Added couplings to details	MOD			
	0	09/15	JMC	TOC	Initial Issue	SL			
	No.	Date	Drn	Chk	Description	App		<b>STD-W- 26</b>	








- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- STRUCTURAL DESIGN AND REINFORCEMENT DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER APPROVAL, & COMPLIANCE WITH IS EN 1917, AND IS 420
- METER CHAMBER SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVER TO IS EN 124 RATING D400. COVERS AND FRAMES SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS SUBJECT TO REVIEW BY IRISH WATER.
- DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
- ANTI CORROSION TAPE TO BE PROVIDED AROUND ALL BURIED FLANGES.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
- REINSTATEMENT OF EXISTING ROADS AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
- NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
- EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
- 200mm ALL AROUND x 100mm DEEP, C20/25 CONCRETE PLINTH COMPLETE WITH BULL NOSE FINISH AND MILD STEEL REINFORCEMENT LINK AROUND COVERS IN GREEN AREAS.

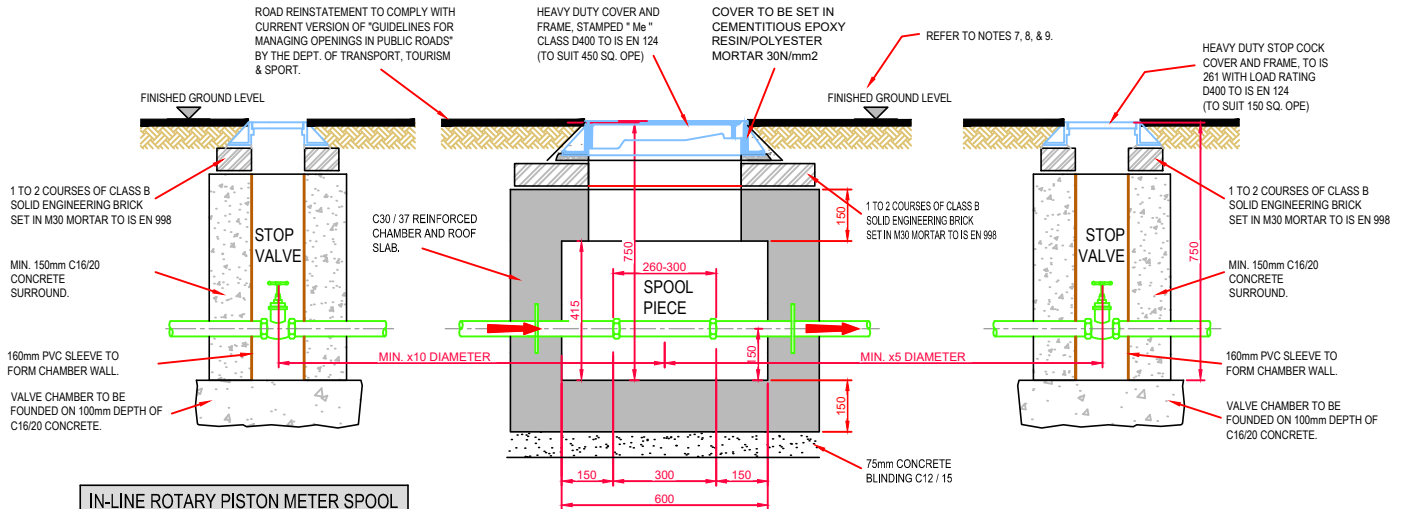


IN-LINE ROTARY PISTON METER SPOOL PIECE LENGTHS			
Ø mm	DN30	DN32	DN40
Length mm	260	260	300

### SECTION

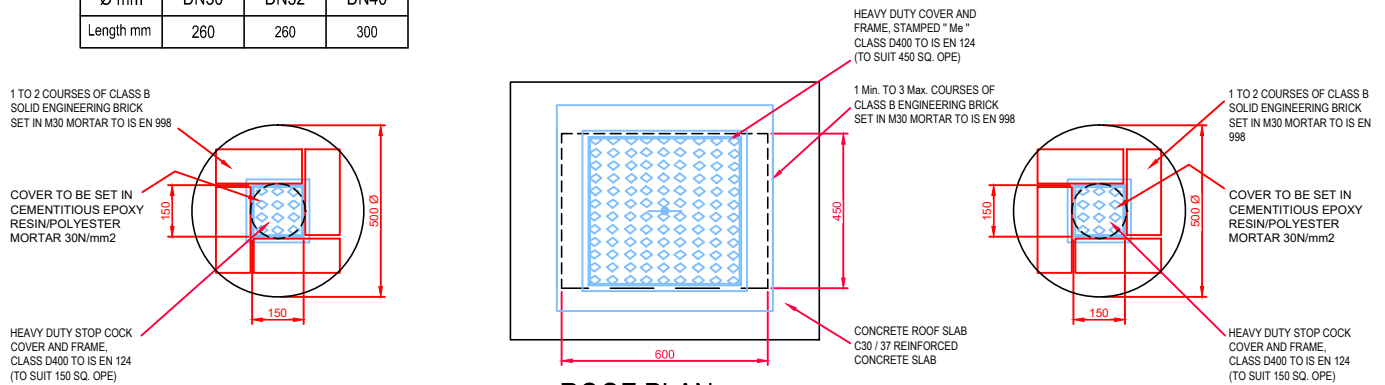

### ROOF PLAN

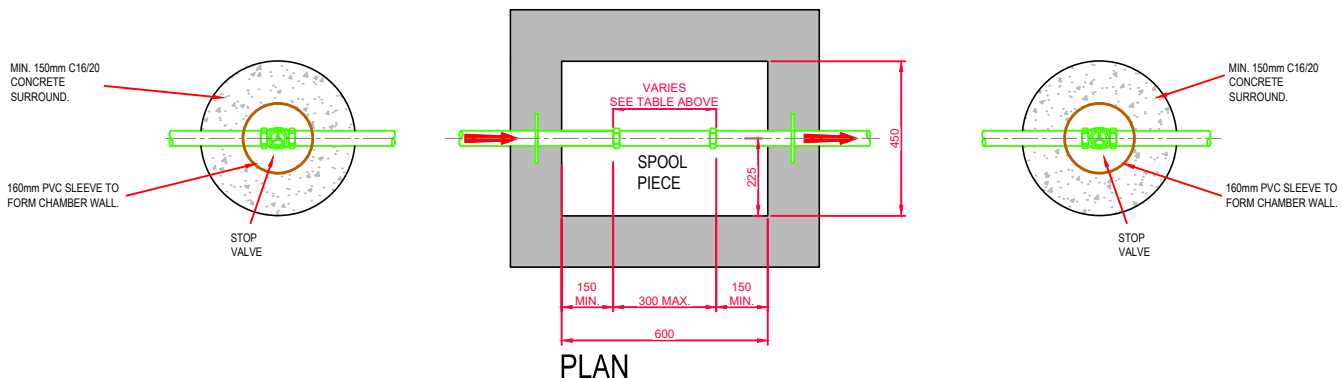

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT




No.	Date	Drn	Chk	Description	App
0	07/20	RH	TOC	Initial Issue	MOD

STANDARD DETAILS - WATER	
TITLE	THREADED ROTARY PISTON FLOW METER CHAMBER (DN30 - DN40mm DIA.) IN-SITU CONCRETE OPTION


SCALE	NOT TO SCALE	DATE	SEPT. 2019
DRAWING No.	STD-W-26C	REV	0

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. STRUCTURAL DESIGN AND REINFORCEMENT DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER APPROVAL, & COMPLIANCE WITH IS EN 1917, AND IS 420
3. METER CHAMBER SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVER TO IS EN 124 RATING D400. COVERS AND FRAMES SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS SUBJECT TO REVIEW BY IRISH WATER.
4. DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
5. ANTI CORROSION TAPE TO BE PROVIDED AROUND ALL BURIED FLANGES.
6. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
7. REINSTATEMENT OF EXISTING ROADS AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
8. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
9. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
10. 200mm ALL AROUND x 100mm DEEP, C20/25 CONCRETE PLINTH COMPLETE WITH BULL NOSE FINISH AND MILD STEEL REINFORCEMENT LINK AROUND COVERS IN GREEN AREAS.

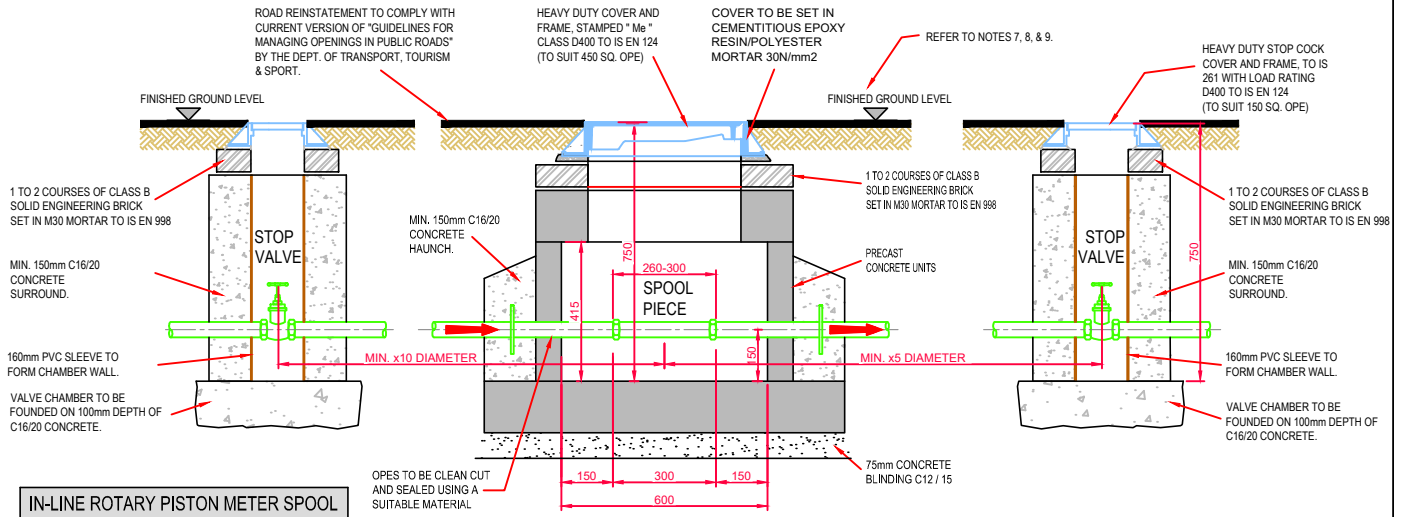


Ø mm	DN30	DN32	DN40
Length mm	260	260	300

**SECTION**

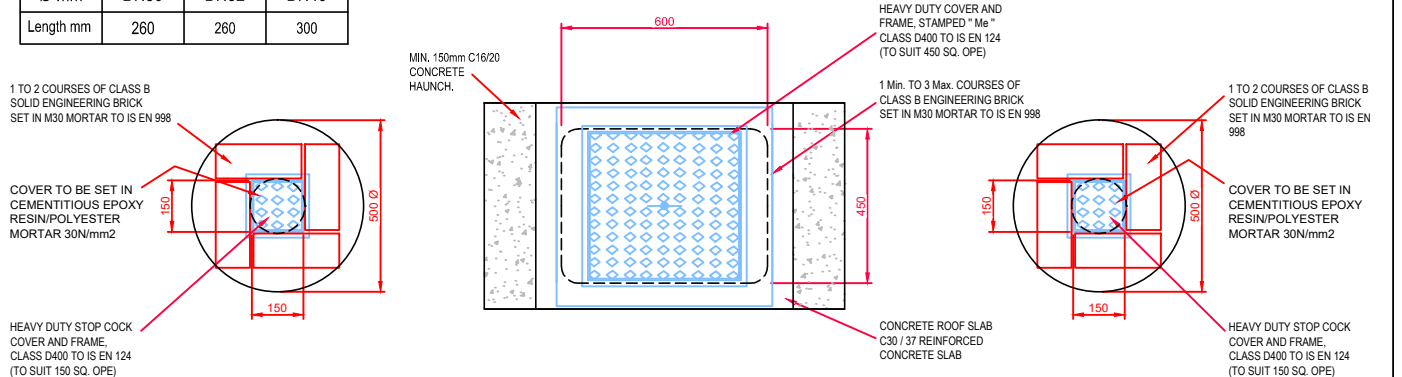

**ROOF PLAN**

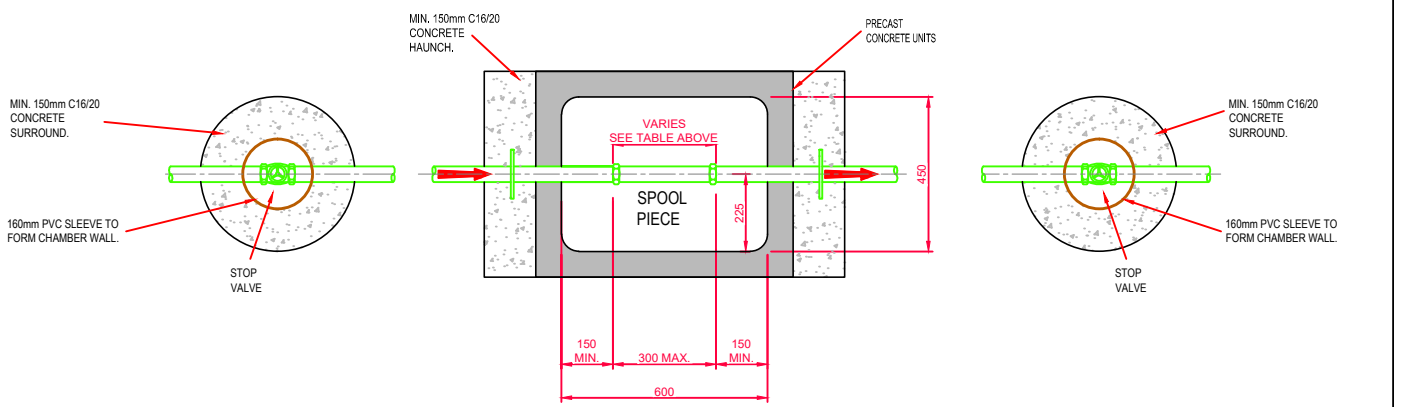


**PLAN**

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT


					<b>STANDARD DETAILS - WATER</b>		SCALE NOT TO SCALE	DATE SEPT. 2019
	TITLE <b>THREADED ROTARY PISTON FLOW METER CHAMBER (DN30 - DN40mm DIA.) PRECAST CONCRETE OPTION</b>						DRAWING No. <b>STD-W-26D</b>	REV <b>0</b>
	No.	Date	Drn	Chk	Description	App		
0	07/20	RH	TOC	Initial Issue				

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- STRUCTURAL DESIGN AND REINFORCEMENT DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER APPROVAL, & COMPLIANCE WITH IS EN 1917, AND IS 420
- METER CHAMBER SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVER TO IS EN 124 RATING D400. COVERS AND FRAMES SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS SUBJECT TO REVIEW BY IRISH WATER.
- DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
- ANTI CORROSION TAPE TO BE PROVIDED AROUND ALL BURIED FLANGES.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
- REINSTATEMENT OF EXISTING ROADS AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
- NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
- EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
- 200mm ALL AROUND x 100mm DEEP, C20/25 CONCRETE PLINTH COMPLETE WITH BULL NOSE FINISH AND MILD STEEL REINFORCEMENT LINK AROUND COVERS IN GREEN AREAS.

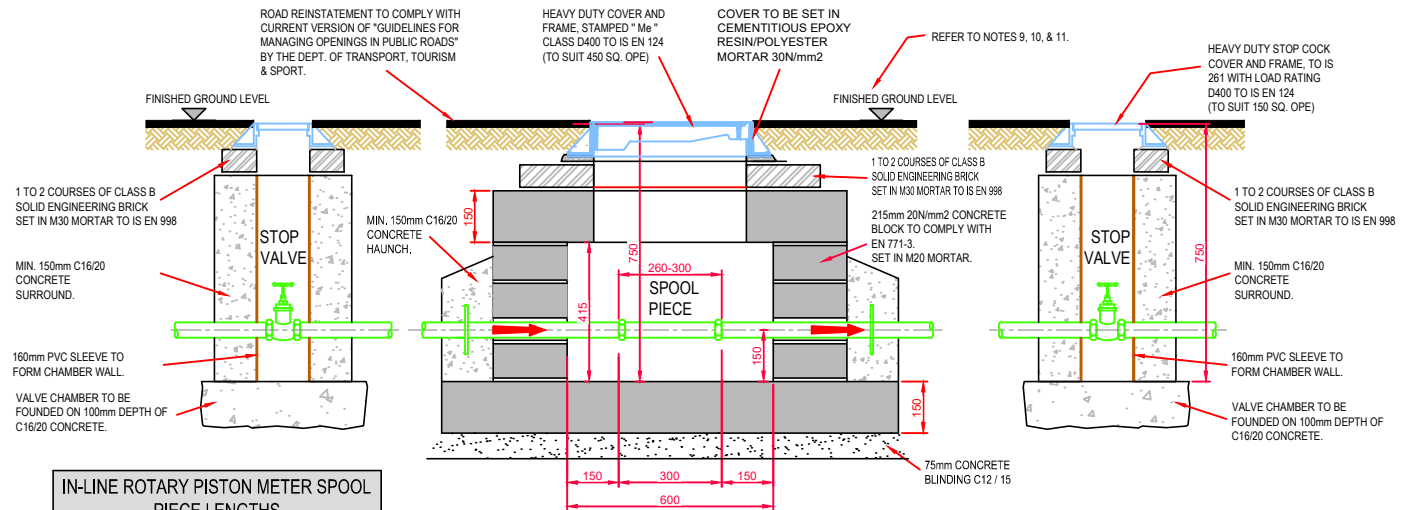


IN-LINE ROTARY PISTON METER SPOOL PIECE LENGTHS			
Ø mm	DN30	DN32	DN40
Length mm	260	260	300

**SECTION**

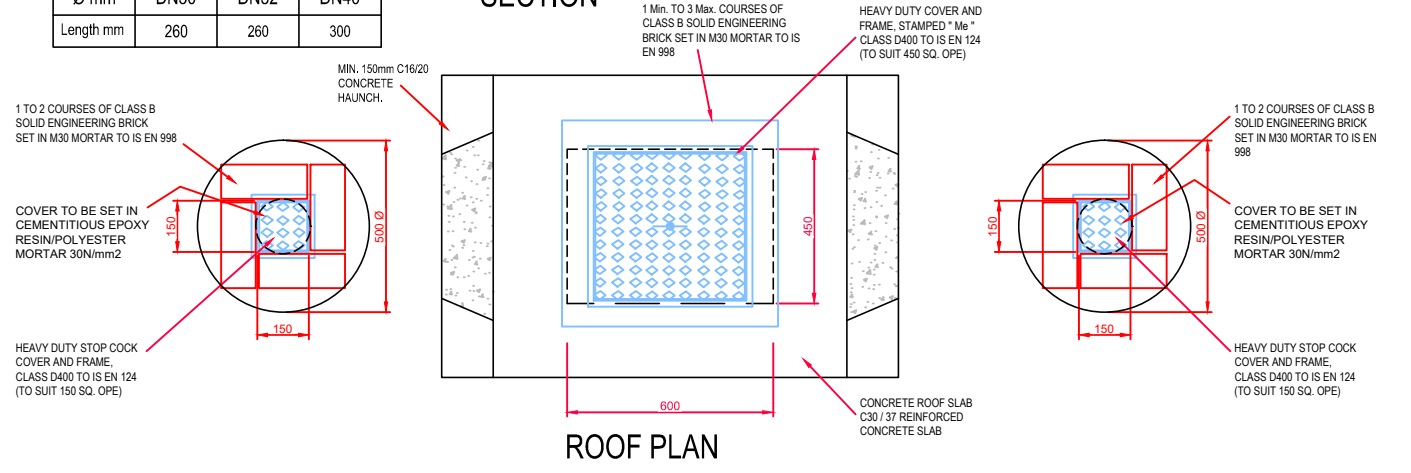

**ROOF PLAN**

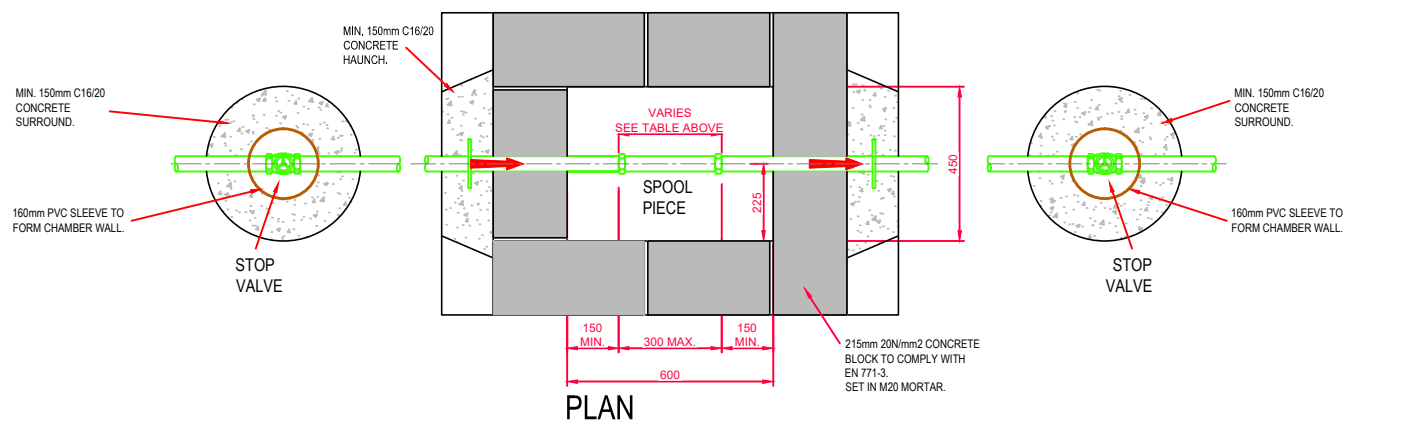

**PLAN**



REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

					<b>STANDARD DETAILS - WATER</b>		SCALE NOT TO SCALE	DATE SEPT. 2019
	TITLE <b>THREADED ROTARY PISTON FLOW METER CHAMBER (DN30 - DN40mm DIA.) BLOCKWORK OPTION</b>						DRAWING No. <b>STD-W-26E</b>	REV <b>0</b>
	No.	Date	Drn	Chk	Description	App		
0	07/20	RH	TOC	Initial Issue				

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- STRUCTURAL DESIGN AND REINFORCEMENT DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER APPROVAL, & COMPLIANCE WITH IS EN 1917 & IS 420.
- SLUICE VALVE CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 OR BS 5834. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
- 200mm ALL AROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GREEN AREAS.
- DUCTILE IRON PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
- ANTI CORROSION TAPE TO BE PROVIDED AROUND ALL BURIED FLANGES.
- ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO REVIEW BY IRISH WATER.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
- ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
- NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
- EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
- 200mm ALL AROUND x 100mm DEEP, C20/25 CONCRETE PLINTH COMPLETE WITH BULL NOSE FINISH AND MILD STEEL REINFORCEMENT LINK AROUND COVERS IN GREEN AREAS.

**NOTE:**

- THIS ARRANGEMENT TO BE INSTALLED FOR THE PURPOSE OF TESTING FOR NIGHT FLOWS WHEN CHECKING AN ESTATE FOR LEAKS.
- STOP TAP IN THE METER BOX TO BE MAINTAINED IN THE CLOSED POSITION.

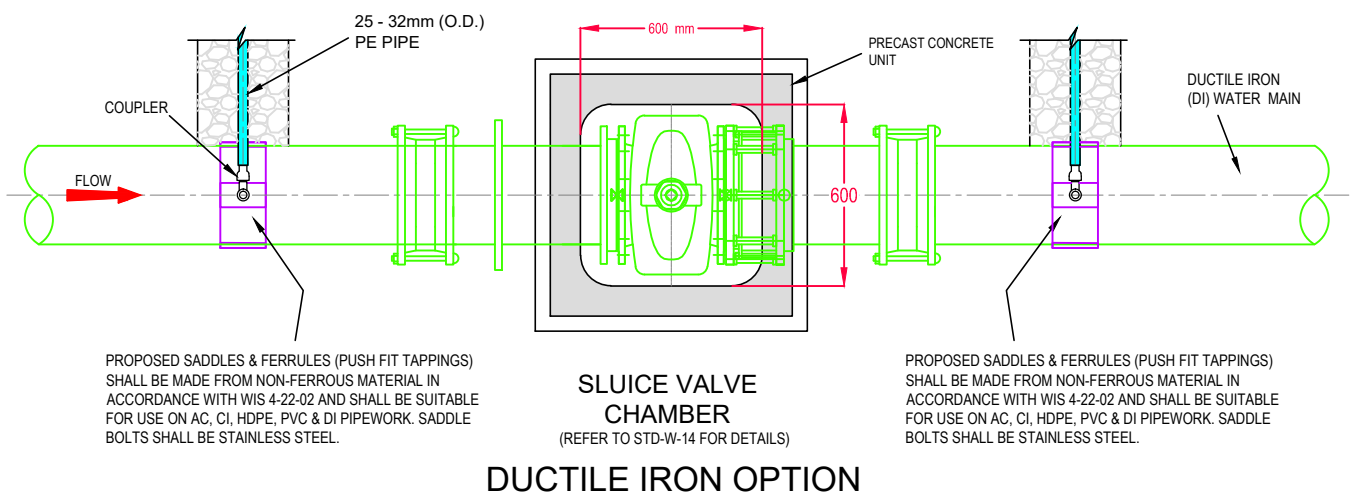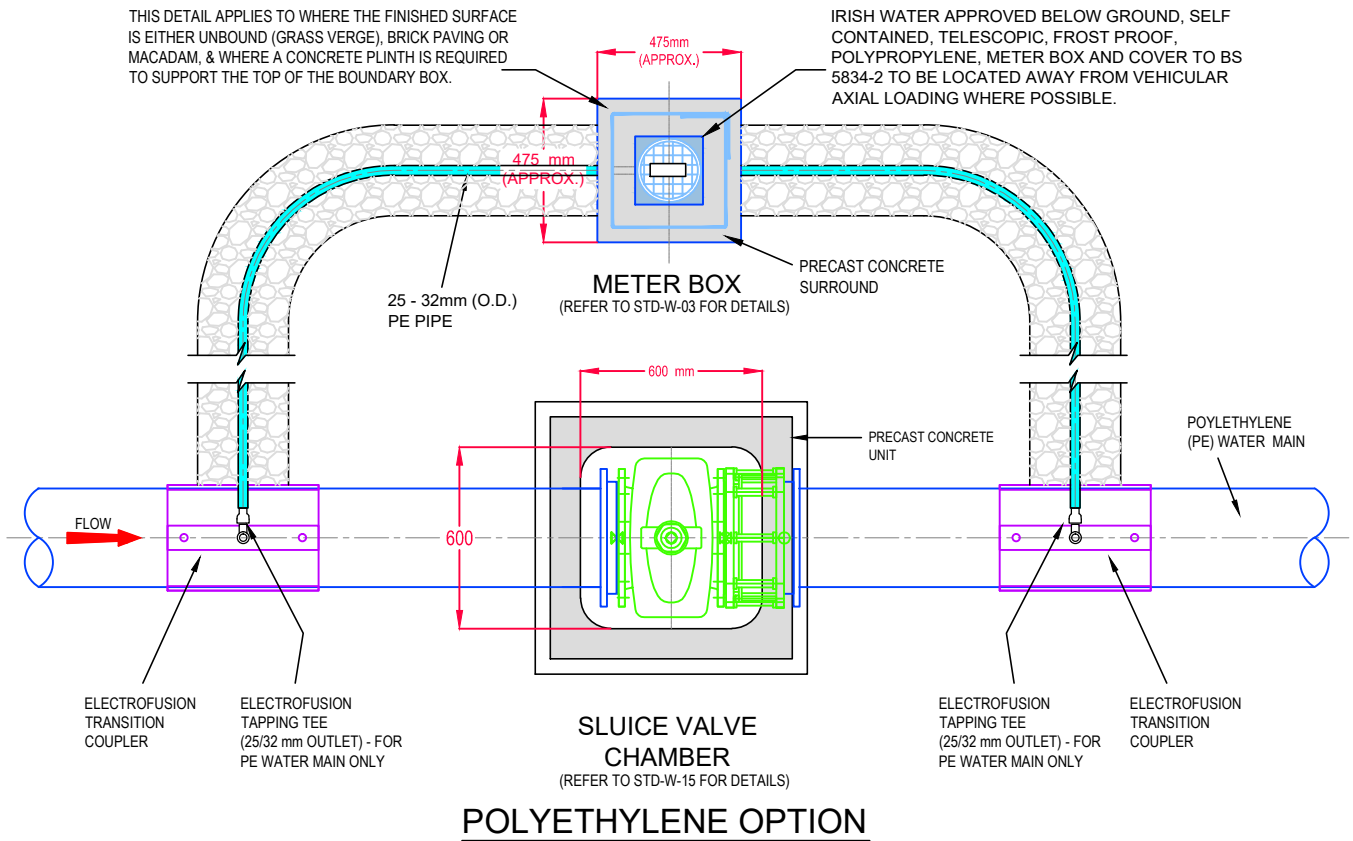

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

	<p>0 07/20 RH TOC Initial Issue MOD</p> <p>No. Date Drn Chk Description App</p>				<p><b>STANDARD DETAILS - WATER</b></p>		<p>SCALE NOT TO SCALE</p>	<p>DATE JAN. 2020</p>
	<p>TITLE</p> <p><b>BY-PASS FLOW METER CHAMBER</b> (25-32mm O.D. DIA.) For Developments with &lt;20m<sup>3</sup>/Day Water Use</p>						<p>DRAWING No.</p> <p><b>STD-W-26F</b></p>	<p>REV</p> <p><b>0</b></p>
	<p>07/20 RH TOC Initial Issue MOD</p> <p>No. Date Drn Chk Description App</p>							

**GENERAL NOTES:**

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. FOR CONNECTION TO AN EXISTING MAIN THE CONNECTION SHALL BE AS PER THE PIPE MANUFACTURER'S SPECIFICATION.
3. ELECTRO FUSION COUPLING TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
4. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.


**BOUNDARY BOX NOTES:**

1. THE BOUNDARY BOX IS TO BE IN ACCORDANCE WITH THE IRISH WATER SPECIFICATION, INCORPORATING A STOP-TAP, FROST PLUG & NON-RETURN VALVE.
2. THE BOUNDARY BOX SHALL BE POSITIONED IN PUBLIC SPACE & AS CLOSE AS POSSIBLE TO THE PROPERTY BOUNDARY BUT NO PART OR FITTING TO BE WITHIN 225mm OF THE PROPERTY LINE.
3. THE BOUNDARY BOX SHALL BE LOCATED WHERE IT IS SAFE TO OPEN THE COVER & ACCESS THE STOP TAP OR VISUALLY READ THE METER, i.e. ON A FOOTPATH OR VERGE, & NOT IN A CARRIAGEWAY.
4. THE SURFACE BOX COVER ON THE BOUNDARY BOX SHOULD BE NOT LESS THAN GRADE C (BS 5834:2-2011); & THE BOUNDARY BOX SHOULD BE LOCATED SUCH THAT HEAVIER GRADES OF COVER WOULD NOT BE REQUIRED.
5. THE SHAFT OF THE BOUNDARY BOX IS TO BE INSTALLED VERTICALLY, & THE SURFACE BOX/COVER INCLINED TO MATCH THE SURFACE GRADIENT.
6. THE BOUNDARY BOX IS TO BE INSTALLED AT A MINIMUM DEPTH OF 600mm (+/- 25mm) TO THE CROWN OF THE INLET & OUTLET FITTINGS ON THE OUTSIDE OF THE BOX.
7. THE SERVICE CONNECTION PIPE SHALL NOT BE WRAPPED AROUND THE SHAFT OF THE BOUNDARY BOX OR BENT IN ANY RADIUS LESS THAN THAT APPROVED BY THE MANUFACTURER.
8. THE PIPE FITTINGS TO THE BOUNDARY BOX SHALL BE APPROVED BY THE BOUNDARY BOX MANUFACTURER.
9. THE BOUNDARY BOX SHALL BE INSTALLED HYGIENICALLY & LEFT CLEAN & FREE OF CONSTRUCTION WASTE OR DIRT FOR LATER METER INSTALLATION BY IRISH WATER.
10. BOX TO BE FOUNDED ON 100mm DEPTH OF C12/15 CONCRETE AND SURROUNDED WITH CLAUSE 808 GRANULAR MATERIAL.
11. THE DESIRABLE MINIMUM COVER FROM THE FINISHED GROUND LEVEL TO THE EXTERNAL CROWN OF A SERVICE CONNECTION SHALL BE 750mm WITH AN ABSOLUTE MINIMUM DEPTH OF 600mm FOR SHORT DISTANCES (SUBJECT TO IRISH WATER AGREEMENT). THE DESIRABLE MAXIMUM COVER FOR A SERVICE CONNECTION PIPE SHOULD BE 1200mm, WHERE PRACTICABLE.
12. CUSTOMER'S DISTRIBUTION PIPEWORK WITHIN THE PREMISES SHOULD BE SUITABLY SIZED TO ACCOMMODATE THE FLOW PASSING THROUGH THE BOUNDARY BOX.
13. WHERE A GRASS VERGE IS NOT AVAILABLE AND A FOOTPATH IS LESS THAN 1.5m WIDE, THE WATERMAIN IS PERMITTED ON THE ROADWAY.
14. THE POSITION OF THE METER DOES NOT REPRESENT THE CHANGE OF OWNERSHIP IN THE SERVICE PIPE. THAT POINT IS NORMALLY AT THE PROPERTY BOUNDARY.
15. THE BOUNDARY BOX ACCOMMODATES INLINE ROTARY PISTON METERS UP TO SIZE DN32mm WITH THREADED ENDS.

IRISH WATER APPROVED BELOW GROUND, SELF CONTAINED, TELESCOPIC, FROST PROOF, POLYPROPYLENE, METER BOX AND COVER TO BS 5834-2 TO BE LOCATED AWAY FROM VEHICULAR AXIAL LOADING WHERE POSSIBLE.

THE BELOW GROUND METER BOX IS TO BE INSTALLED AT A MINIMUM DEPTH OF 600mm (+/- 25mm) TO THE CROWN OF THE INLET & OUTLET FITTINGS ON THE OUTSIDE OF THE BOX.


WELL COMPACTED CLAUSE 808 GRANULAR BACKFILL

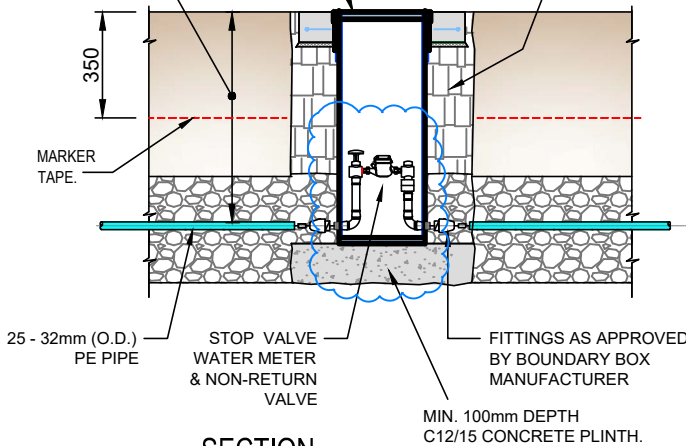

**SECTION**

THIS DETAIL APPLIES TO WHERE THE FINISHED SURFACE IS EITHER UNBOUND (GRASS VERGE), BRICK PAVING OR MACADAM, & WHERE A CONCRETE PLINTH IS REQUIRED TO SUPPORT THE TOP OF THE BOUNDARY BOX.

TO MATCH SURFACE FINISH LEVEL OF SURROUNDING AREA.

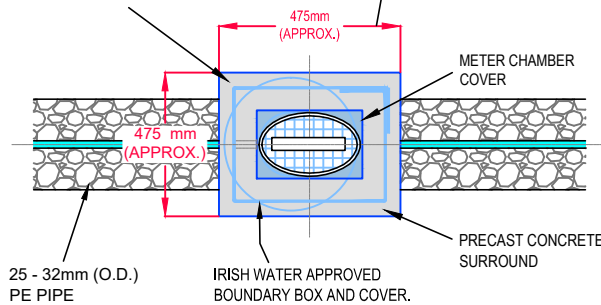

**PLAN**


**25-32mm O.D. Ø INLINE WATER METER CHAMBER DETAILS**

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



0	07/20	RH	TOC	Initial Issue	MOD
No.	Date	Drn	Chk	Description	App


STANDARD DETAILS - WATER	
TITLE	SCALE
INLINE FLOW METER CHAMBER (25-32mm O.D. DIA.)	NOT TO SCALE
	DATE
	SEPT. 2019
	DRAWING No.
	STD-W-26G
	REV
	0

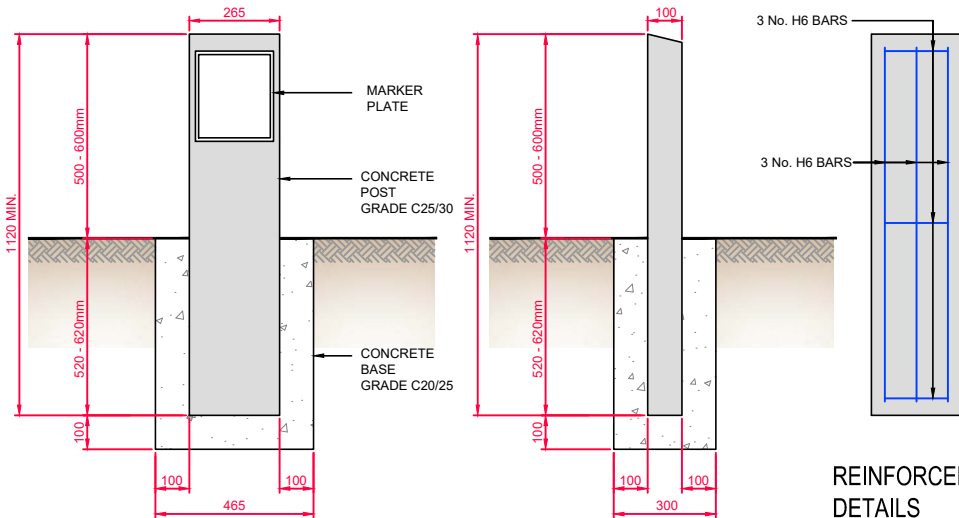

ELEVATION

SECTION


REINFORCEMENT DETAILS



PLAN

DIAMETER OF WATERMAIN  
(100mm) - 40mm HIGH TEXT

- WHERE PRACTICAL MARKER PLATES SHALL BE FIXED TO ADJACENT WALLS OR ALTERNATIVELY ATTACHED TO MARKER POSTS.
- PLATES TO BE FIXED IN POSITION USING WALL PLUGS AND STAINLESS STEEL SCREWS.
- MARKER PLATES TO BE MANUFACTURED IN ACCORDANCE WITH BS 3251.
- FOR HYDRANT PLATE ALL CHARACTERS SHOULD BE BLACK AND THE REMAINDER OF THE FRONT FACE SHOULD CONFORM TO COLOUR REFERENCE RAL 0658080.
- PIPE DIAMETER ON HYDRANT PLATE TO REFER TO WATERMAIN NOT BRANCH.
- SLUICE VALVE, AIR VALVE, SCOUR VALVE, AND WASHOUT HYDRANT, ETC. SHOULD BE CAST ALUMINIUM. ALL CHARACTERS SHOULD BE BLACK ON WHITE PAINT BACKGROUND. ALTERNATIVE MATERIAL MAY BE USED SUBJECT TO ACCEPTANCE BY IRISH WATER.
- CONCRETE MARKER POST TO BE GRADE C25/30 AND IN ACCORDANCE WITH IS EN 206/2013.
- CONCRETE BASE TO BE GRADE C20/25
- PLASTIC MARKER POSTS ARE NOT ACCEPTABLE.
- PAINTING SPECIFICATION: 2 PACK EPOXY PRIMER 40 - 60 MICRONS FOLLOWED BY 2 PACK HIGH GLOSS POLYURETHANE TOP COAT APPLIED AT 40 - 60 MICRONS
- REFERENCES TO PIPE DIAMETERS ON MARKER PLATES REFER SPECIFICALLY TO THE NOMINAL INTERNAL DIAMETER OF THE PIPE REGARDLESS OF PIPE MATERIAL.









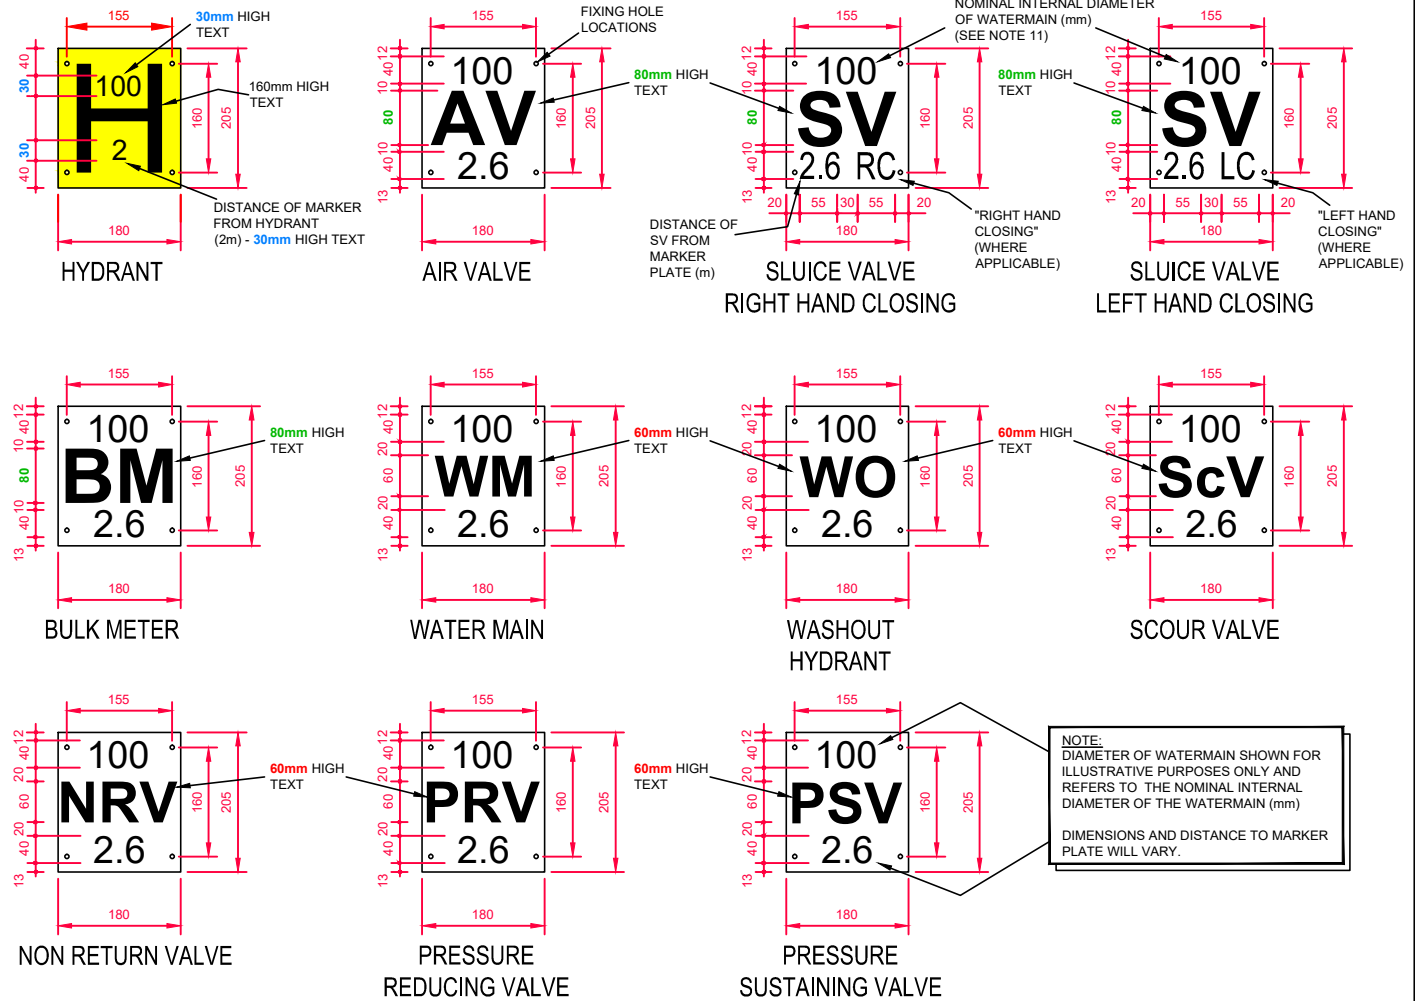


NOTE:  
DIAMETER OF WATERMAIN SHOWN FOR ILLUSTRATIVE PURPOSES ONLY AND REFERS TO THE NOMINAL INTERNAL DIAMETER OF THE WATERMAIN (mm)  
DIMENSIONS AND DISTANCE TO MARKER PLATE WILL VARY.

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

	<p style="text-align: center;"><b>STANDARD DETAILS - WATER</b></p>						SCALE	DATE
	TITLE						NOT TO SCALE	SEPT. 2015
	MARKER POSTS / PLATES						DRAWING No.	REV
							STD-W-27	3
No.	Date	Drn	Chk	Description	App			
3	07/20	IRH	TOC	Additional Marker Plates Included and Revised Notes	MOD			
2	11/17	JMC	TOC	Added BM plate & updated notes	MOD			
1	04/16	JMC	TOC	Added washout hydrant plate	MOD			
0	09/15	JMC	TOC	Initial Issue	SL			



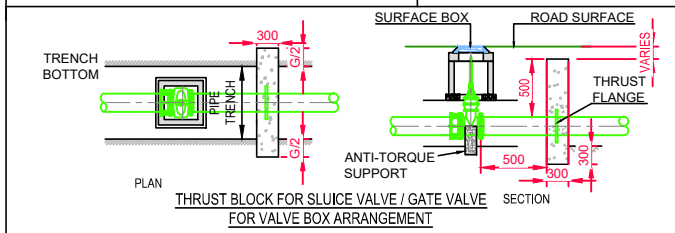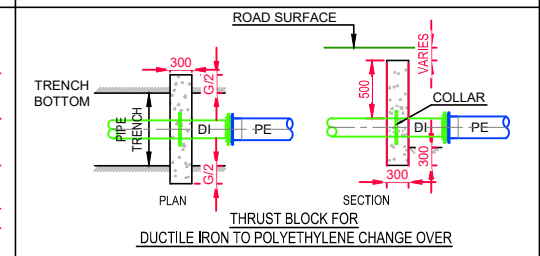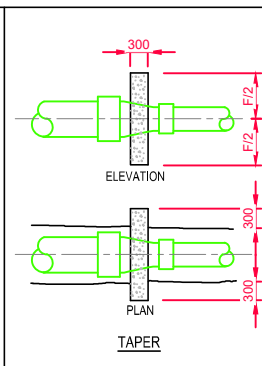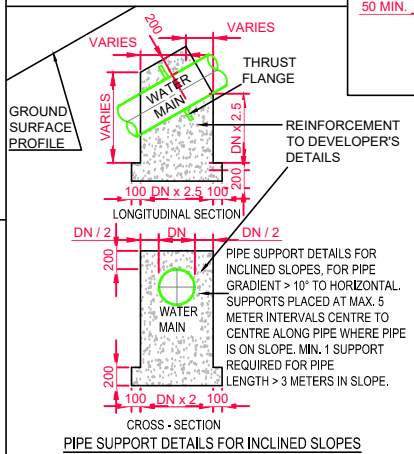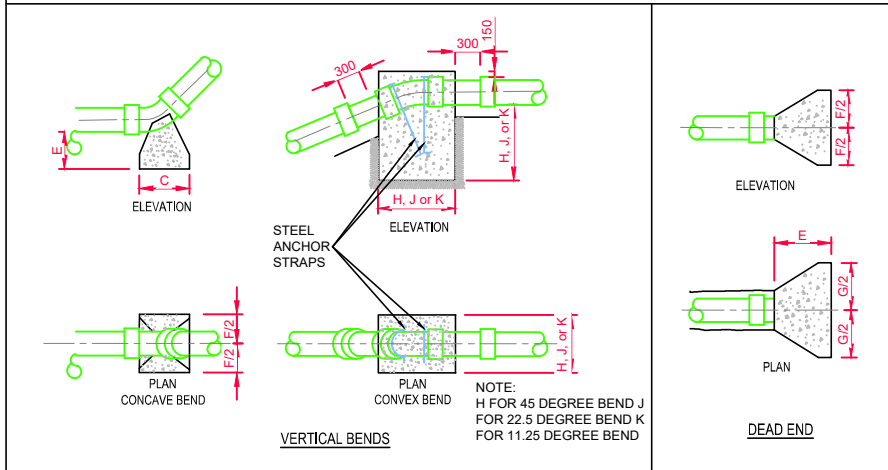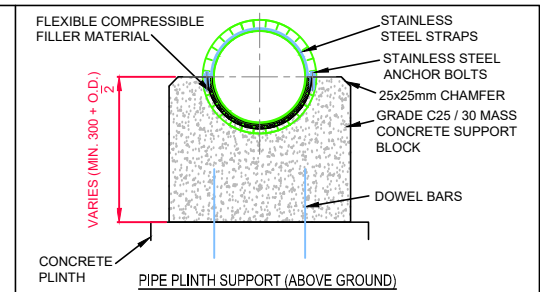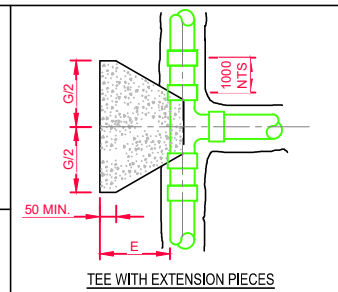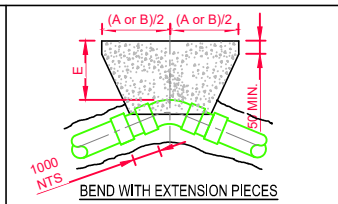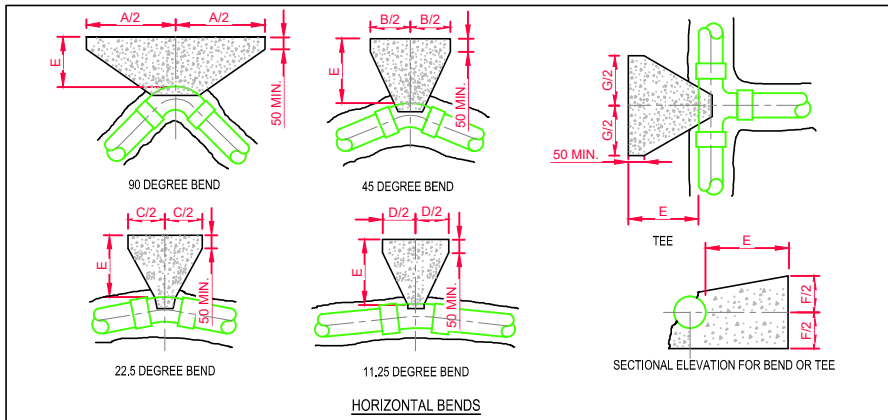

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. CONCRETE THRUST BLOCKS (ANCHORAGE) SHALL BE POSITIONED SYMMETRICALLY WITH RESPECT TO THE CONNECTING PIPE & BENDS.
3. TRENCH DIMENSIONS : REFER TO DRAWING No.s. STD-W-13.
4. THRUST BLOCKS SHALL BEAR ON UNDISTURBED SOIL. IF FOR ANY REASON THEY CANNOT THEN THE DEVELOPER SHALL NOTIFY IRISH WATER IMMEDIATELY WITH A PROPOSED SOLUTION.
5. THRUST BLOCK REINFORCEMENT REQUIRES SPECIFIC DESIGN.
6. FOR TEST PRESSURES GREATER THAN 18 BAR, THRUST BLOCK DESIGN IS TO BE SUBMITTED TO IRISH WATER FOR REVIEW.
7. THRUST BLOCKS ARE DESIGNED FOR AN AVERAGE BEARING PRESSURE OF 100 KN/m<sup>2</sup> (TYPICAL FOR SOFT CLAY) FOR OTHER CONDITIONS. ACTUAL DIMENSIONS MAY BE ALTERED ON INSTRUCTIONS FROM IRISH WATER.
8. CONCRETE IN THRUST BLOCKS SHALL BE GRADE C20/25.
9. COMPRESSIBLE FILLER FOR CONCRETE PROTECTION TO BE IN ACCORDANCE WITH BS EN 622-1 AND BS EN 622-4. BITUMINOUS MATERIAL SHALL NOT BE PUT IN CONTACT WITH PLASTIC PIPES. THE THICKNESS OF COMPRESSIBLE FILLER FOR MAINS < 450mm IN DIAMETER IS TO BE 18mm.
10. CONCRETE THRUST BLOCKS FOR POLYETHYLENE PIPE TO COMPLY WITH THE MANUFACTURERS REQUIREMENTS.
11. POLYETHYLENE PIPES SHALL BE WRAPPED IN PLASTIC SHEETING HAVING A COMPOSITION IN ACCORDANCE WITH BS 6076 BEFORE BEING CAST INTO CONCRETE.
12. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.

< 12 BAR TEST PRESSURE

NOM. DIA. (mm)	DIMENSIONS									
	A	B	C	D	E	F	G	H	J	K
100	600	330	160	80	200	350	390	700	600	400
150	950	510	260	130	225	450	660	900	750	600
200	1150	600	310	160	300	650	790	1050	900	700
250	1350	750	380	200	300	800	970	1200	1000	750
300	1580	850	450	220	320	950	1110	1330	1100	850
350	2100	1150	570	290	450	1000	1450	1550	1200	900
400	2550	1400	700	350	500	1050	1800	1700	1250	1000
450	3000	1630	830	420	680	1100	2130	1800	1450	1150
500	3590	1950	990	500	800	1200	2540	1950	1600	1250
600	4100	2200	1120	570	850	1400	2880	2100	1700	1300

12 BAR TO 15 BAR TEST PRESSURE

NOM. DIA. (mm)	DIMENSIONS									
	A	B	C	D	E	F	G	H	J	K
100	700	380	190	100	200	350	510	750	600	400
150	1135	620	320	160	225	450	760	950	750	600
200	1400	750	380	190	300	650	960	1150	950	700
250	1730	940	480	240	320	800	1210	1350	1050	850
300	2090	1130	580	300	380	950	1480	1500	1200	950
350	2600	1410	720	360	500	1050	1840	1700	1350	1050
400	2980	1610	820	420	750	1200	2110	1850	1500	1150
450	3400	1840	940	470	900	1300	2330	2000	1600	1250
500	4090	2210	1130	570	1000	1400	2890	2200	1750	1350
600	5010*	2710*	1380	700	1000	1500	3550*	2350	1900	1500

15 BAR TO 18 BAR TEST PRESSURE


NOM. DIA. (mm)	DIMENSIONS									
	A	B	C	D	E	F	G	H	J	K
100	750	400	205	100	220	400	530	800	650	400
150	1250	700	350	180	250	500	890	1000	850	650
200	1650	890	450	230	320	700	1170	1250	1000	800
250	1960	1060	540	270	350	900	1370	1450	1150	900
300	2300	1200	640	320	500	1100	1630	1650	1300	1050
350	2930	1580	830	410	750	1200	2070	1850	1500	1150
400	3510	1900	970	190*	1000	1300	2490	2000	1600	1250
450	3810	2270	1160	580	1000	1350	2970	2150	1700	1350
500	4340*	2380	1210	610	1000	1400	3700	2250	1750	1400
600	6370*	3450*	1760	890	1000	1500	4500*	2400	2050	1650

TABLE OF DIMENSIONS FOR STEEPLY INCLINED PIPELINES

GRADIENT	SPACING
1 IN 2 & STEEPER	5.5m
BELOW 1 IN 2 TO 1 IN 4	11.0m
1 IN 4 TO 1 IN 5	16.6m
1 IN 5 TO 1 IN 6	22.0m


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						STANDARD DETAILS - WATER		SCALE NOT TO SCALE	DATE SEPT. 2015
						TITLE	WATER MAIN THRUST AND SUPPORT BLOCKS		
	No.	Date	Dm	Chk	Description	App	STD-W-28		

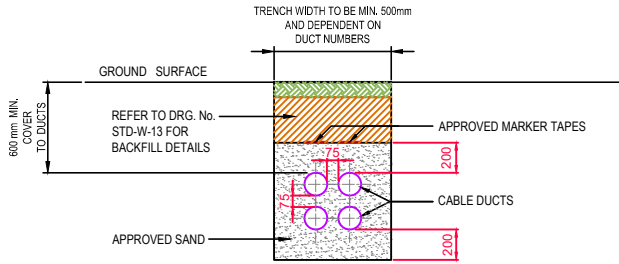


SECTION C - C


1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. STRUCTURAL DESIGN AND REINFORCEMENT DETAILS TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW.
3. DUCT ARRANGEMENT MAY VARY DEPENDING ON REQUIREMENTS.
4. CABLE DUCTS TO BE IN ACCORDANCE WITH BS 4460 AND BS EN 1401. DUCTS FOR ESB USE TO BE IN ACCORDANCE WITH ESB SPECIFICATION.
5. PROPRIETARY DUCT CHAMBER MAY BE USED SUBJECT TO REVIEW FROM IRISH WATER.
6. LONG RADIUS BENDS MAY BE USED FOR CHANGES IN DIRECTION OF UP TO 45°. DUCT CHAMBERS SHALL BE PROVIDED FOR ALL BENDS GREATER THAN 45°.
7. DUCT CHAMBERS TO BE LOCATED AT 50m INTERVALS MAXIMUM.
8. APPROPRIATE MARKER TAPE SHALL BE LAID 200mm ABOVE THE EXTERNAL CROWN OF THE DUCT AND SHOULD INCORPORATE REINFORCED TRACING WIRE. TRACING WIRES SHALL BE CONNECTED ACROSS CHAMBERS. ELECTRICAL MARKER TAPE TO BE USED IN ACCORDANCE WITH ESB SPECIFICATION.
9. ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO REVIEW FROM IRISH WATER.
10. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
11. ALL DUCTING TO BE INSTALLED WITH DRAW CORDS/ROPES, TO ALLOW PULL THROUGH OF CABLES.
12. CABLE DUCT INTERFACE WITH CHAMBER WALL TO BE SEALED TO PREVENT INGRESS OF GROUNDWATER TO CHAMBER.
13. DRAIN POINT TO BE PROVIDED FROM LOWEST LOCATED DUCT CHAMBER

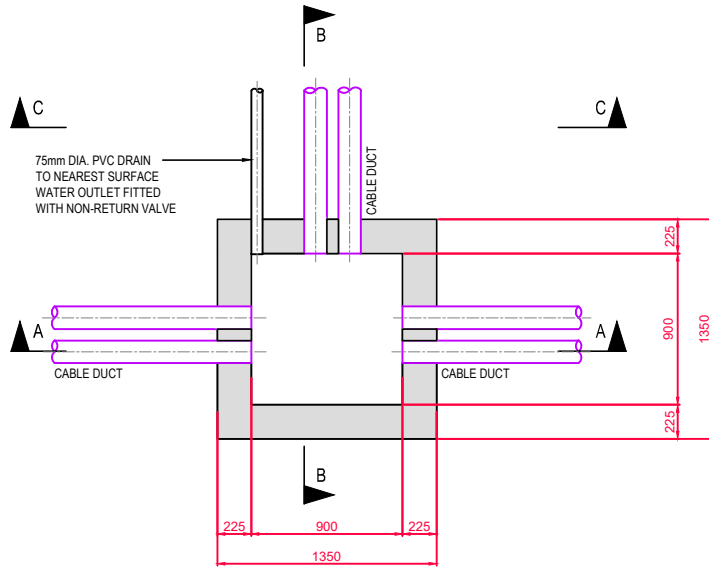

PLAN

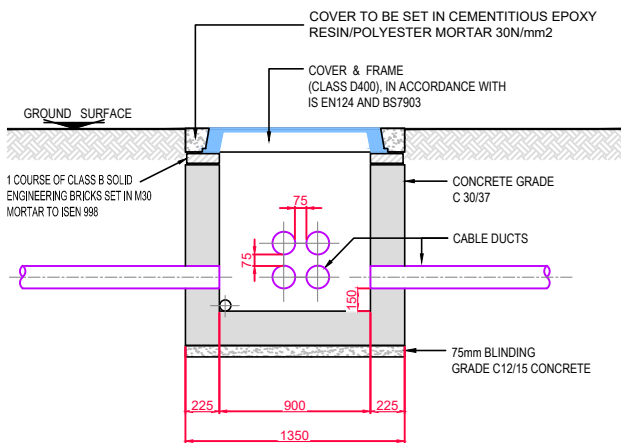

SECTION A - A

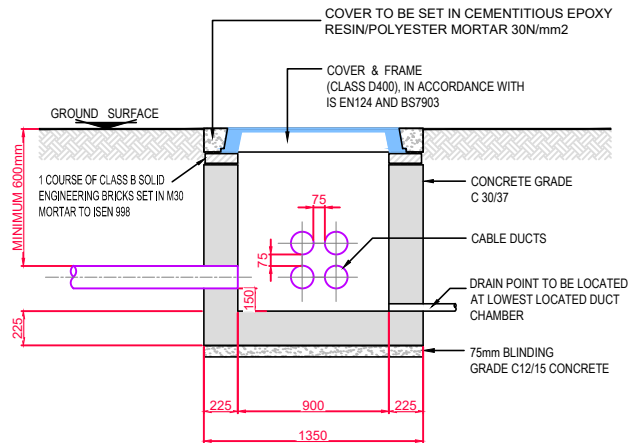





SECTION B - B

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						STANDARD DETAILS - WATER		SCALE NOT TO SCALE	DATE SEPT. 2015
						TITLE		DRAWING No.	REV
						DUCT CHAMBER		STD-W-29	3
	No.	Date	Drn	Chk	Description	App			
3	07/20	RH	TOC	Included drain point, updated notes	MOD				
2	11/17	JMC	TOC	Updated notes	MOD				
1	08/16	JMC	TOC	Revised cover notes	MOD				
0	09/15	JMC	TOC	Initial Issue	SL				


DIAMETER OF WATERMAIN (mm)	DIAMETER OF SCOUR (mm)
NOT EXCEEDING 75	50
100 TO 200	75
200 TO 350	100

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. STRUCTURAL REINFORCEMENT AND DESIGN DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 225mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1719 & IS 420.
3. CONCRETE FOR SCOUR CHAMBER AND HEADWALL TO BE C30/37.
4. PREFABRICATED CHAMBER AND HEADWALL MAY ALSO BE USED, SUBJECT TO REVIEW FROM IRISH WATER.
5. SCOUR CHAMBER SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS EN 124 RATING D400. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW FROM IRISH WATER.
6. 200mm ALL ROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GRASS AREAS.
7. FINAL DETAIL TO BE REVIEWED BY IRISH WATER AND RELEVANT REGULATORY AUTHORITIES.
8. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
9. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
10. ALL PIPEWORK AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
11. ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO AGREEMENT WITH IRISH WATER.
12. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
13. BACKFILL AND REINSTATEMENT OF RIVER BED AND BANK TO BE SUBJECT TO AGREEMENT WITH IRISH WATER & RELEVANT AUTHORITIES.

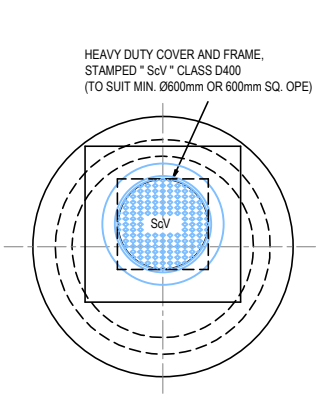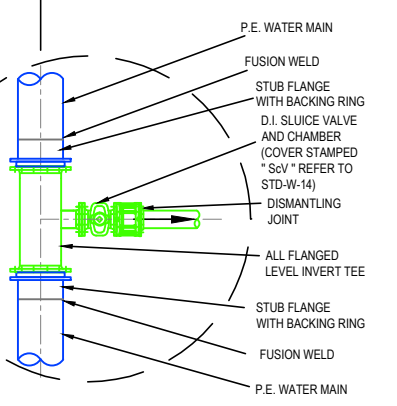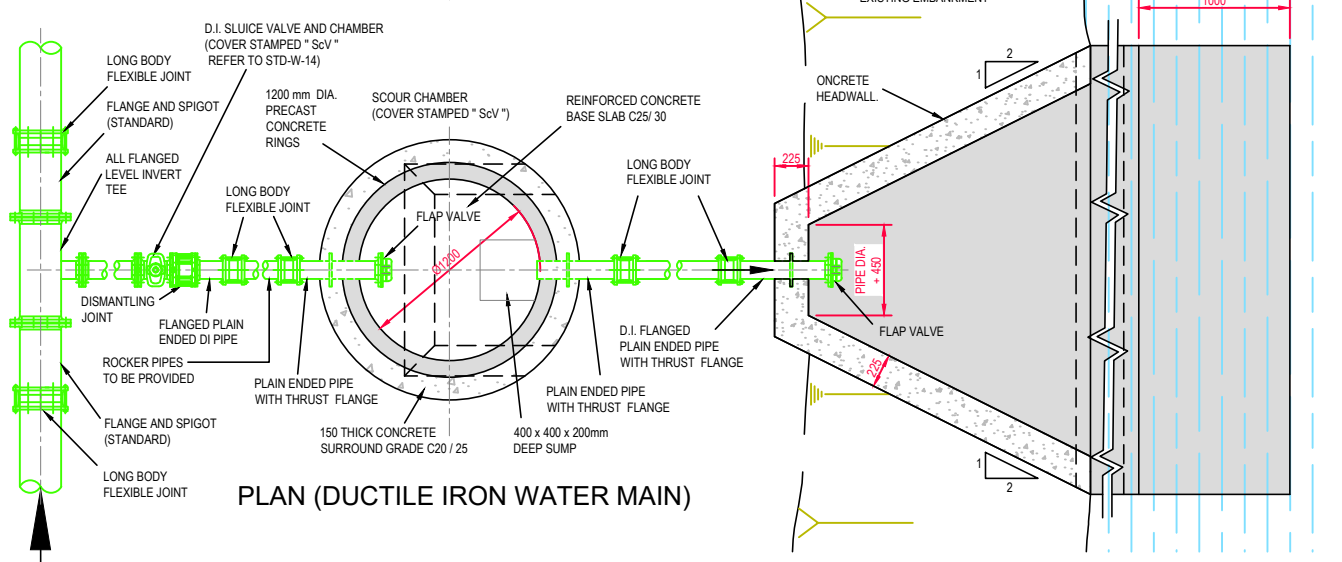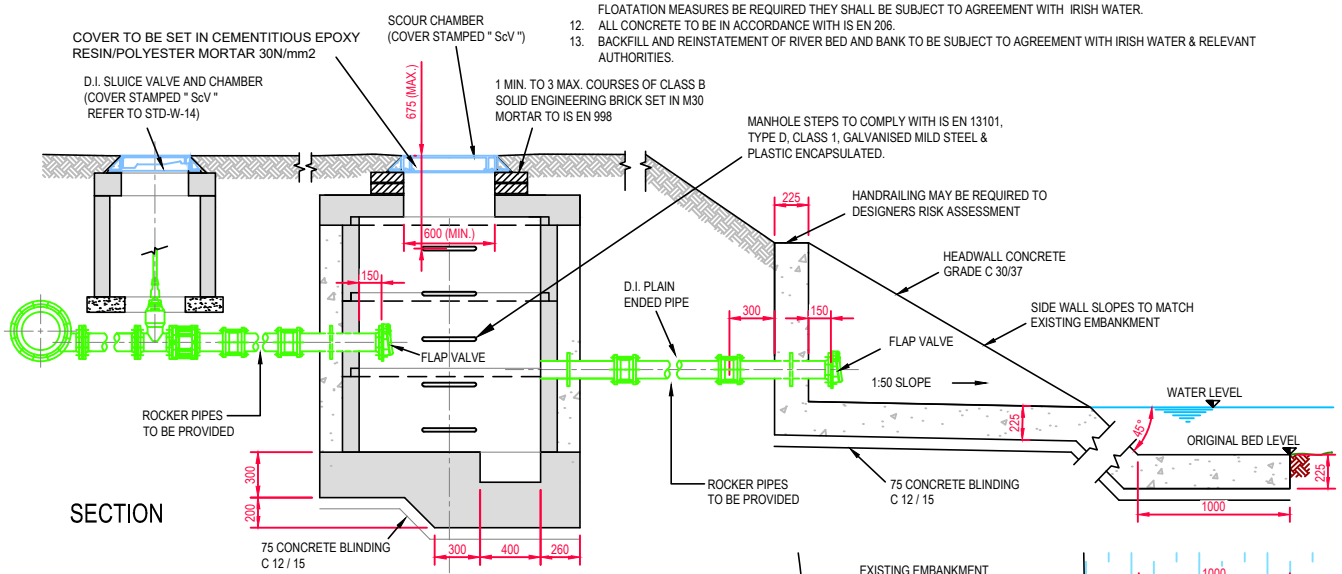


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT


	4	07/20	RH	TOC	Updated notes	MOD	<b>STANDARD DETAILS - WATER</b>	SCALE	DATE
	3	11/17	JMC	TOC	Updated notes	MOD		NOT TO SCALE	SEPT. 2015
	2	08/16	JMC	TOC	Added steps & revised access cover & ope	MOD	<b>SCOUR CHAMBER AND HEAD WALL ARRANGEMENTS</b>	DRAWING No.	REV
	1	04/16	JMC	TOC	Added 1 No. flexible joint	MOD			
	0	09/15	JMC	TOC	Initial Issue	SL			
No.	Date	Drn	Chk	Description	App				

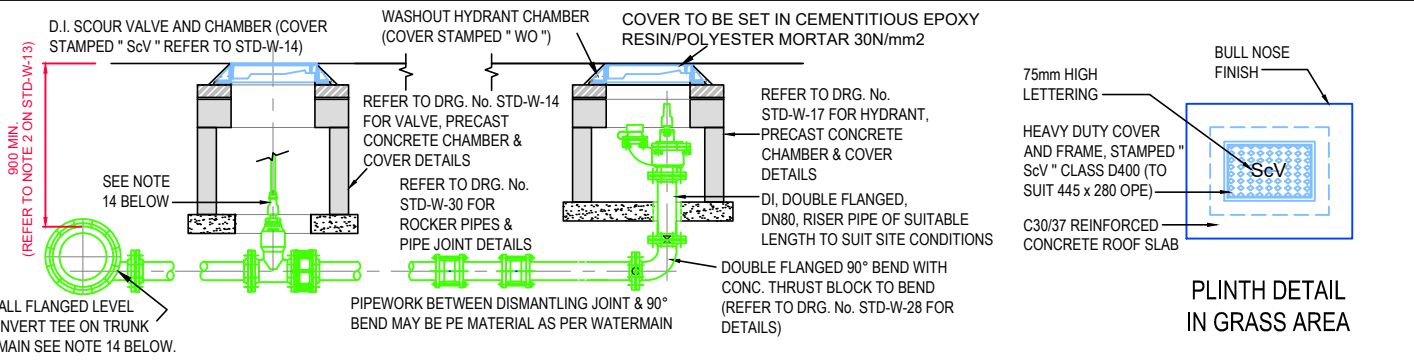


**SECTION (PRECAST CONCRETE CHAMBER OPTION)**

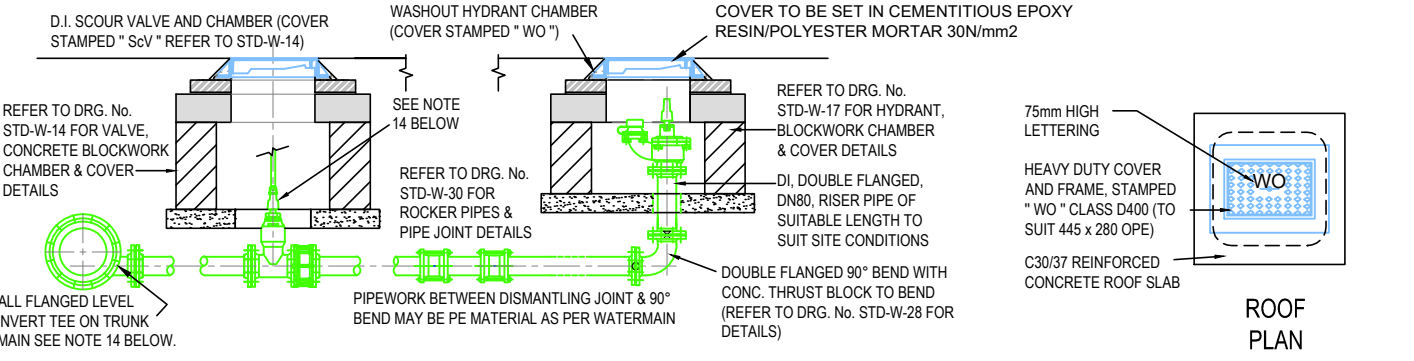

**SECTION (BLOCKWORK CHAMBER OPTION)**

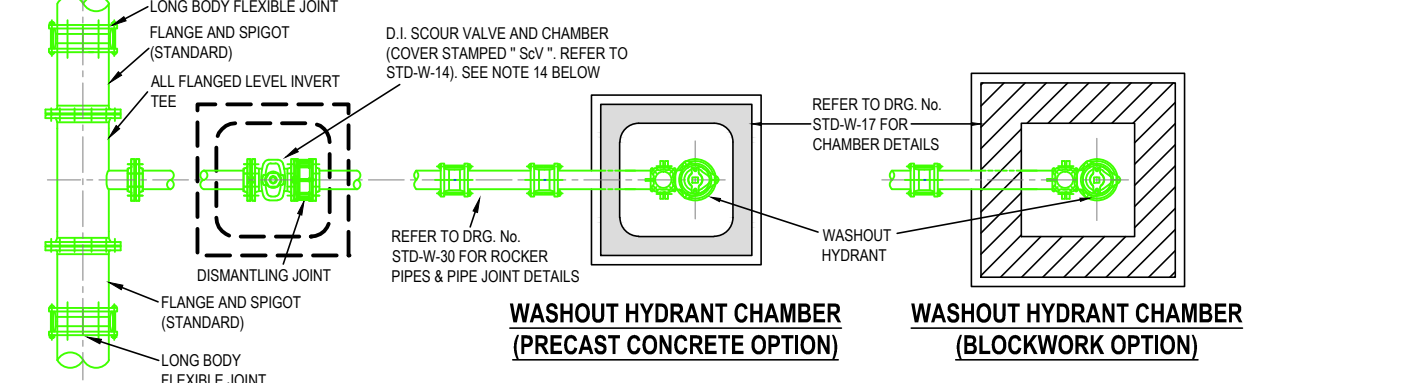

**PLAN (DUCTILE IRON WATER MAIN)**

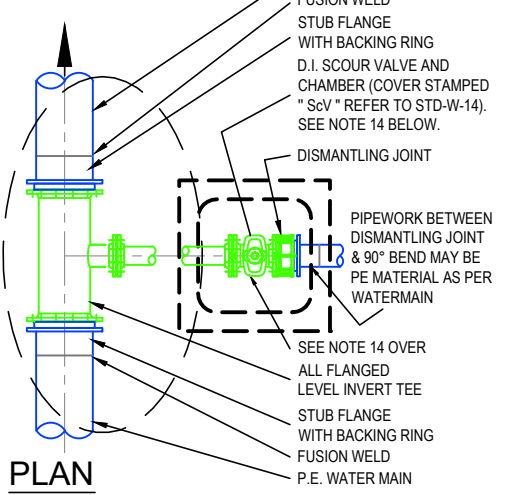

**PLAN (POLYETHYLENE WATER MAIN)**





1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. STRUCTURAL REINFORCEMENT AND DESIGN DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW.
3. HYDRANT CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 AND BS 5834 COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
4. HYDRANTS SHALL BE DOUBLE FLANGED DRILLED TO PN 16. THEY SHALL COMPLY WITH BS 750: 2012. THE HYDRANT SHALL INCORPORATE A SCREW DOWN GATE VALVE, UNDERGROUND "GUIDE TO HEAD" TYPE WITH SCREW DOWN CONNECTION OUTLET AND FALSE SPINDLE CAP AND IRON CHAIN IN ACCORDANCE WITH ITEM 15 BELOW.
5. ALL HYDRANTS SHALL BE CLOCKWISE CLOSING.
6. HYDRANT CHAMBER & SCOUR VALVE CHAMBER TO BE CONSTRUCTED OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVELY PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW FROM IRISH WATER. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH BS 5911, Part 4.
7. CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
8. 200mm ALL ROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GRASS AREAS.
9. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
10. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
11. ALL PIPEWORK AND FITTINGS FOR WASHOUT HYDRANT CHAMBER CONNECTION SHALL BE DUCTILE IRON. PIPES AND FITTINGS ON MAIN LINE SHALL BE: PE PIPES & FITTINGS IN ACCORDANCE WITH IS EN 12201:2011, OR DUCTILE IRON PIPES AND FITTINGS IN ACCORDANCE WITH IS EN 545.
12. ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO AGREEMENT WITH IRISH WATER.
13. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
14. WHERE HYDRANTS ARE INSTALLED ON TRUNK MAINS OR PRINCIPAL MAINS, A SEPARATE SCOUR VALVE IS REQUIRED. THE PURPOSE OF THE SCOUR VALVE IS TO ISOLATE THE WASHOUT HYDRANT FOR MAINTENANCE PURPOSES & ALSO TO REDUCE THE VELOCITY OF THE DISCHARGE FLOW WHERE HIGH HEAD VALUES ARE CONCERNED. A "SANDWICH" OR "SPADE" VALVE MAY BE USED IN LIEU OF A SEPARATE SCOUR VALVE, SUBJECT TO PRIOR REVIEW BY IRISH WATER.
15. FIRE HYDRANT OUTLET TYPE SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE FIRE OFFICER FOR THE AREA AND SHALL BE AGREED PRIOR TO THE COMMENCEMENT OF WORKS.

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						<b>STANDARD DETAILS - WATER</b> TITLE <b>WASHOUT HYDRANT</b>	SCALE NOT TO SCALE	DATE APR. 2016	
	3	07/20	RH	TOC	Added notes re. PE branch pipe		MOD	DRAWING No. <b>STD-W-30A</b>	REV <b>3</b>
	2	11/17	JMC	TOC	Revised Chamber Base Detail & updated & added notes		MOD		
	1	08/16	JMC	TOC	Revised note 7		MOD		
	0	04/16	JMC	TOC	Initial Issue		MOD		
No.	Date	Drn	Chk	Description	App				

DIAMETER OF WATERMAIN (mm)	DIAMETER OF SCOUR (mm)
NOT EXCEEDING 75	50
100 TO 200	75
200 TO 350	100


1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. STRUCTURAL REINFORCEMENT AND DESIGN DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 225mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1719 & IS 420
3. CONCRETE FOR SCOUR CHAMBER AND HEADWALL TO BE C30/37.
4. APPROVAL TO BE OBTAINED FROM LOCAL AUTHORITY FOR CONNECTION TO THE EXISTING STORM SEWER.
5. SCOUR CHAMBER SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS EN 124 RATING D400. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW IRISH WATER.
6. 200mm ALL ROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GRASS AREAS.
7. FINAL DETAIL TO BE REVIEWED BY IRISH WATER AND RELEVANT REGULATORY AUTHORITIES.
8. THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
9. ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
10. ALL PIPEWORK AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
11. ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO AGREEMENT WITH IRISH WATER.
12. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
13. BACKFILL AND REINSTATEMENT OF RIVER BED AND BANK TO BE SUBJECT TO AGREEMENT WITH IRISH WATER & RELEVANT AUTHORITIES.

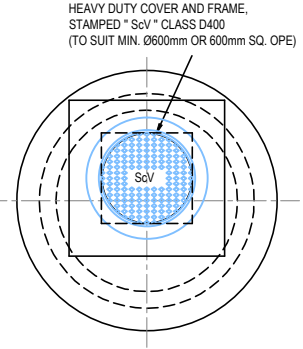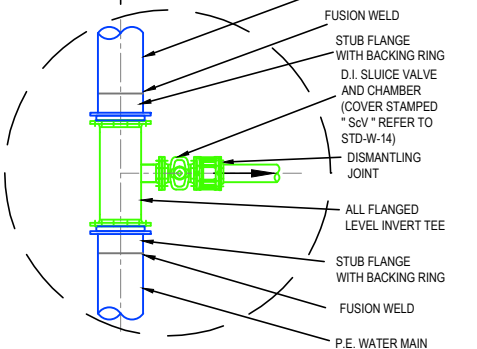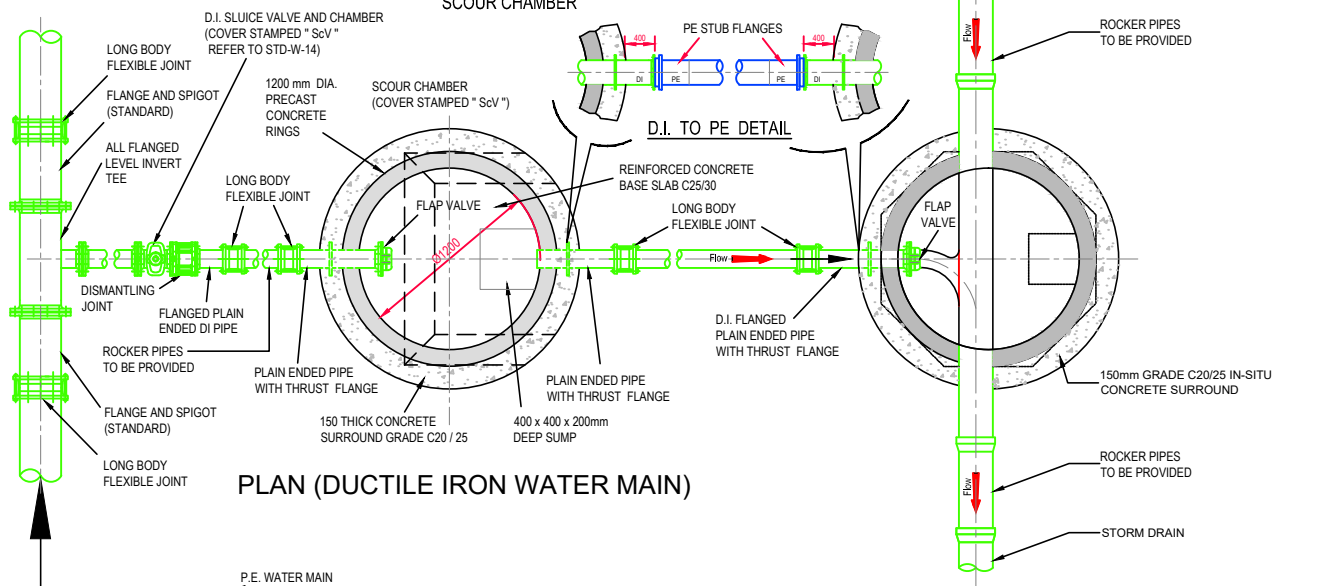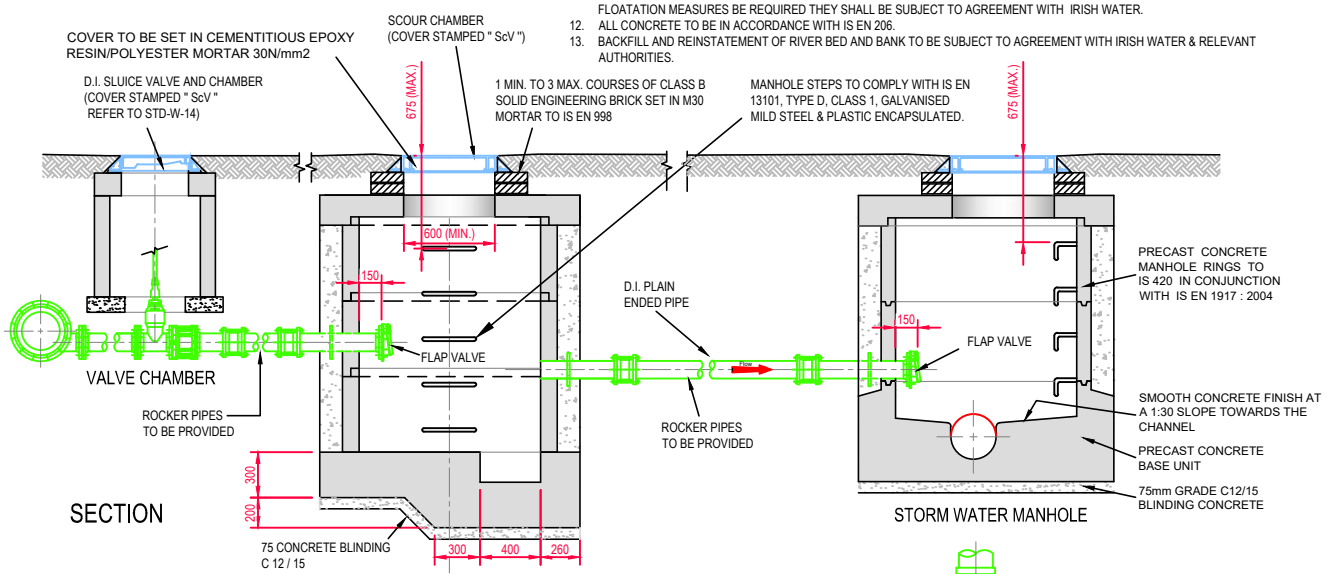


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

	<p>0 07/20 RH TOC Initial Issue MOD</p> <p>No. Date Drn Chk Description App</p>				<p>STANDARD DETAILS - WATER</p>		<p>SCALE NOT TO SCALE</p>	<p>DATE SEPT. 2019</p>
	<p>TITLE</p> <p>SCOUR CHAMBER TO STORM SEWER ARRANGEMENTS</p>						<p>DRAWING No.</p> <p>STD-W-30B</p>	<p>REV</p> <p>0</p>
	<p>UISCE EIREANN : IRISH WATER</p>							


1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. O.D. REFERS TO OUTSIDE DIAMETER OF PIPES OR COLLARS.
3. BENDS AT RESPECTIVE CROSSINGS SHALL BE AS INDICATED ON THE LONGITUDINAL SECTION DRAWING.
4. PIPEWORK AT CROSSING POINT TO BE POLYETHYLENE JOINED USING BUTT FUSION WELDING.
5. POLYETHYLENE PIPES SHALL BE WRAPPED IN PLASTIC SHEETING HAVING A COMPOSITION IN ACCORDANCE WITH BS 6076 BEFORE BEING CAST INTO CONCRETE.
6. THRUST BLOCKS TO BE PROVIDED AS PER STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
7. ALL DUCTILE IRON PIPEWORK AND FITTINGS SHALL BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
8. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
9. PIPEWORK FOR WATERMAIN CAN BE EITHER DUCTILE IRON OR POLYETHYLENE. PIPEWORK AT CROSSING POINT TO BE PE IN BOTH CASES.
10. BACKFILL AND REINSTATEMENT OF RIVER BED AND BANK TO BE SUBJECT TO AGREEMENT WITH RELEVANT AUTHORITY & IRISH WATER.

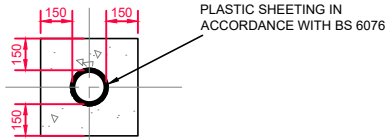

**CROSS SECTION  
(CONCRETE SURROUND)**

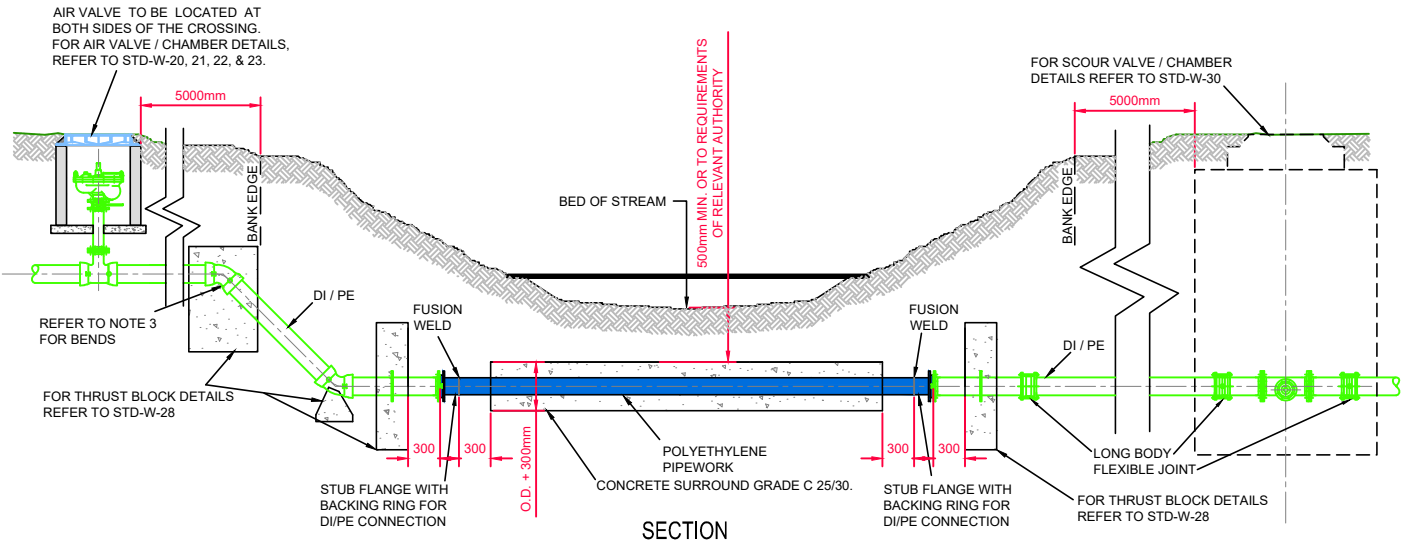

**SECTION**

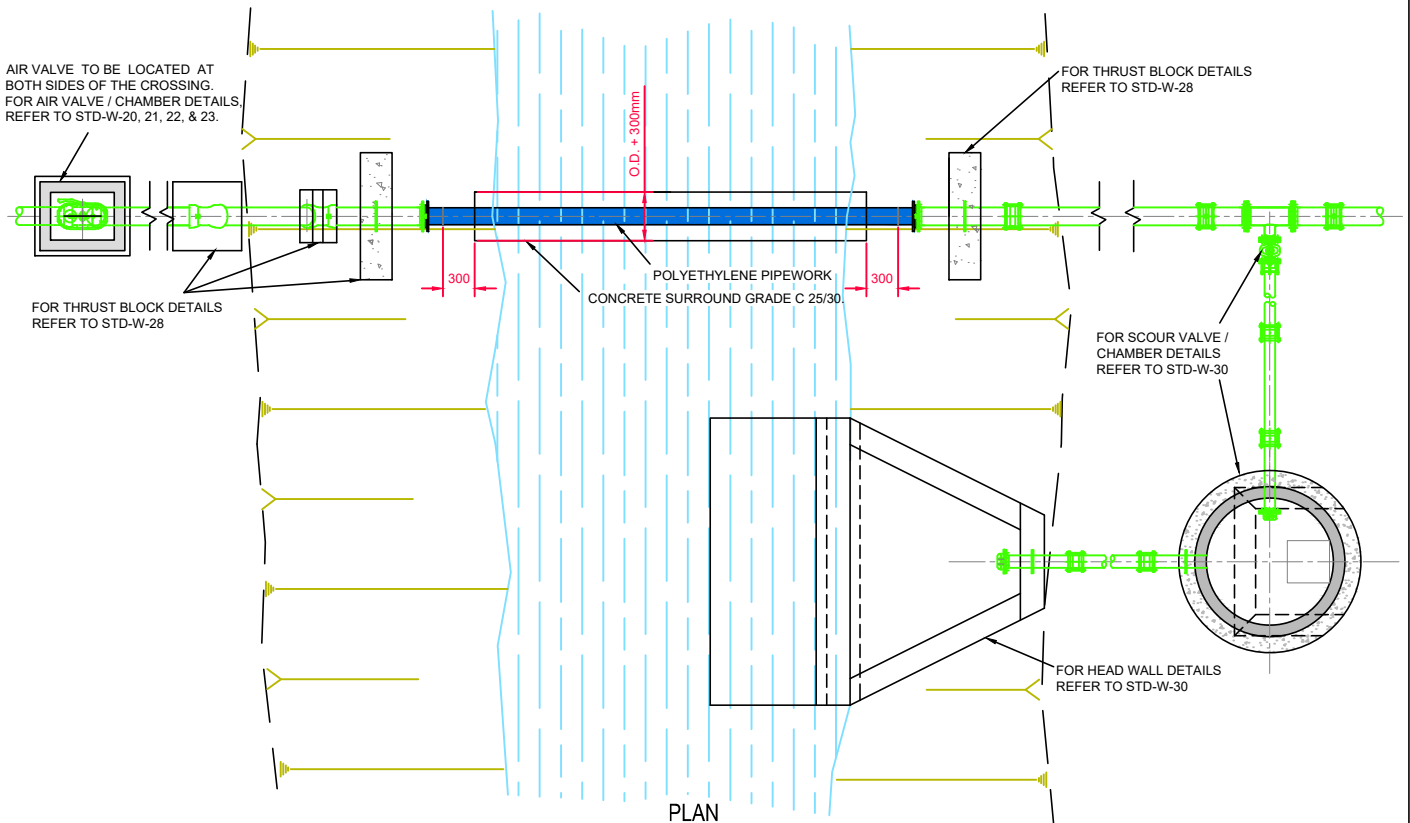

**PLAN**

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT






No.	Date	Drm	Chk	Description	App
2	07/20	RH	TOC	Title Amended	MOD
1	11/17	JMC	TOC	Updated pipe depth dimension	MOD
0	09/15	JMC	TOC	Initial Issue	SL

STANDARD DETAILS - WATER	
TITLE	SCALE
TYPICAL DITCH / STREAM CROSSING FOR WATER MAIN DUCTILE IRON OPTION	NOT TO SCALE

DATE	REV
SEPT. 2015	
DRAWING No.	STD-W- 31
	2

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. O.D. REFERS TO OUTSIDE DIAMETER OF PIPES OR COLLARS.
3. BENDS AT RESPECTIVE CROSSINGS SHALL BE AS INDICATED ON THE LONGITUDINAL SECTION DRAWING.
4. PIPEWORK AT CROSSING POINT TO BE POLYETHYLENE JOINED USING BUTT FUSION WELDING.
5. POLYETHYLENE PIPES SHALL BE WRAPPED IN PLASTIC SHEETING HAVING A COMPOSITION IN ACCORDANCE WITH BS 6076 BEFORE BEING CAST INTO CONCRETE.
6. THRUST BLOCKS TO BE PROVIDED AS PER STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
7. ALL DUCTILE IRON PIPEWORK AND FITTINGS SHALL BE IN ACCORDANCE WITH IS EN 545. PE PIPES AND FITTINGS TO BE IN ACCORDANCE WITH IS EN 12201:2011.
8. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
9. PIPEWORK FOR WATERMAIN CAN BE EITHER DUCTILE IRON OR POLYETHYLENE. PIPEWORK AT CROSSING POINT TO BE PE IN BOTH CASES.
10. BACKFILL AND REINSTATEMENT OF RIVER BED AND BANK TO BE SUBJECT TO AGREEMENT WITH RELEVANT AUTHORITY & IRISH WATER.

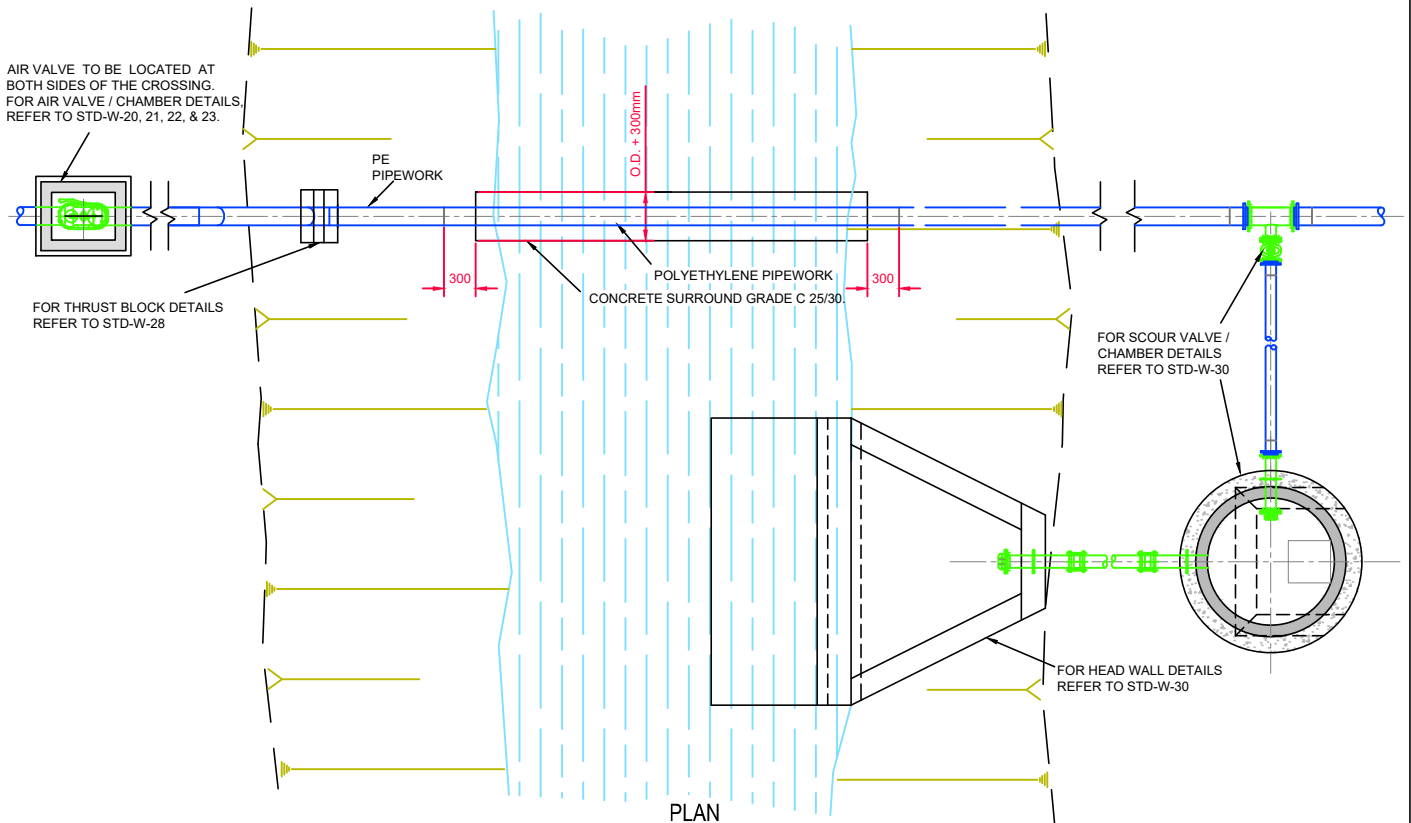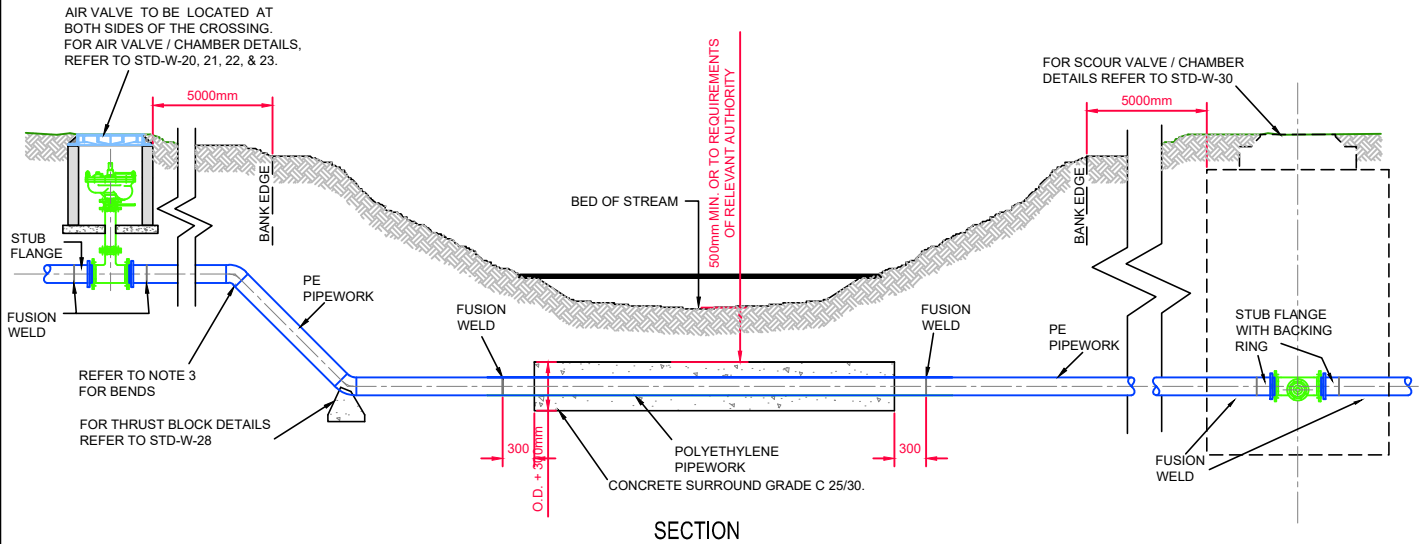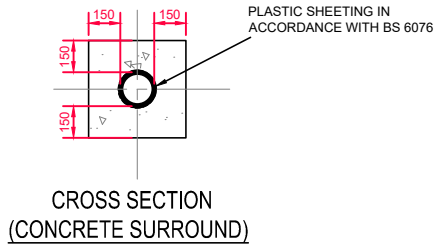


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



0	07/20	RH	TOC	Initial Issue	MOD
No.	Date	Drm	Chk	Description	App


STANDARD DETAILS - WATER	
TITLE	TYPICAL DITCH / STREAM CROSSING FOR WATER MAIN POLYETHYLENE OPTION

SCALE	NOT TO SCALE	DATE	SEPT. 2019
DRAWING No.	STD-W-31A	REV	0

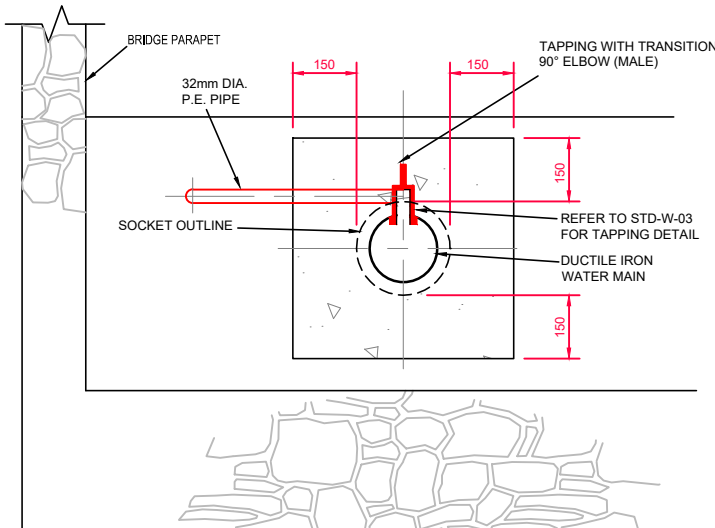


**SECTION A - A  
(AIR VALVE CONNECTION)**

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. AT BRIDGE CROSSING ALL PIPEWORK TO BE DUCTILE IRON IN ACCORDANCE WITH IS EN 545.
3. O.D. REFERS TO OUTSIDE DIAMETER OF PIPES OR COLLARS.
4. BENDS AT RESPECTIVE CROSSINGS SHALL BE INDICATED ON THE LONGITUDINAL SECTION DRAWING.
5. THE DEVELOPER IS TO SEEK ADVICE FROM IRISH WATER AS TO WHETHER A DUPLICATE MAIN IS TO BE PROVIDED THROUGH THE BRIDGE CROSSING. IF NECESSARY THE DEVELOPER IS TO SUBMIT A DESIGN TO IRISH WATER FOR REVIEW.
6. THRUST BLOCKS TO BE PROVIDED AS PER STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
7. THE QUALITY OF THE KIOSK CONSTRUCTION SHALL ENSURE THAT THE FOLLOWING IS ACHIEVED:
  - (a) A THERMAL TRANSMITTANCE OF 1.5W PER m<sup>2</sup> K
  - (b) A FIRE RESISTANCE (RETENTION OF STABILITY, INTEGRITY AND INSULATION) EQUIVALENT TO CLASS 2 OF BS 476, WHEN TESTED IN ACCORDANCE WITH BS 476 FOR A PERIOD EXCEEDING 30 MINUTES.
8. KIOSK (MIN. 600 HIGH x 450 WIDE x 300mm DEEP) - TO BE CONSTRUCTED FROM THERMOSETTING U.V. & WEATHER RESISTANT PLASTIC POWDER COATED & HOT DIPPED GALVANISED MILD STEEL (MIN. 4mm THICKNESS) TO BS EN 1461. STAINLESS STEEL OR NON-METALLIC MATERIALS, SUCH AS GLASS REINFORCED PLASTIC (GRP), MAY BE USED AS AN ALTERNATIVE KIOSK MATERIAL, PARTICULARLY IN SEVERE ENVIRONMENTS, SUBJECT TO AGREEMENT WITH IRISH WATER. COLOUR TO BE HOLLY GREEN BS 4800 14 C 39. KIOSK TO HAVE HINGED, LOCKABLE ACCESS DOOR (HINGES AND LOCKS TO BE STAINLESS STEEL).
9. THE KIOSK SHALL BE LOCATED OFF THE FOOTPATH SO AS NOT TO IMPEDE PEDESTRIANS AND POSITIONED SO AS TO FACILITATE SAFE ACCESS FOR MAINTENANCE PERSONNEL.
10. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
11. DETAIL FOR PE WATERMAIN TO BE AS PER THIS DETAIL. BRIDGE CROSSING PIPEWORK TO BE DI IN BOTH CASES.

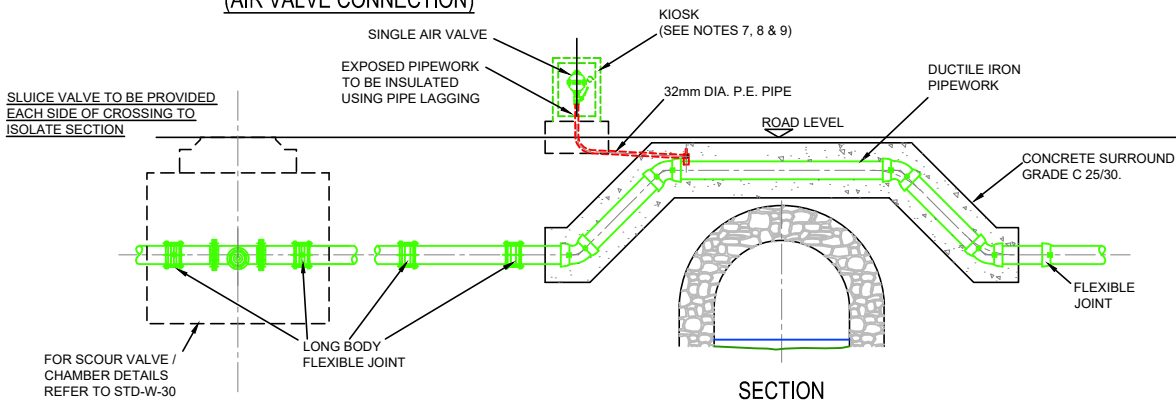

**SECTION**

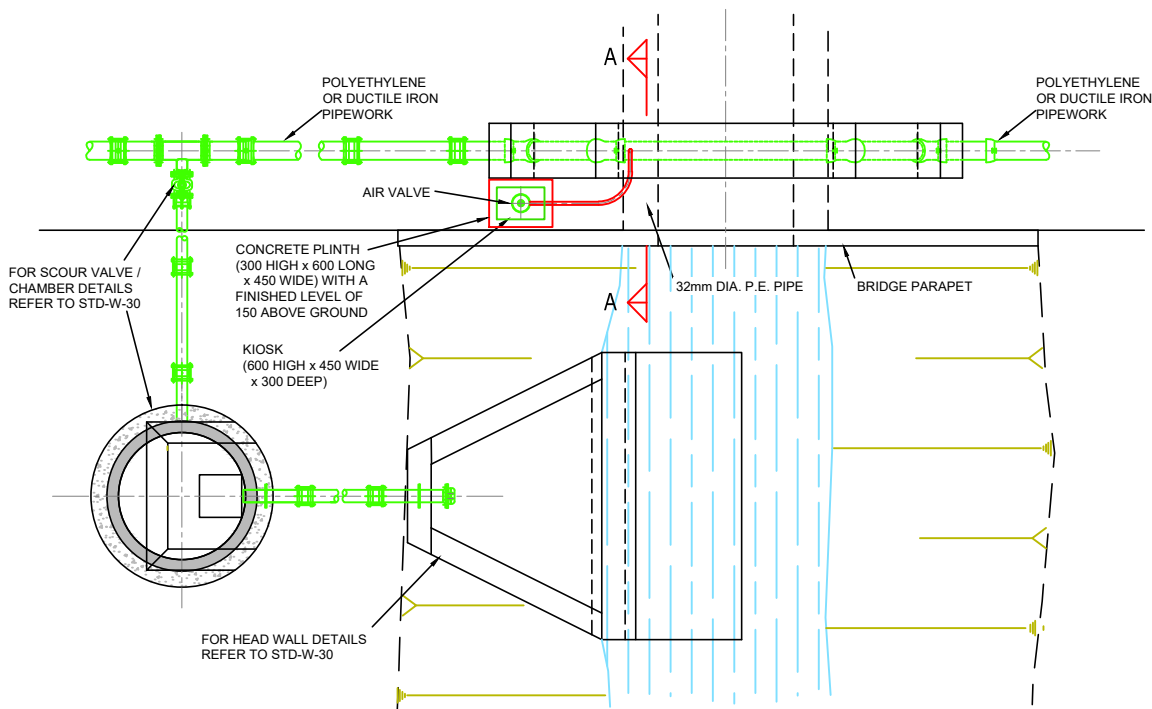

**PLAN**

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT




No.	Date	Drn	Chk	Description	App
1	11/17	JMC	TOC	Updated & added notes	MOD
0	09/15	JMC	TOC	Initial Issue	SL

STANDARD DETAILS - WATER	
TITLE	SCALE
TYPICAL BRIDGE CROSSING FOR WATER MAIN (Sheet 1 of 2)	NOT TO SCALE


DATE	REV
SEPT. 2015	
DRAWING No.	REV
STD-W-32	1




1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. O.D. REFERS TO OUTSIDE DIAMETER OF PIPES OR COLLARS.
3. BENDS AT RESPECTIVE CROSSINGS SHALL BE INDICATED ON THE LONGITUDINAL SECTION DRAWING.
4. PIPEWORK AT CROSSING POINT TO BE JOINED USING BUTT FUSION WELDING.
5. POLYETHYLENE PIPES SHALL BE WRAPPED IN PLASTIC SHEETING HAVING A COMPOSITION IN ACCORDANCE WITH BS 6076 BEFORE BEING CAST INTO CONCRETE.
6. THRUST BLOCKS TO BE PROVIDED AS PER STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
7. THE DEVELOPER IS TO SEEK ADVICE FROM IRISH WATER AS TO WHETHER A DUPLICATE MAIN IS TO BE PROVIDED AT THE BRIDGE CROSSING. IF NECESSARY THE DEVELOPER IS TO SUBMIT A DESIGN TO IRISH WATER FOR REVIEW.
8. BACKFILL AND REINSTATEMENT REQUIREMENTS OF THE RIVER BED AND BANK IS SUBJECT TO AGREEMENT WITH RELEVANT AUTHORITY & IRISH WATER.
9. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
10. ALL DUCTILE IRON PIPEWORK TO BE IN ACCORDANCE WITH IS EN 545. ALL POLYETHYLENE PIPEWORK TO BE IN ACCORDANCE WITH IS EN 12201.
11. PIPEWORK FOR WATERMAIN CAN BE EITHER DUCTILE IRON OR POLYETHYLENE. PIPEWORK AT THE CROSSING POINT TO BE PE IN BOTH CASES.

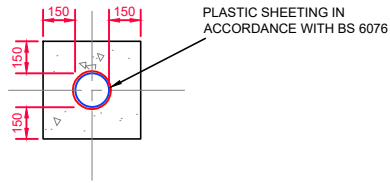

**CROSS SECTION  
(CONCRETE SURROUND)**

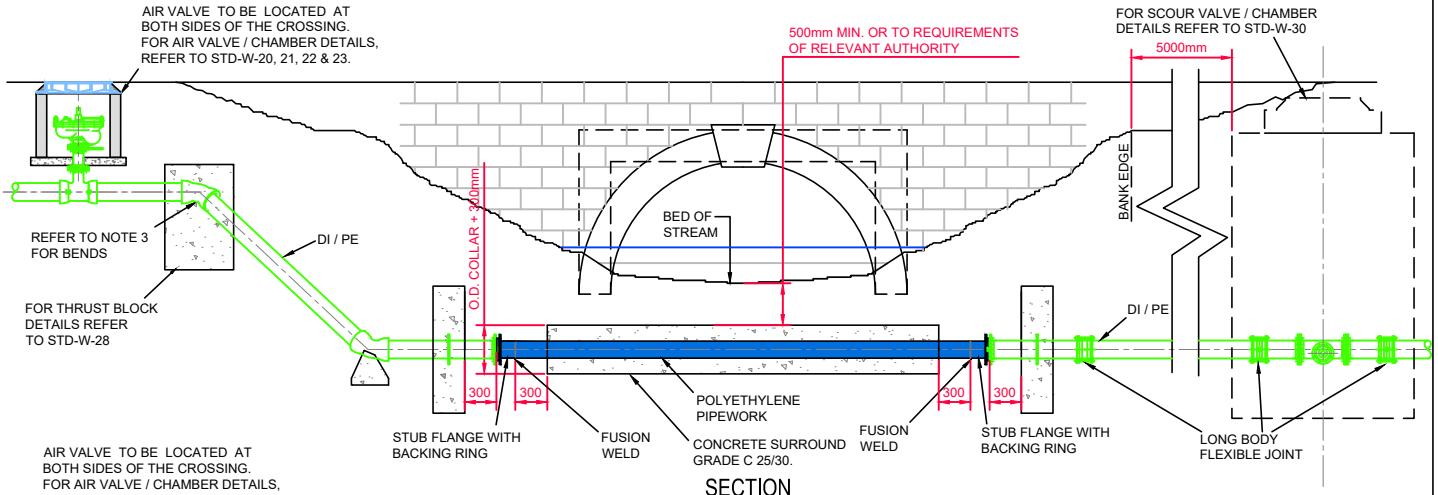


**SECTION**

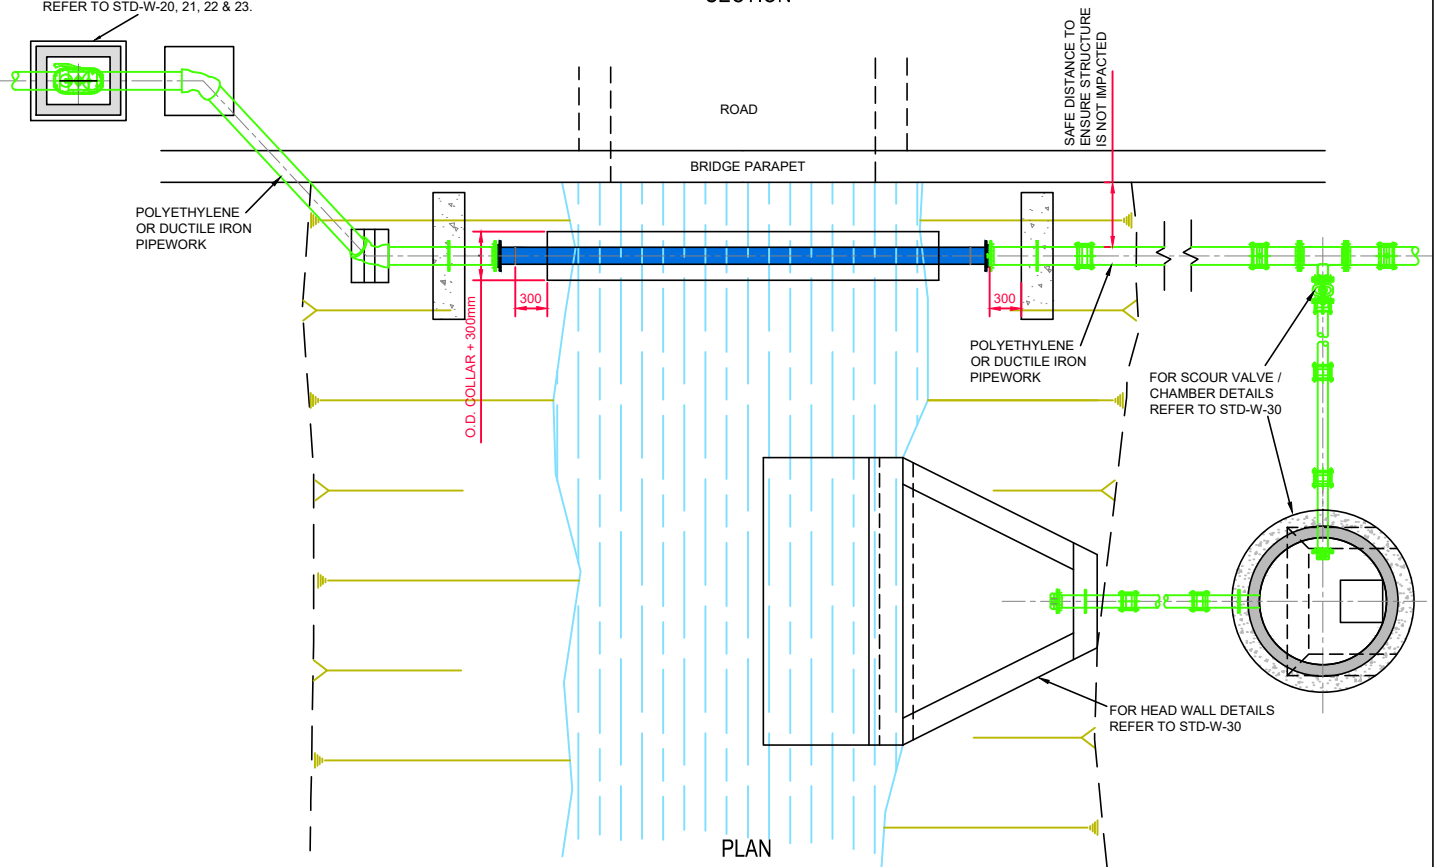

**PLAN**




REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

						<b>STANDARD DETAILS - WATER</b>		SCALE NOT TO SCALE	DATE SEPT. 2015
						TITLE		DRAWING No.	REV
						TYPICAL BRIDGE CROSSING FOR WATER MAIN (Sheet 2 of 2)		STD-W- 33	2
	2	07/20	RH	TOC	Drawing reference edits	MOD			
1	11/17	JMC	TOC	Notes added & updated	MOD				
0	09/15	JMC	TOC	Initial Issue	SL				
No.	Date	Drm	Chk	Description	App				


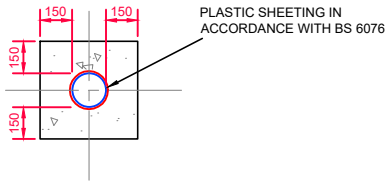


**CROSS SECTION  
(CONCRETE SURROUND)**


1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. O.D. REFERS TO OUTSIDE DIAMETER OF PIPES OR COLLARS.
3. BENDS AT RESPECTIVE CROSSINGS SHALL BE INDICATED ON THE LONGITUDINAL SECTION DRAWING.
4. PIPEWORK AT CROSSING POINT TO BE JOINED USING BUTT FUSION WELDING.
5. POLYETHYLENE PIPES SHALL BE WRAPPED IN PLASTIC SHEETING HAVING A COMPOSITION IN ACCORDANCE WITH BS 6076 BEFORE BEING CAST INTO CONCRETE.
6. THRUST BLOCKS TO BE PROVIDED AS PER STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
7. THE DEVELOPER IS TO SEEK ADVICE FROM IRISH WATER AS TO WHETHER A DUPLICATE MAIN IS TO BE PROVIDED AT THE CROSSING. IF NECESSARY THE DEVELOPER IS TO SUBMIT A DESIGN TO IRISH WATER FOR REVIEW.
8. BACKFILL AND REINSTATEMENT REQUIREMENTS OF THE RIVER BED AND BANK IS SUBJECT TO AGREEMENT WITH RELEVANT AUTHORITY & IRISH WATER.
9. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
10. ALL DUCTILE IRON PIPEWORK TO BE IN ACCORDANCE WITH IS EN 545. ALL POLYETHYLENE PIPEWORK TO BE IN ACCORDANCE WITH IS EN 12201.
11. PIPEWORK FOR WATERMAIN CAN BE EITHER DUCTILE IRON OR POLYETHYLENE. PIPEWORK AT THE CROSSING POINT TO BE PE IN BOTH CASES.

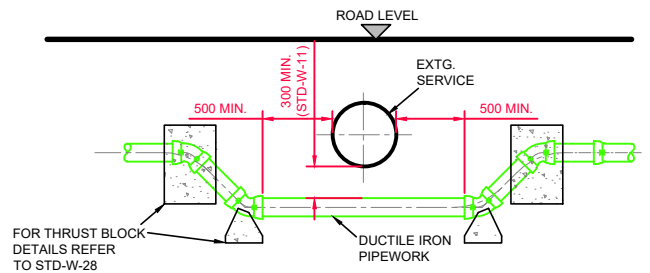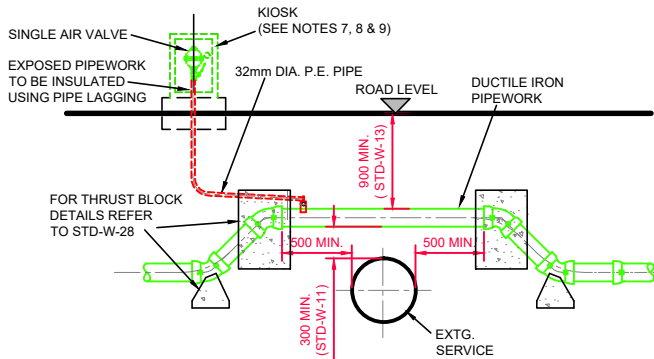

**DETAIL 1  
(WATERMAIN CROSSING  
OVER EXISTING SERVICES)**



**DETAIL 2  
(WATERMAIN CROSSING  
UNDER EXISTING SERVICES)**




P.E. TO D.I. OPTION

P.E. TO D.I. OPTION


P.E. TO D.I. OPTION

P.E. TO D.I. OPTION

**DUCTILE IRON DETAIL**

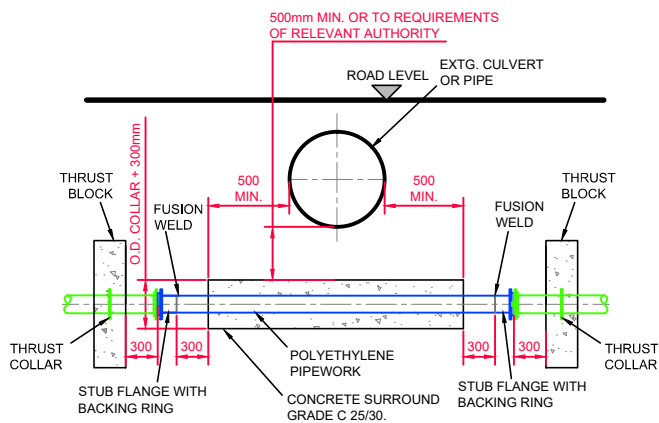

**DETAIL 3  
(WATERMAIN CROSSING UNDER  
EXTG. SERVICE / CULVERT / PIPE)**

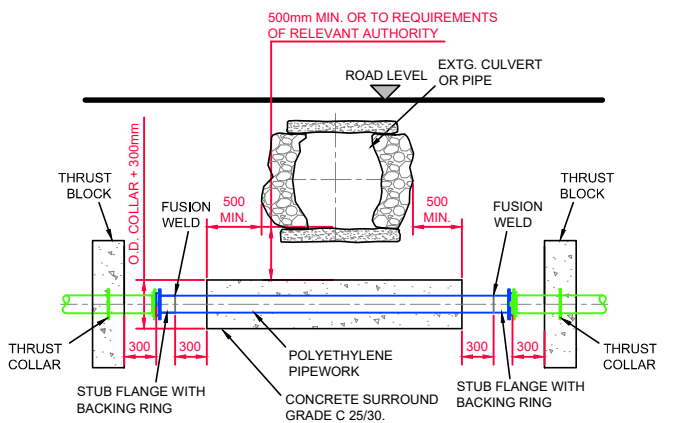

**DETAIL 4  
(WATERMAIN CROSSING  
UNDER EXTG. CULVERT)**

NOTE:  
IN SITUATIONS WHERE PE PIPEWORK IS  
UTILISED EITHER SIDE OF THE CROSSING,  
THRUST BLOCKS AND THRUST COLLARS ARE  
NOT REQUIRED.

**POLYETHYLENE DETAIL**


NOTE:  
IN SITUATIONS WHERE PE PIPEWORK IS  
UTILISED EITHER SIDE OF THE CROSSING,  
THRUST BLOCKS AND THRUST COLLARS ARE  
NOT REQUIRED.

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

	<p>0 07/20 RH TOC Initial Issue MOD</p>					<p><b>STANDARD DETAILS - WATER</b></p>		<p>SCALE NOT TO SCALE</p>	<p>DATE SEPT. 2018</p>
	<p>No. Date Dm Chk Description App</p>					<p>TITLE <b>TYPICAL CULVERT &amp; SERVICES CROSSING DETAILS FOR WATER MAIN</b></p>		<p>DRAWING No. <b>STD-W-33A</b></p>	<p>REV <b>0</b></p>

2.5mm THK. x 17 No. PALINGS WELDED. CONSTRUCTED TO BS EN 1722-12-2016 FILLET WELDED PALES, GALVANISED & PVC COATED TO BS EN 1722-12-2016


PALES TO BE WELDED TO 50x50x5 RAILS.

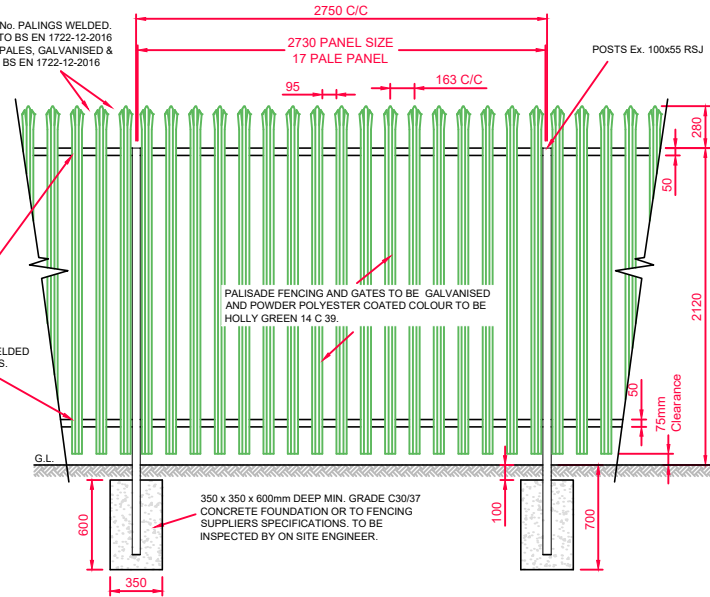


PANEL - ELEVATION

2.5mm THK. x 17 No. PALINGS WELDED. CONSTRUCTED TO BS EN 1722-12-2016 FILLET WELDED PALES, GALVANISED & PVC COATED TO BS EN 1722-12-2016


PALES TO BE WELDED TO 50x50x5 HORIZONTAL RAILS.

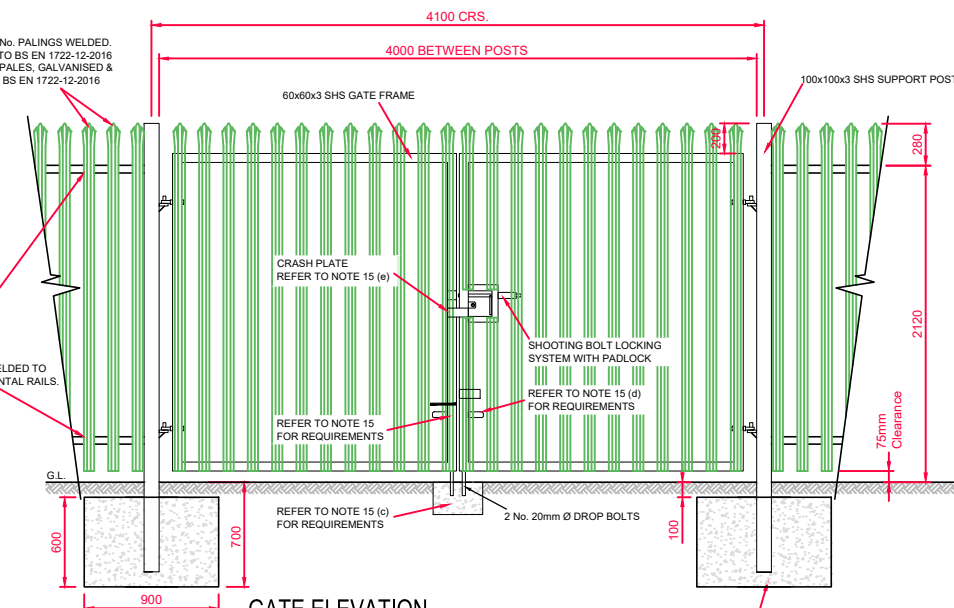

GATE ELEVATION

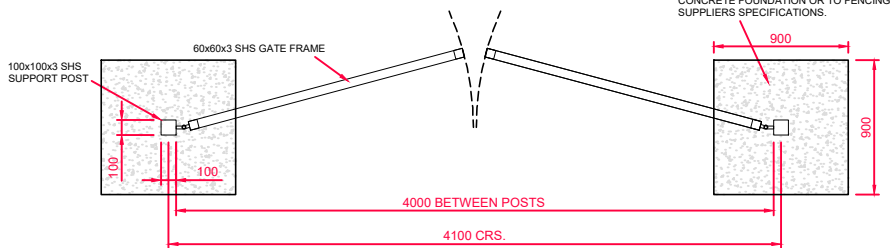

PLAN

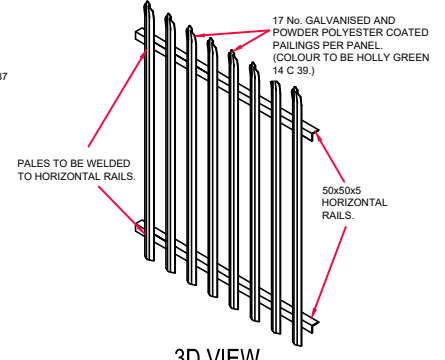

3D VIEW

1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. SECURITY FENCING SHALL COMPRISE 2.4m HIGH, CORROSION RESISTANT MILD STEEL FENCING, GALVANISED AND PLASTIC COATED FINISHED, WITH SIMILAR TYPE ACCESS GATES.
3. THE ACCESS GATES SHALL BE OF SUFFICIENT WIDTH TO ACCOMMODATE MAINTENANCE VEHICLES, TANKERS, ETC. THE SECURITY GATES SHALL BE PROVIDED WITH SLIDE BOLTS, SHOOTING BOLTS AND PADLOCKS. IF OPENING OUTWARDS, THE ACCESS GATES SHALL BE SET BACK FROM PARKING AND ACCESS AREAS BY THE WIDTH OF THE LEAF OF THE GATE. BOLTS - UNLESS TAMPER RESISTANT FIXINGS ARE USED, ALL BOLTS TO THE ACCESS GATES & FENCING SHALL BE BURRED OVER.
4. GATE HINGES SHALL BE DESIGNED SO THAT IT IS IMPOSSIBLE TO REMOVE THE GATE BY LIFTING WHEN IT IS IN A CLOSED & LOCKED POSITION. DROP BOLTS SHALL BE FITTED TO EACH GATE LEAF IN SUCH A WAY THAT THEY CANNOT BE REMOVED BUT ALLOW THE GATE TO BE SECURED IN BOTH THE OPEN & CLOSED POSITION.
5. THE SECURITY RATING SHALL BE EITHER BASIC +, ENHANCED OR ENHANCED +. THE FENCE STANDARD WILL BE BASED ON THE SECURITY RATING OF THE SITE & IS TO BE AGREED WITH IRISH WATER.
6. CORNER BRACING AND POST DETAIL TO MANUFACTURER'S SPECIFICATION.
7. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
8. ALL FENCE MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH IS EN 1722-14 : 2006.
9. DIMENSIONS OF GATE PILLARS, GATE FRAME, FENCE PILLARS, FENCE RUNNERS, DIAGONALS, ETC. TO BE MANUFACTURER'S SPECIFICATION.
10. FENCE/GATE DESIGN AND DETAILS TO BE PROVIDED TO IRISH WATER FOR REVIEW / VETTING BEFORE MANUFACTURE.
11. PEDESTRIAN GATE SHALL BE PROVIDED IF DEEMED NECESSARY BY IRISH WATER.
12. COLOUR TO BE HOLLY GREEN 14 C 39 IN ACCORDANCE WITH BS 4800:2011.
13. A 300mm WIDE x 150mm DEEP CONCRETE SILL (IF REQUIRED BY IRISH WATER) GRADE C20/25 CONCRETE SHALL BE PROVIDED TO IRISH WATER'S REQUIREMENTS (ENHANCED + SECURITY RATING ONLY).
14. THE GATES SHALL HAVE THE FOLLOWING SECURITY FEATURES:
  - a. GATE LOCKING MECHANISM SHALL INCLUDE A SHROUD COVER PROTECTING THE PADLOCK FROM ATTACK AND THE SLIP BOLT SHALL BE OF HIGH CARBON STEEL - TECHNICAL SPECIFICATION TO BE INCLUDED IN THE DESIGN SUBMISSION FOR REVIEW / VETTING BEFORE MANUFACTURE.
  - b. DROP BOLTS SHALL BE FITTED TO EACH GATE LEAF IN SUCH A WAY THAT THEY CANNOT BE REMOVED BUT ALLOW THE GATE TO BE SECURED IN BOTH THE OPEN POSITION, AND USING ONE OF THE DROP BOLTS TO LOCK IN A CLOSED POSITION.
  - c. DROP BOLTS SHALL BE A MINIMUM OF 650MM IN LENGTH WITH 50MM CONTAINED IN A STEEL RETAINER IMBEDDED IN CONCRETE, PROTECTING AGAINST FORCED ATTACK OF THE GATE.
  - d. THE DESIGN SHALL INCLUDE A METAL STAY ATTACHED TO THE LEAF 2 TO PREVENT THE DROP BOLT FROM BEING ACTIVATED ON LEAF 1 WHILE THE GATE IS IN A LOCKED POSITION AND TO ENSURE THAT THE GATE CANNOT BE LOCKED BY AN OPERATOR UNLESS A DROP BOLT IS ENGAGED IN A RECEIVER.
  - e. A CRASH PLATE SHALL BE INSTALLED ON LEAF 1 TO PREVENT LEAF 2 FROM SWINGING PAST THE CLOSE POINT OF THE GATE. THE CRASH PLATE SHALL IN ADDITION BE INSTALLED SUCH THAT IT PROVIDES RESTRICTED ACCESS TO THE SLIDE BOLT, IMPEDING ATTEMPTS OF CUTTING OF SAME.
  - f. BRACKETS ATTACHING FENCE PANELS TO FENCE POST TO BE CONSTRUCTED OF 5MM STEEL WITH TAMPER PROOF CONNECTIONS


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



0	07/20	RH	TOC	Initial Issue	MOD
No.	Date	Drm	Chk	Description	App


STANDARD DETAILS - WATER	
TITLE	SECURITY GATE AND FENCING PALISADE OPTION (PREFERRED)

SCALE	NOT TO SCALE	DATE	SEPT. 2019
DRAWING No.	STD-W- 34	REV	0

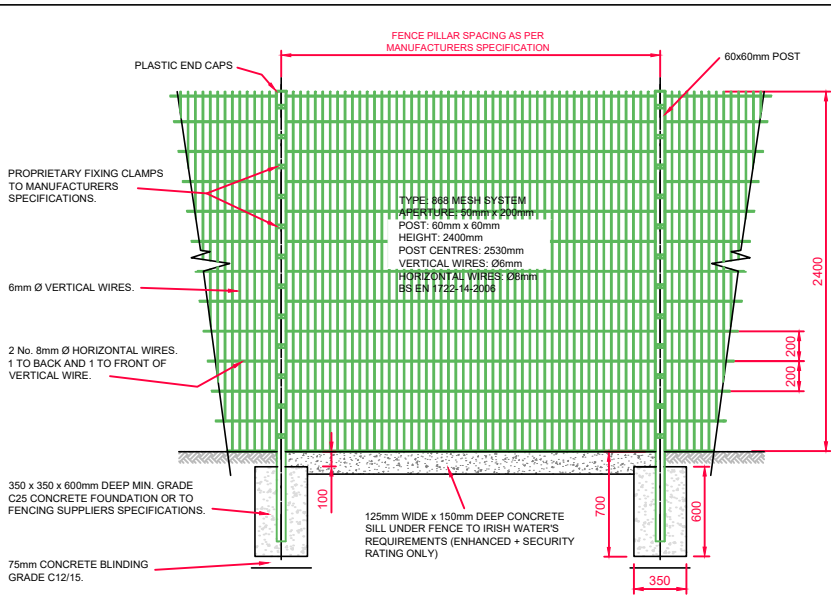


1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. SECURITY FENCING SHALL COMPRISE 2.4m HIGH, CORROSION RESISTANT MILD STEEL FENCING, GALVANISED AND PLASTIC COATED FINISHED, WITH SIMILAR TYPE ACCESS GATES.
3. THE ACCESS GATES SHALL BE OF SUFFICIENT WIDTH TO ACCOMMODATE MAINTENANCE VEHICLES, TANKERS, ETC. THE SECURITY GATES SHALL BE PROVIDED WITH SLIDE BOLTS, SHOOTING BOLTS AND PADLOCKS. IF OPENING OUTWARDS, THE ACCESS GATES SHALL BE SET BACK FROM PARKING AND ACCESS AREAS BY THE WIDTH OF THE LEAF OF THE GATE.
4. BOLTS - UNLESS TAMPER RESISTANT FIXINGS ARE USED, ALL BOLTS TO THE ACCESS GATES & FENCING SHALL BE BURIED OVER.
5. GATE HINGES SHALL BE DESIGNED SO THAT IT IS IMPOSSIBLE TO REMOVE THE GATE BY LIFTING WHEN IT IS IN A CLOSED & LOCKED POSITION. DROP BOLTS SHALL BE FITTED TO EACH GATE LEAF IN SUCH A WAY THAT THEY CANNOT BE REMOVED BUT ALLOW THE GATE TO BE SECURED IN BOTH THE OPEN & CLOSED POSITION.
6. THE SECURITY RATING SHALL BE EITHER BASIC +, ENHANCED OR ENHANCED +. THE FENCE STANDARD WILL BE BASED ON THE SECURITY RATING OF THE SITE & IS TO BE AGREED WITH IRISH WATER.
7. CORNER BRACING AND POST DETAIL TO MANUFACTURER'S SPECIFICATION.
8. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
9. ALL FENCE MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH IS EN 1722-14:2006.
10. DIMENSIONS OF GATE PILLARS, GATE FRAME, FENCE PILLARS, FENCE RUNNERS, DIAGONALS, ETC. TO BE TO MANUFACTURER'S SPECIFICATION.
11. FENCE/GATE DESIGN AND DETAILS TO BE PROVIDED TO IRISH WATER FOR REVIEW/VETTING BEFORE MANUFACTURE.
12. PEDESTRIAN GATE SHALL BE PROVIDED IF DEEMED NECESSARY BY IRISH WATER.
13. COLOUR TO BE HOLLY GREEN 14 C 39 IN ACCORDANCE WITH BS 4800:2011.
14. A 300mm WIDE x 150mm DEEP CONCRETE SILL (IF REQUIRED BY IRISH WATER) GRADE C20/25 CONCRETE SHALL BE PROVIDED TO IRISH WATER'S REQUIREMENTS (ENHANCED + SECURITY RATING ONLY).
15. THE GATES SHALL HAVE THE FOLLOWING SECURITY FEATURES:
  - a. GATE LOCKING MECHANISM SHALL INCLUDE A SHROUD COVER PROTECTING THE PADLOCK FROM ATTACK AND THE SLIP BOLT SHALL BE OF HIGH CARBON STEEL - TECHNICAL SPECIFICATION TO BE INCLUDED IN THE TENDER SUBMISSION FOR REVIEW / VETTING BEFORE MANUFACTURE.
  - b. DROP BOLTS SHALL BE FITTED TO EACH GATE LEAF IN SUCH A WAY THAT THEY CANNOT BE REMOVED BUT ALLOW THE GATE TO BE SECURED IN BOTH THE OPEN POSITION, AND USING ONE OF THE DROP BOLTS TO LOCK IN A CLOSED POSITION.
  - c. DROP BOLTS SHALL BE A MINIMUM OF 650MM IN LENGTH WITH 50MM CONTAINED IN A STEEL RETAINER IMBEDDED IN CONCRETE, PROTECTING AGAINST FORCED ATTACK OF THE GATE.
  - d. THE DESIGN SHALL INCLUDE A METAL STAY ATTACHED TO THE LEAF 2 TO PREVENT THE DROP BOLT FROM BEING ACTIVATED ON LEAF 1 WHILE THE GATE IS IN A LOCKED POSITION AND TO ENSURE THAT THE GATE CANNOT BE LOCKED BY AN OPERATOR UNLESS A DROP BOLT IS ENGAGED IN A RECEIVER.
  - e. A CRASH PLATE SHALL BE INSTALLED ON LEAF 1 TO PREVENT LEAF 2 FROM SWINGING PAST THE CLOSE POINT OF THE GATE. THE CRASH PLATE SHALL IN ADDITION BE INSTALLED SUCH THAT IT PROVIDES RESTRICTED ACCESS TO THE SLIDE BOLT, IMPEDING ATTEMPTS OF CUTTING OF SAME.
  - f. BRACKETS ATTACHING FENCE PANELS TO FENCE POST TO BE CONSTRUCTED OF 5MM STEEL WITH TAMPER PROOF CONNECTIONS

SECURITY RATING	MESH SPACING A x B	BAR THICKNESS	HEIGHT	ADDITIONAL FEATURES
BASIC +	200 x 50	Type: 868	2.4m	ANTI-CLIMB
ENHANCED	200 x 50	Type: 868	2.4m	ANTI-CLIMB
ENHANCED +	200 x 50	Type: 868	2.4m	ANTI-CLIMB & ANTI-BURROW

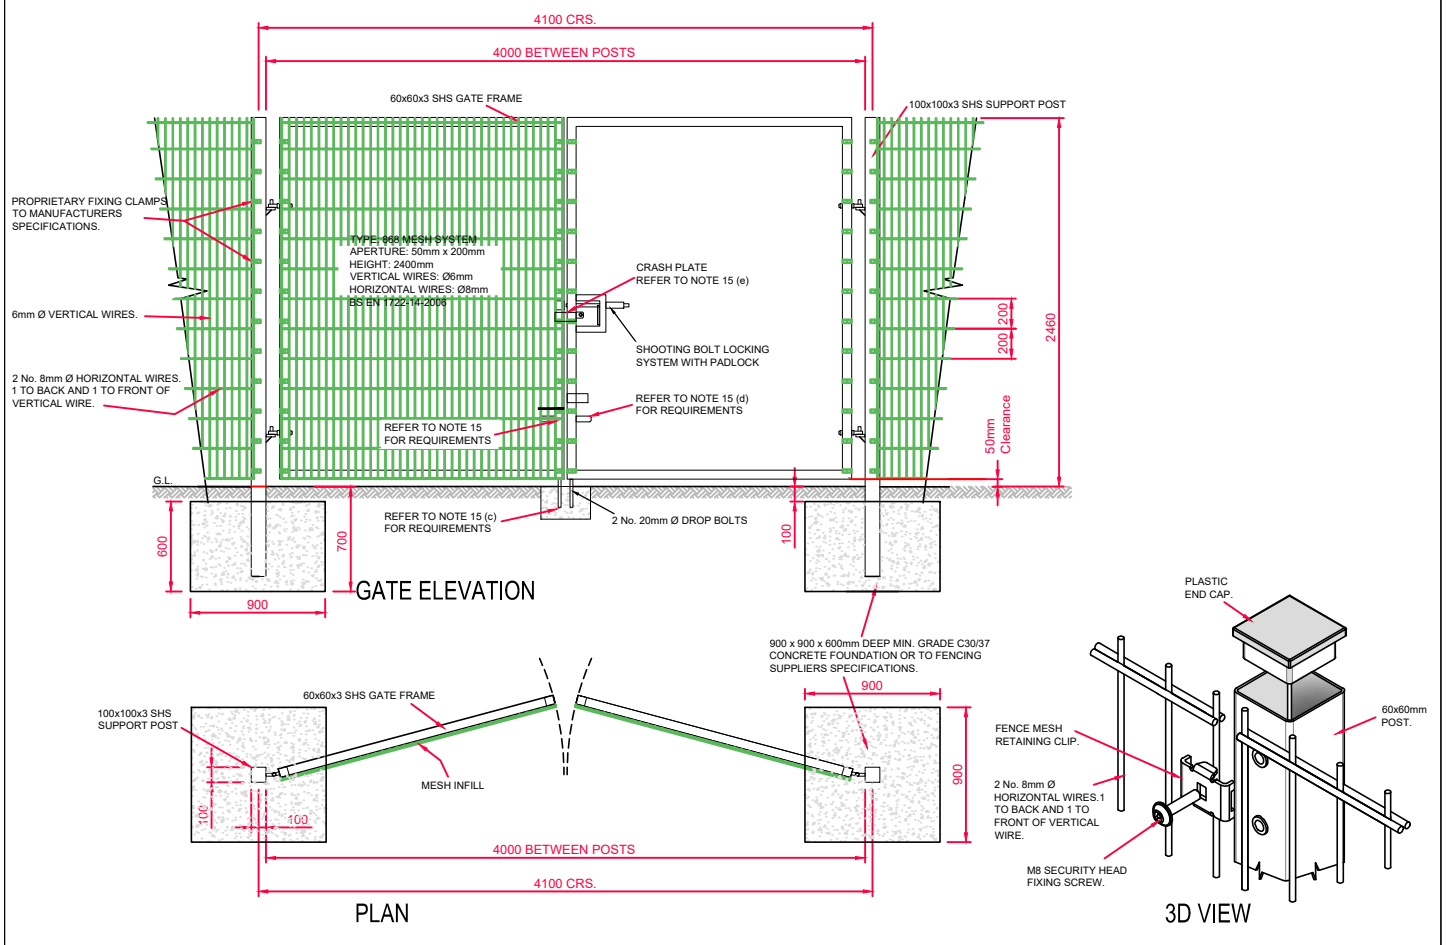


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT


	<p>STANDARD DETAILS - WATER</p>					SCALE	DATE																													
	<p>TITLE</p>					NOT TO SCALE	SEPT. 2015																													
	<p>SECURITY GATE AND FENCING WIRE MESH OPTION</p>					DRAWING No.	REV																													
<table border="1"> <thead> <tr> <th>No.</th> <th>Date</th> <th>Drn</th> <th>Chk</th> <th>Description</th> <th>App</th> </tr> </thead> <tbody> <tr> <td>3</td> <td>07/20</td> <td>RH</td> <td>TOC</td> <td>Infill mesh updated</td> <td>MOD</td> </tr> <tr> <td>2</td> <td>11/17</td> <td>JMC</td> <td>TOC</td> <td>Fencing table updated</td> <td>MOD</td> </tr> <tr> <td>1</td> <td>08/16</td> <td>JMC</td> <td>TOC</td> <td>Revised notes &amp; table</td> <td>MOD</td> </tr> <tr> <td>0</td> <td>09/15</td> <td>JMC</td> <td>TOC</td> <td>Initial Issue</td> <td>SL</td> </tr> </tbody> </table>					No.	Date	Drn	Chk	Description	App	3	07/20	RH	TOC	Infill mesh updated	MOD	2	11/17	JMC	TOC	Fencing table updated	MOD	1	08/16	JMC	TOC	Revised notes & table	MOD	0	09/15	JMC	TOC	Initial Issue	SL	<p>STD-W-34A</p>	<p>3</p>
No.	Date	Drn	Chk	Description	App																															
3	07/20	RH	TOC	Infill mesh updated	MOD																															
2	11/17	JMC	TOC	Fencing table updated	MOD																															
1	08/16	JMC	TOC	Revised notes & table	MOD																															
0	09/15	JMC	TOC	Initial Issue	SL																															

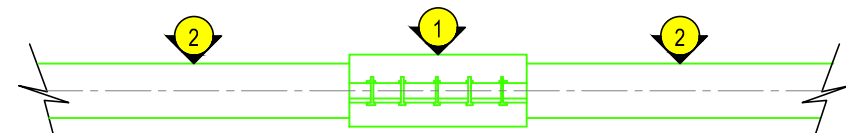


TYPE 1 REPAIR  
COUPLING CLAMP FOR  
DI, uPVC, ST AND CI

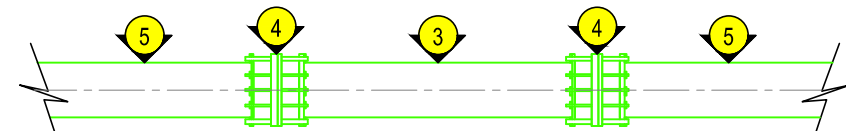


TYPE 2 REPAIR  
REPLACEMENT SECTION OF  
CAST IRON / DUCTILE IRON

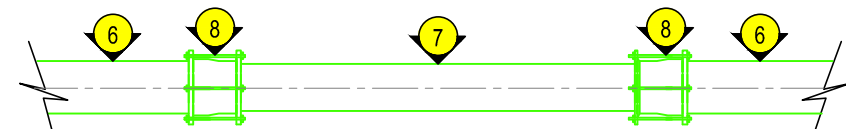

TYPE 3 REPAIR  
REPLACEMENT  
ASBESTOS CEMENT PIPE

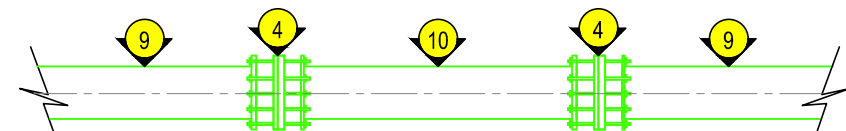

TYPE 4 REPAIR  
REPLACEMENT SECTION FOR  
uPVC MAIN

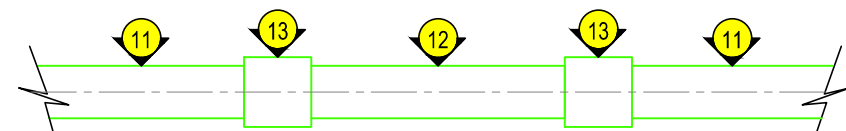

TYPE 5 REPAIR  
REPLACEMENT SECTION OF  
PE MAIN


**LEGEND:**

1. STAINLESS STEEL WRAP AROUND CLAMP (GRADE 1.4571), ELASTOMER RUBBER GASKET WITH VULCANIZED REINFORCEMENT SHEET OF STAINLESS STEEL.
2. EXISTING ST / uPVC/ DI OR CI PIPE.
3. REPLACEMENT SECTION (MINIMUM 1.0 M ) OF PLAIN ENDED DUCTILE IRON PIPE.
4. MULTI FIT UNIVERSAL COUPLING.
5. EXISTING CAST IRON OR DUCTILE IRON PIPE.
6. EXISTING ASBESTOS MAIN.
7. REPLACEMENT OF FULL SECTION OF AC MAIN WITH A FULL LENGTH OF AN ALTERNATIVE IRISH WATER APPROVED PIPE MATERIAL.
8. SPECIAL TRANSITIONAL COUPLER (TO FIT TURNED END OF AC PIPE).
9. EXISTING PVC MAIN.
10. REPLACEMENT SECTION OF AN ALTERNATIVE IRISH WATER APPROVED PIPE MATERIAL (MINIMUM 1.0m) CUT TO LENGTH.
11. EXISTING PE PIPE.
12. REPLACEMENT SECTION OF PE PIPE.
13. FUSION WELDED COUPLING.
14. PIPE MATERIAL REFERENCES AS FOLLOWS:  
AC - ASBESTOS CEMENT.  
DI - DUCTILE IRON.  
CI - CAST IRON.  
PE - POLYETHYLENE.  
uPVC - UNPLASTICISED POLY VINYL CHLORIDE.  
ST - STEEL.
15. REPAIRS TO EXISTING WATER MAINS THAT ARE IN OWNERSHIP OF IRISH WATER SHALL BE CARRIED OUT BY IRISH WATER OR AN AGENT OF IRISH WATER.
16. REPAIRS TO EXISTING WATER MAINS TO BE CARRIED OUT BY CONTRACTORS WHO ARE DEEMED COMPETENT BY IRISH WATER TO CARRY OUT SUCH REPAIRS. THESE REPAIRS SHALL BE CARRIED OUT IN ACCORDANCE WITH AN AGREED METHOD STATEMENT, SAFETY AND HEALTH PLAN AND HYGIENE PLAN.
17. A HIGH LEVEL OF HEALTH & SAFETY PROCEDURES IS REQUIRED WHEN WORKING ON AC MAINS, & THE OPERATION OF DISMANTLING/ REMOVAL OF AC PIPES & JOINTS.


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

							STANDARD DETAILS - WATER		SCALE NOT TO SCALE	DATE SEPT. 2015
							TITLE	DRAWING No.		REV
							PIPE REPAIR TO EXISTING MAINS	STD-W- 35		2
	2	11/17	JMC	TOC	Updated Note 10	MOD				
	1	08/16	JMC	TOC	Added Note 17	MOD				
0	09/15	JMC	TOC	Initial Issue	SL					
No.	Date	Drm	Chk	Description	App					


- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- THE KIOSK SHALL BE LOCATED OFF THE FOOTPATH SO AS NOT TO IMPEDE PEDESTRIANS AND POSITIONED SO AS TO FACILITATE SAFE ACCESS FOR MAINTENANCE PERSONNEL.
- KIOSK TO BE CONSTRUCTED FROM THERMOSETTING U.V. & WEATHER RESISTANT PLASTIC POWDER COATED & HOT DIPPED GALVANISED STEEL (MINIMUM 3mm THICKNESS) IN ACCORDANCE WITH BS EN 1461. STAINLESS STEEL MAY BE USED AS AN ALTERNATIVE KIOSK MATERIAL, PARTICULARLY IN SEVERE ENVIRONMENTS, SUBJECT TO AGREEMENT WITH IRISH WATER.
- KIOSK TO HAVE SINGLE OR DOUBLE STEEL/GRP DOORS WITH MULTIPLE LOCKS TO LPS 1175 SR3 OR EN 1627. MINIMUM DOUBLE LOCKS WITH BOLTS THAT ENGAGE INTO THE SILL & HEADER AS WELL AS BETWEEN THE TWO LEAVES OR LEAF & FRAME. LEADING EDGE OF LEAVES TO HAVE EITHER REBATED EDGES OR FITTED WITH ASTRAGALS.
- COLOUR TO BE HOLLY GREEN BS 4800 14 C39. INTERIOR FINISH TO BE WHITE UNLESS APPROVED BY IRISH WATER.
- THE QUALITY OF KIOSK CONSTRUCTION SHALL ENSURE THAT THE FOLLOWING IS ACHIEVED:
  - A THERMAL TRANSMITTANCE OF 1.5W PER m<sup>2</sup>K.
  - A FIRE RESISTANCE (RETENTION OF STABILITY, INTEGRITY AND INSULATION) EQUIVALENT TO CLASS 2 OF BS 476, WHEN TESTED IN ACCORDANCE WITH BS 476 FOR A PERIOD EXCEEDING 30 MINUTES.
  - AN IP RATING OF IP55 OR EQUIVALENT.
- KIOSK TO BE BOLTED TO THE PLINTH THROUGH A BOTTOM FLANGE WITH GALVANISED MILD STEEL OR STAINLESS STEEL ANCHOR BOLTS.
- THE BOTTOM FLANGE SHALL BE SEATED ON A NEOPRENE GASKET AND SEALED WITH MASTIC.
- REAR WALL SHALL BE REINFORCED WITH STAINLESS STEEL SECTIONS TO WHICH A MARINE PLY WOOD, 18mm THICK BOARD IS FIXED.
- THE DEVELOPER SHALL BE RESPONSIBLE FOR THE ULTIMATE SIZING OF THE KIOSK TO ENSURE ADEQUATE SPACE REQUIREMENTS.
- TELEMETRY DUCTING TO BE IN ACCORDANCE WITH BS EN 50085-1:2005 AND ENATS 12-24.
- ELECTRICAL REQUIREMENTS TO BE IN ACCORDANCE WITH ESB SPECIFICATION.
- THE ROOF OF THE KIOSK SHALL BE REMOVABLE (BOLTS) TO FACILITATE BACKBOARD REMOVAL.
- ALL EXPOSED PIPEWORK TO BE ADEQUATELY INSULATED WITH PIPE LAGGING.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.

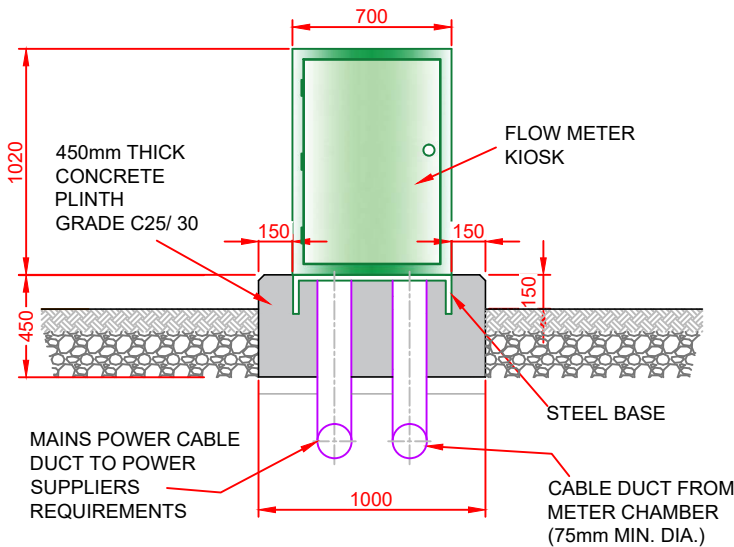

FRONT ELEVATION

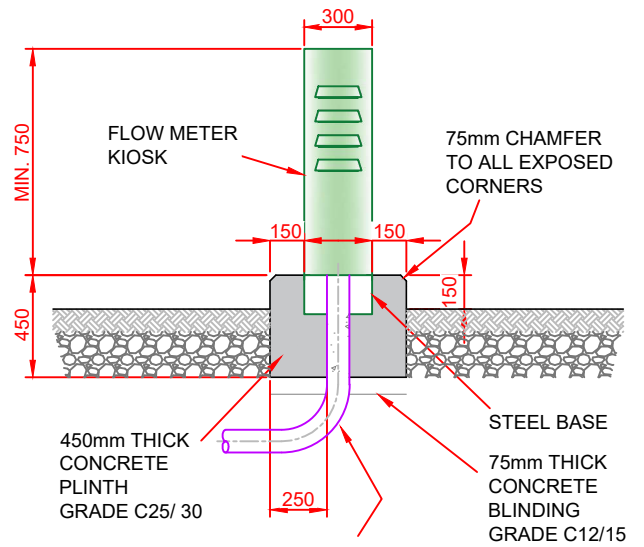

CROSS SECTION

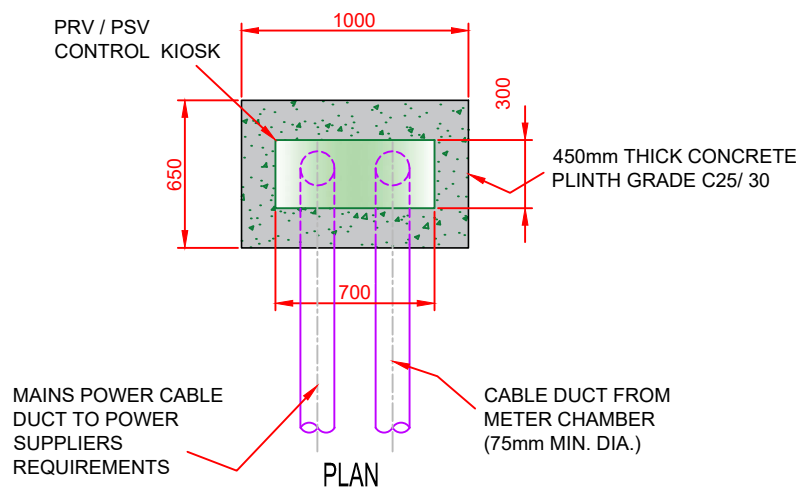


PLAN


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT

	<p style="text-align: center;"><b>STANDARD DETAILS - WATER</b></p>					SCALE	DATE
						NOT TO SCALE	SEPT. 2015
	TITLE					DRAWING No.	REV
	FLOW METER KIOSK					STD-W- 36	3
No.	Date	Drm	Chk	Description	App		
3	07/20	RH	TOC	Notes and kiosk revised	MOD		
2	11/17	JMC	TOC	Note 10 revised	MOD		
1	08/16	JMC	TOC	Added Note 4	MOD		
0	09/15	JMC	TOC	Initial Issue	SL		


- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- THE KIOSK SHALL BE LOCATED OFF THE FOOTPATH SO AS NOT TO IMPEDE PEDESTRIANS AND POSITIONED SO AS TO FACILITATE SAFE ACCESS FOR MAINTENANCE PERSONNEL.
- KIOSK TO BE CONSTRUCTED FROM THERMOSETTING U.V. & WEATHER RESISTANT PLASTIC POWDER COATED & HOT DIPPED GALVANISED STEEL (MINIMUM 3mm THICKNESS) IN ACCORDANCE WITH BS EN 1461. STAINLESS STEEL MAY BE USED AS AN ALTERNATIVE KIOSK MATERIAL, PARTICULARLY IN SEVERE ENVIRONMENTS, SUBJECT TO AGREEMENT WITH IRISH WATER.
- KIOSK TO HAVE SINGLE OR DOUBLE STEEL/GRP DOORS WITH MULTIPLE LOCKS TO LPS 1175 SR3 OR EN 1627. MINIMUM DOUBLE LOCKS WITH BOLTS THAT ENGAGE INTO THE SILL & HEADER AS WELL AS BETWEEN THE TWO LEAVES OR LEAF & FRAME. LEADING EDGE OF LEAVES TO HAVE EITHER REBATED EDGES OR FITTED WITH ASTRAGALS.
- COLOUR TO BE HOLLY GREEN BS 4800 14 C39. INTERIOR FINISH TO BE WHITE UNLESS APPROVED BY IRISH WATER.
- THE QUALITY OF KIOSK CONSTRUCTION SHALL ENSURE THAT THE FOLLOWING IS ACHIEVED:
  - A THERMAL TRANSMITTANCE OF 1.5W PER m<sup>2</sup>K.
  - A FIRE RESISTANCE (RETENTION OF STABILITY, INTEGRITY AND INSULATION) EQUIVALENT TO CLASS 2 OF BS 476, WHEN TESTED IN ACCORDANCE WITH BS 476 FOR A PERIOD EXCEEDING 30 MINUTES.
  - AN IP RATING OF IP55 OR EQUIVALENT.
- KIOSK TO BE BOLTED TO THE PLINTH THROUGH A BOTTOM FLANGE WITH GALVANISED MILD STEEL OR STAINLESS STEEL ANCHOR BOLTS.
- THE BOTTOM FLANGE SHALL BE SEATED ON A NEOPRENE GASKET AND SEALED WITH MASTIC.
- REAR WALL SHALL BE REINFORCED WITH STAINLESS STEEL SECTIONS TO WHICH A MARINE PLY WOOD, 18mm THICK BOARD IS FIXED.
- THE DEVELOPER SHALL BE RESPONSIBLE FOR THE ULTIMATE SIZING OF THE KIOSK TO ENSURE ADEQUATE SPACE REQUIREMENTS.
- TELEMETRY DUCTING TO BE IN ACCORDANCE WITH BS EN 50085-1:2005 AND EN 12-24.
- ELECTRICAL REQUIREMENTS TO BE IN ACCORDANCE WITH ESB SPECIFICATION.
- THE ROOF OF THE KIOSK SHALL BE REMOVABLE (BOLTS) TO FACILITATE BACKBOARD REMOVAL.
- ALL EXPOSED PIPEWORK TO BE ADEQUATELY INSULATED WITH PIPE LAGGING.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.

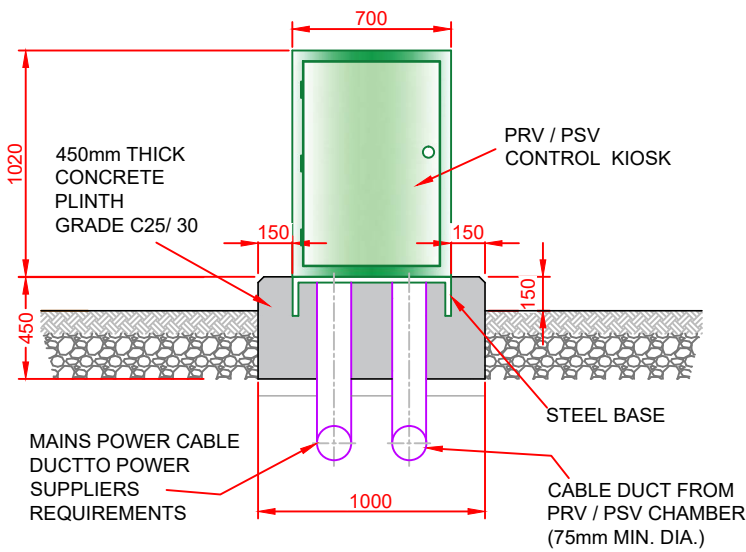

FRONT ELEVATION

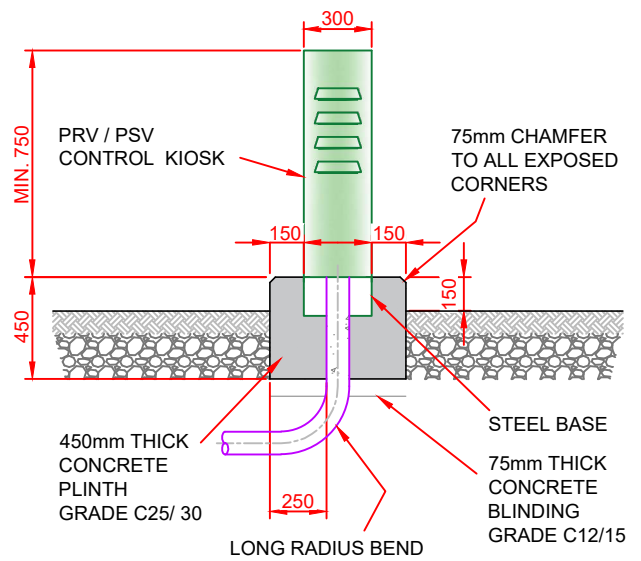

CROSS SECTION

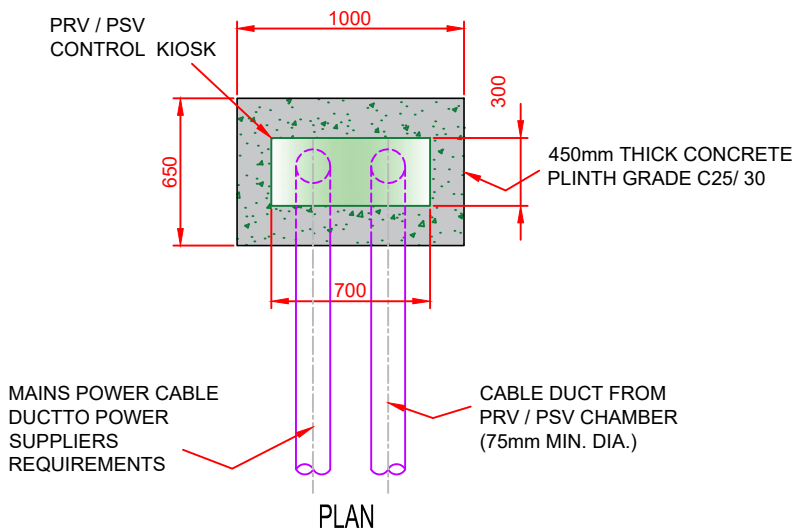

PLAN


REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT




0	07/20	RH	TOC	Initial Issue	MOD
No.	Date	Drm	Chk	Description	App

STANDARD DETAILS - WATER	
TITLE	PRV / PSV CONTROL KIOSK

SCALE NOT TO SCALE	DATE SEPT. 2019
DRAWING No. STD-W-36A	REV 0

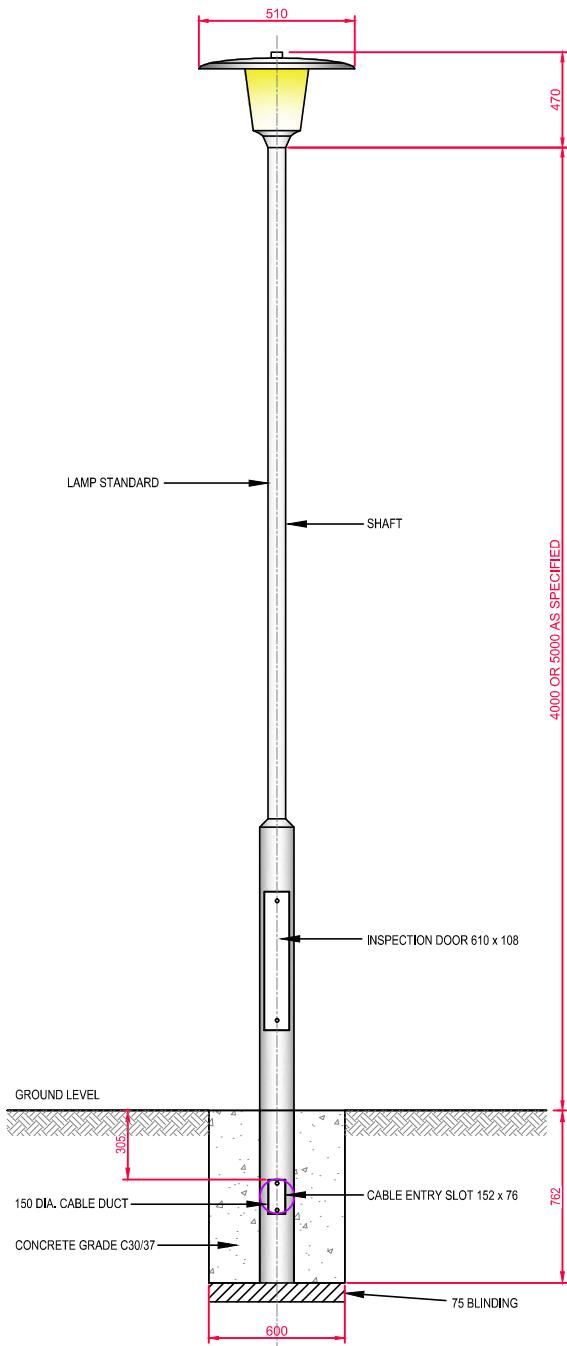


**SECTION**

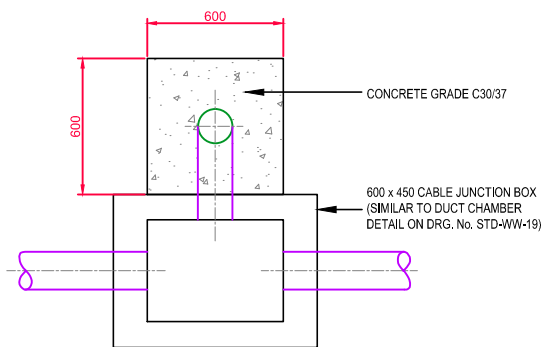


**PLAN**

**LAMP STANDARD**

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. LAMP BOLLARD TO BE REVIEWED BY IRISH WATER.
3. LAMP STANDARD TO BE REVIEWED BY IRISH WATER.
4. ELECTRICAL DUCTING TO BE IN ACCORDANCE WITH ESB SPECIFICATION.

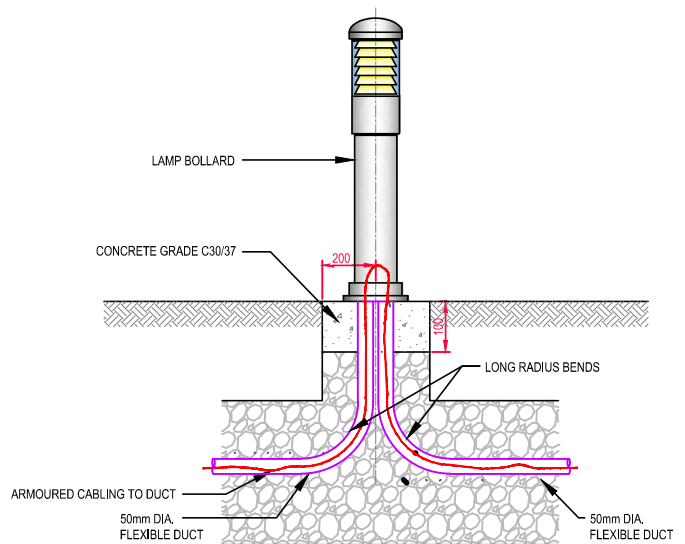

**SECTION**

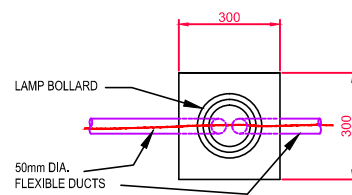

**PLAN**

**LAMP BOLLARD**

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT




No.	Date	Drm	Chk	Description	App
2	07/20	RH	TOC	Cable ducts to Lamp Bollard Revised	MOD
1	11/17	JMC	TOC	Notes updated	MOD
0	09/15	JMC	TOC	Initial Issue	SL

STANDARD DETAILS - WATER		SCALE	DATE
TITLE		NOT TO SCALE	SEPT. 2015
LAMP BOLLARD AND LAMP STANDARD		DRAWING No.	REV
		STD-W-37	2






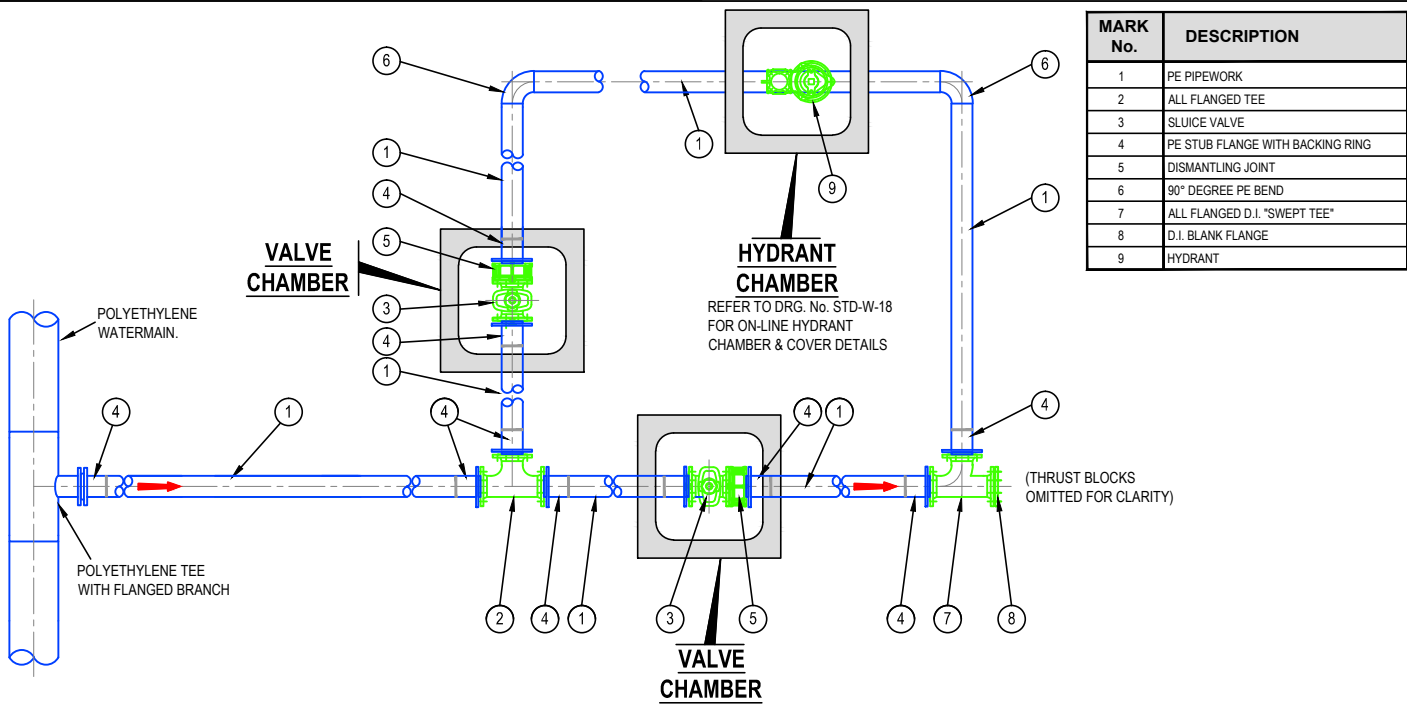

MARK No.	DESCRIPTION
1	PE PIPEWORK
2	ALL FLANGED TEE
3	SLUICE VALVE
4	PE STUB FLANGE WITH BACKING RING
5	DISMANTLING JOINT
6	90° DEGREE PE BEND
7	ALL FLANGED D.I. "SWEEP TEE"
8	D.I. BLANK FLANGE
9	HYDRANT

**PLAN SHOWING PE WATERMAIN "LOOP" ARRANGEMENT**

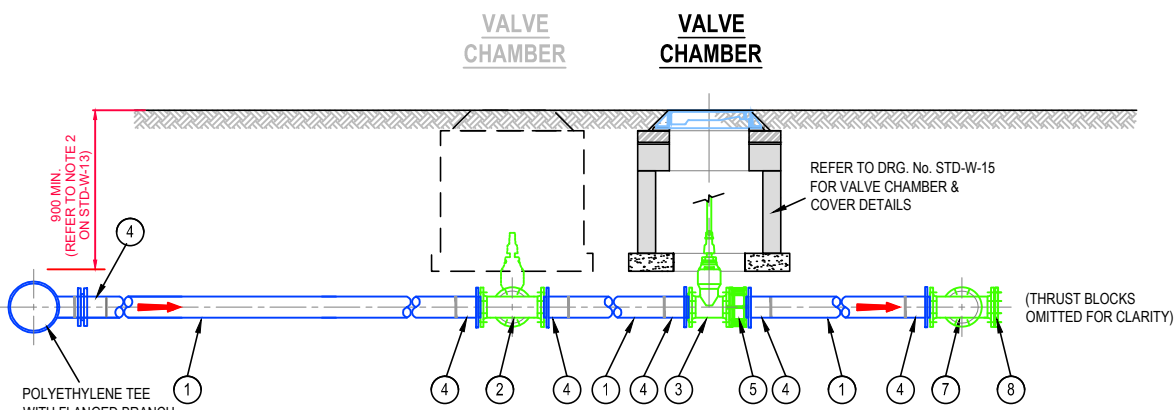

**SECTION SHOWING PE WATERMAIN "LOOP" ARRANGEMENT**

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- STRUCTURAL REINFORCEMENT AND DESIGN DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW.
- HYDRANT CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 AND BS 5834 COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
- THE HYDRANT SHALL BE DOUBLE FLANGED DRILLED TO PN 16. THEY SHALL COMPLY WITH IS EN 14339, IS EN 1074 PART 6 AND BS 750: 2012. THE HYDRANT SHALL INCORPORATE A SCREW DOWN GATE VALVE, UNDERGROUND "GUIDE TO HEAD" TYPE WITH A FALSE SPINDLE CAP. THE OUTLET SHALL BE IN ACCORDANCE WITH ITEM 5 BELOW.
- FIRE HYDRANT OUTLET TYPE SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE FIRE OFFICER FOR THE AREA AND SHALL BE AGREED PRIOR TO THE COMMENCEMENT OF WORKS.
- ALL HYDRANTS SHALL BE CLOCKWISE CLOSING.
- HYDRANT CHAMBER & SCOUR VALVE CHAMBER TO BE CONSTRUCTED OF PRECAST CONCRETE UNITS OR HIGH DENSITY BLOCKWORK. ALTERNATIVELY PROPRIETARY PREFABRICATED CHAMBER UNITS MAY ALSO BE USED, SUBJECT TO REVIEW FROM IRISH WATER. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF IN-SITU CONCRETE, GRADE C30/37, WITH A MINIMUM THICKNESS OF 150mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, SUBJECT TO IRISH WATER REVIEW, & COMPLIANCE WITH IS EN 1917 AND IS 470
- CONCRETE CHAMBERS SHALL BE SURROUNDED BY A MINIMUM OF 150mm COMPACTED CLAUSE 808 MATERIAL AS PER STD-W-13.
- 200mm ALL ROUND, 100mm DEEP CONCRETE PLINTH AROUND COVERS IN GRASS AREAS.
- THRUST BLOCKS (NOT SHOWN ON DRAWING), TO BE PROVIDED AS PER STANDARD DRAWING STD-W-28 AT ALL TEES, BENDS, TAPERS, DEAD ENDS AND PIPES AT STEEP SLOPES.
- ANTI CORROSION TAPE TO BE PROVIDED AROUND BURIED FLANGES.
- ALL PIPEWORK AND FITTINGS FOR WASHOUT HYDRANT CHAMBER CONNECTION SHALL BE DUCTILE IRON. PIPES AND FITTINGS ON MAIN LINE SHALL BE: PE PIPES & FITTINGS IN ACCORDANCE WITH IS EN 12201:2011, OR DUCTILE IRON PIPES AND FITTINGS IN ACCORDANCE WITH IS EN 545.
- ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO AGREEMENT WITH IRISH WATER.
- ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT




0	07/20	RH	TOC	Initial Issue	MOD
No.	Date	Drn	Chk	Description	App

STANDARD DETAILS - WATER	
TITLE	WATERMAIN LOOP DETAIL POLYETHYLENE OPTION

SCALE	DATE
NOT TO SCALE	SEPT. 2019
DRAWING No.	REV
STD-W- 39	0

1. FOR NOTES REFER TO STD-WW-13

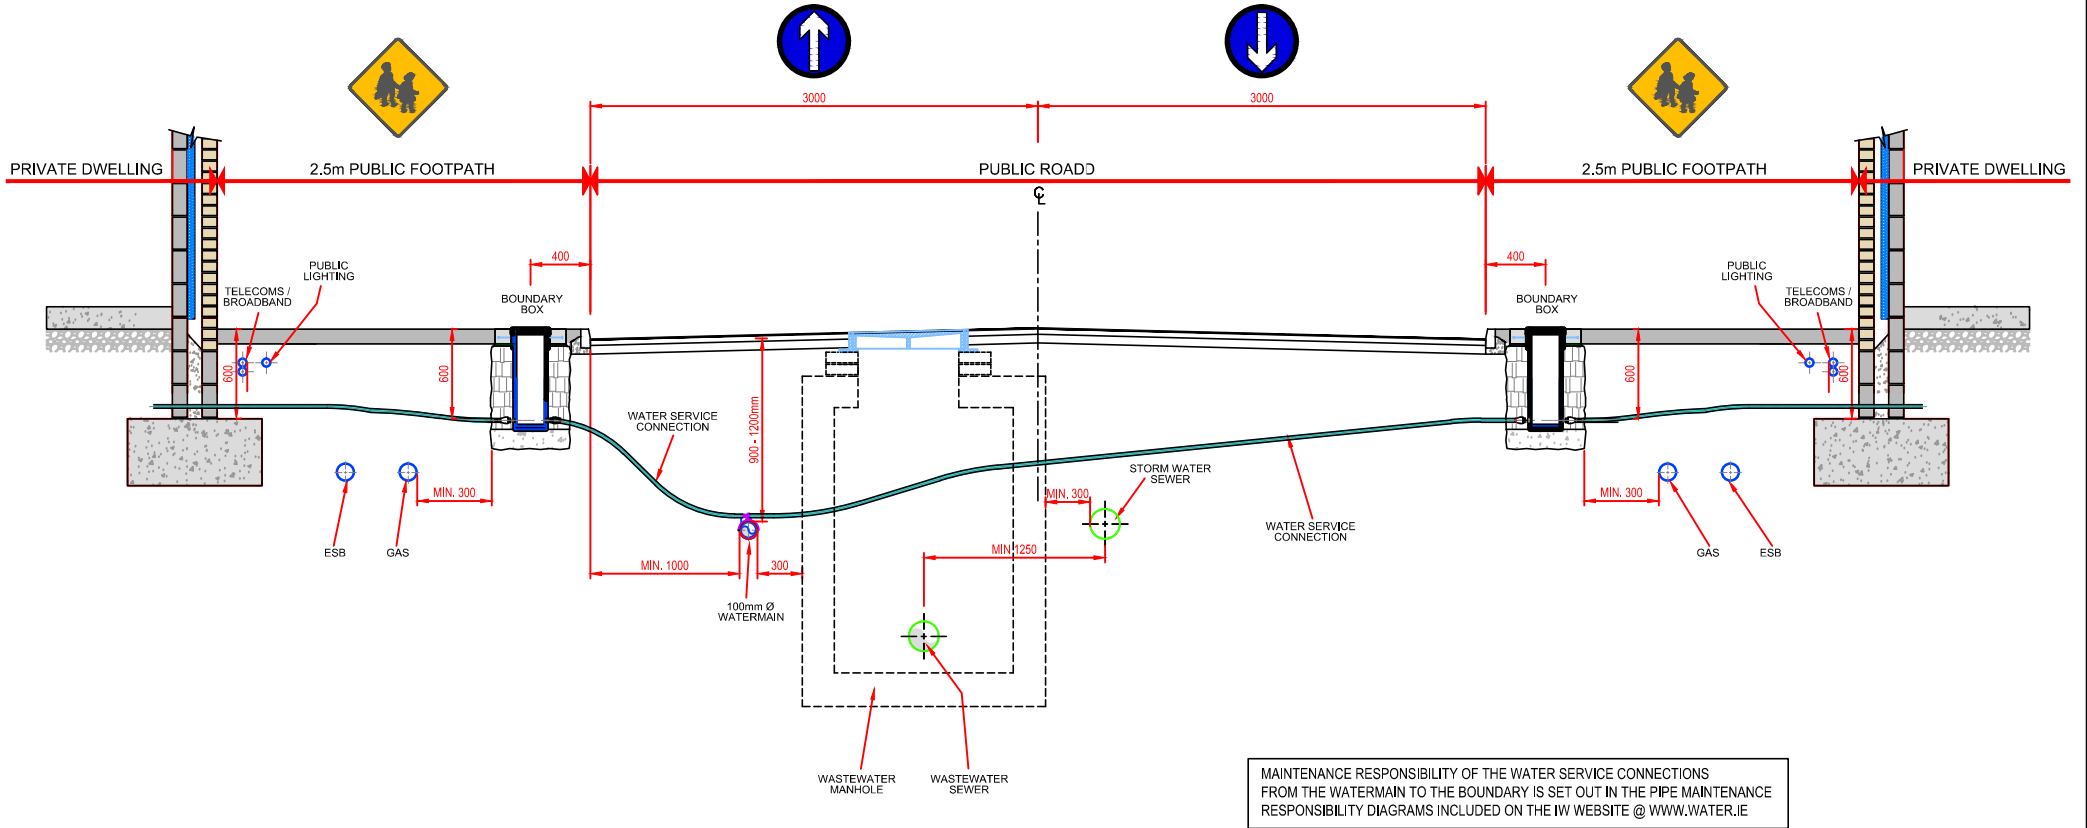

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



0	07/20	RH	TOC	Initial Issue	MOD
No.	Date	Dm	Chk	Description	App



TITLE

**STANDARD DETAILS - WATER**

SECTION SHOWING WATER SERVICES  
SEPARATION DETAILS IN HIGH DENSITY DEVELOPMENTS  
2.5m Wide Footpaths with 6.0m Wide Carriageway

SCALE NOT TO SCALE	DATE APR. 2020
DRAWING No. <b>STD-W- 40</b>	REV <b>0</b>

1. FOR NOTES REFER TO STD-WW-13
2. MINIMUM DISTANCE BETWEEN SERVICE CONNECTIONS AND OTHER SERVICES CONNECTIONS TO BE 300mm.

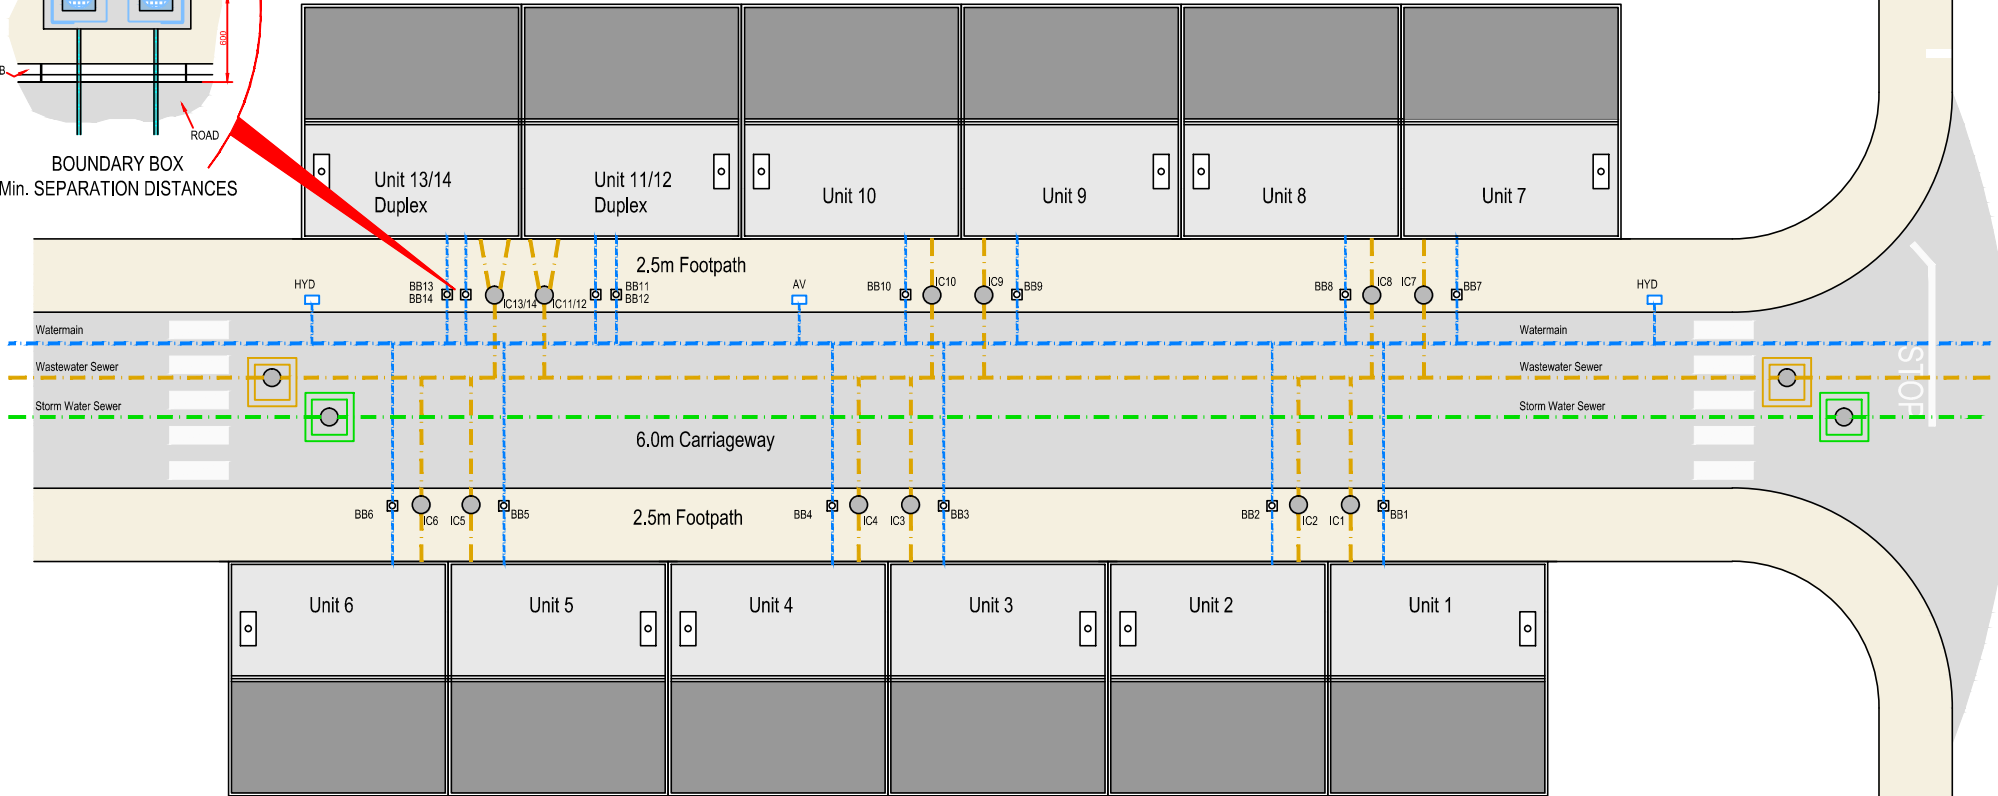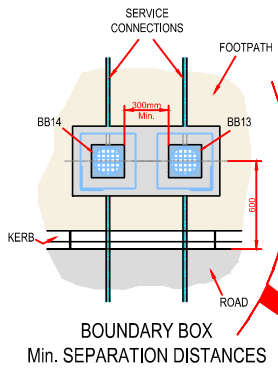

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



0	07/20	RH	TOC	Initial Issue	MOD
No.	Date	Drm	Chk	Description	App


TITLE

STANDARD DETAILS - WATER

LAYOUT PLAN SHOWING BELOW GROUND SERVICES SEPARATION DETAILS IN HIGH DENSITY DEVELOPMENTS  
2.5m Wide Footpaths with 6.0m Wide Carriageway

SCALE NOT TO SCALE	DATE APR. 2020
DRAWING No. <b>STD-W- 41</b>	REV <b>0</b>

1. FOR NOTES REFER TO STD-WW-13

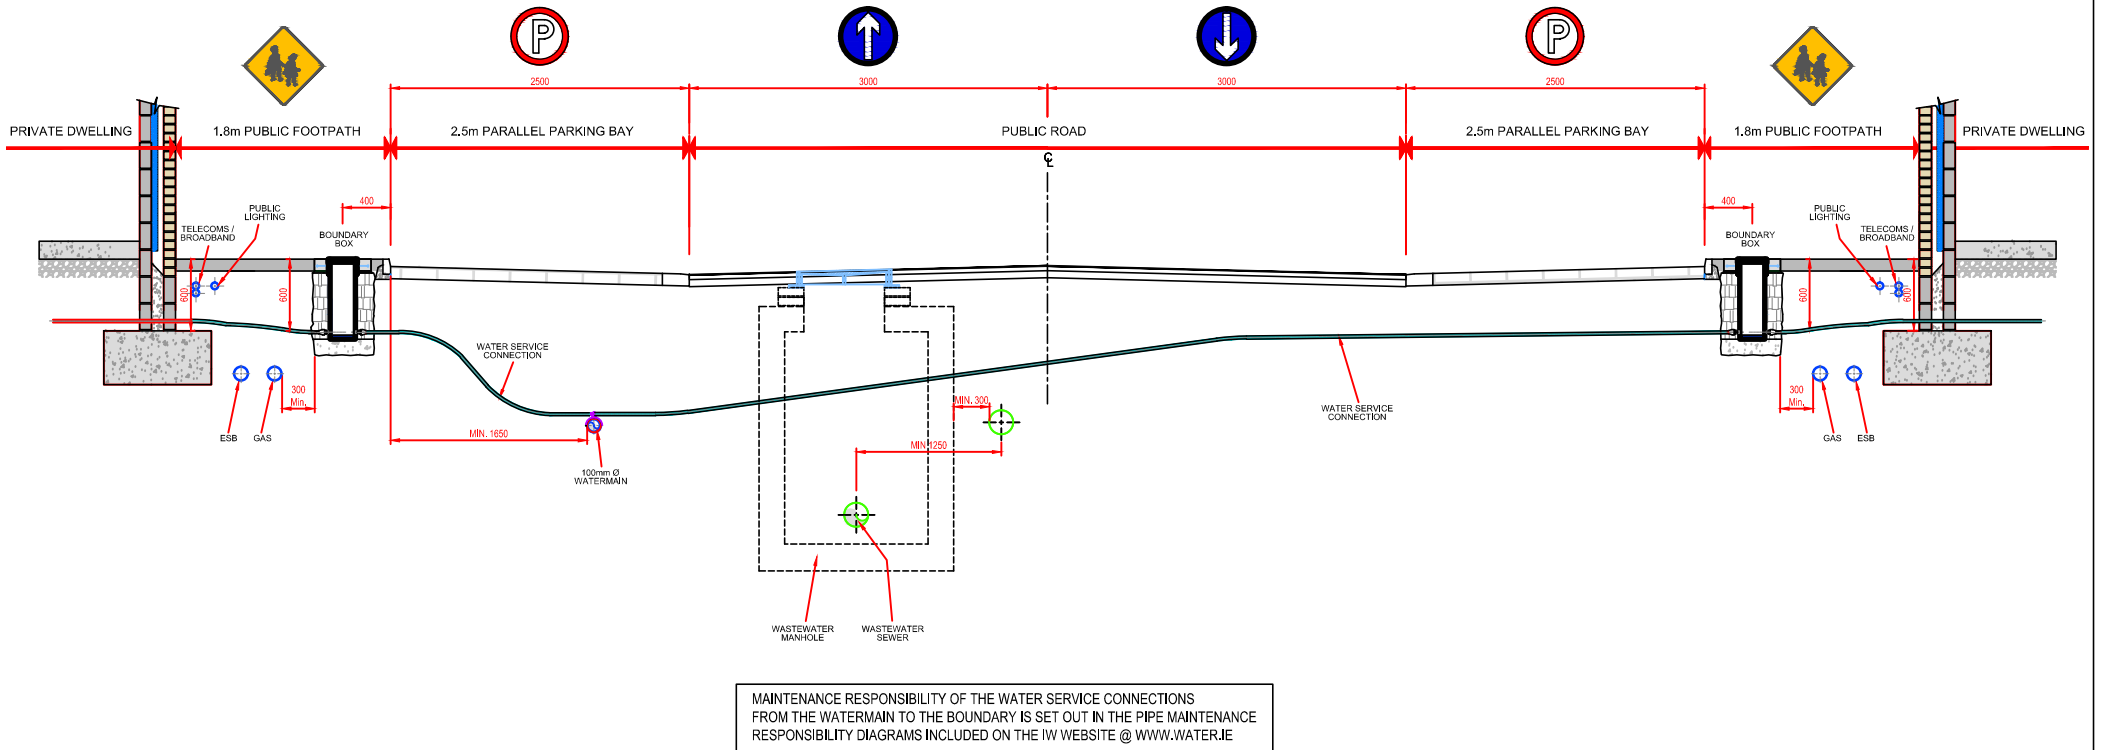

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



No.	Date	Dm	Chk	Description	App
0	07/20	RH	TOC	Initial Issue	MOD



**STANDARD DETAILS - WATER**

TITLE

**SECTION SHOWING WATER SERVICES  
SEPARATION DETAILS IN HIGH DENSITY DEVELOPMENTS  
1.8m Wide Footpaths, 2.5m wide Parallel Parking Bays with 6.0m Wide Carriageway.**

SCALE NOT TO SCALE	DATE APR. 2020
DRAWING No. <b>STD-W- 42</b>	REV <b>0</b>

- FOR NOTES REFER TO STD-WW-13
- MINIMUM DISTANCE BETWEEN SERVICE CONNECTIONS AND OTHER SERVICES CONNECTIONS TO BE 300mm.

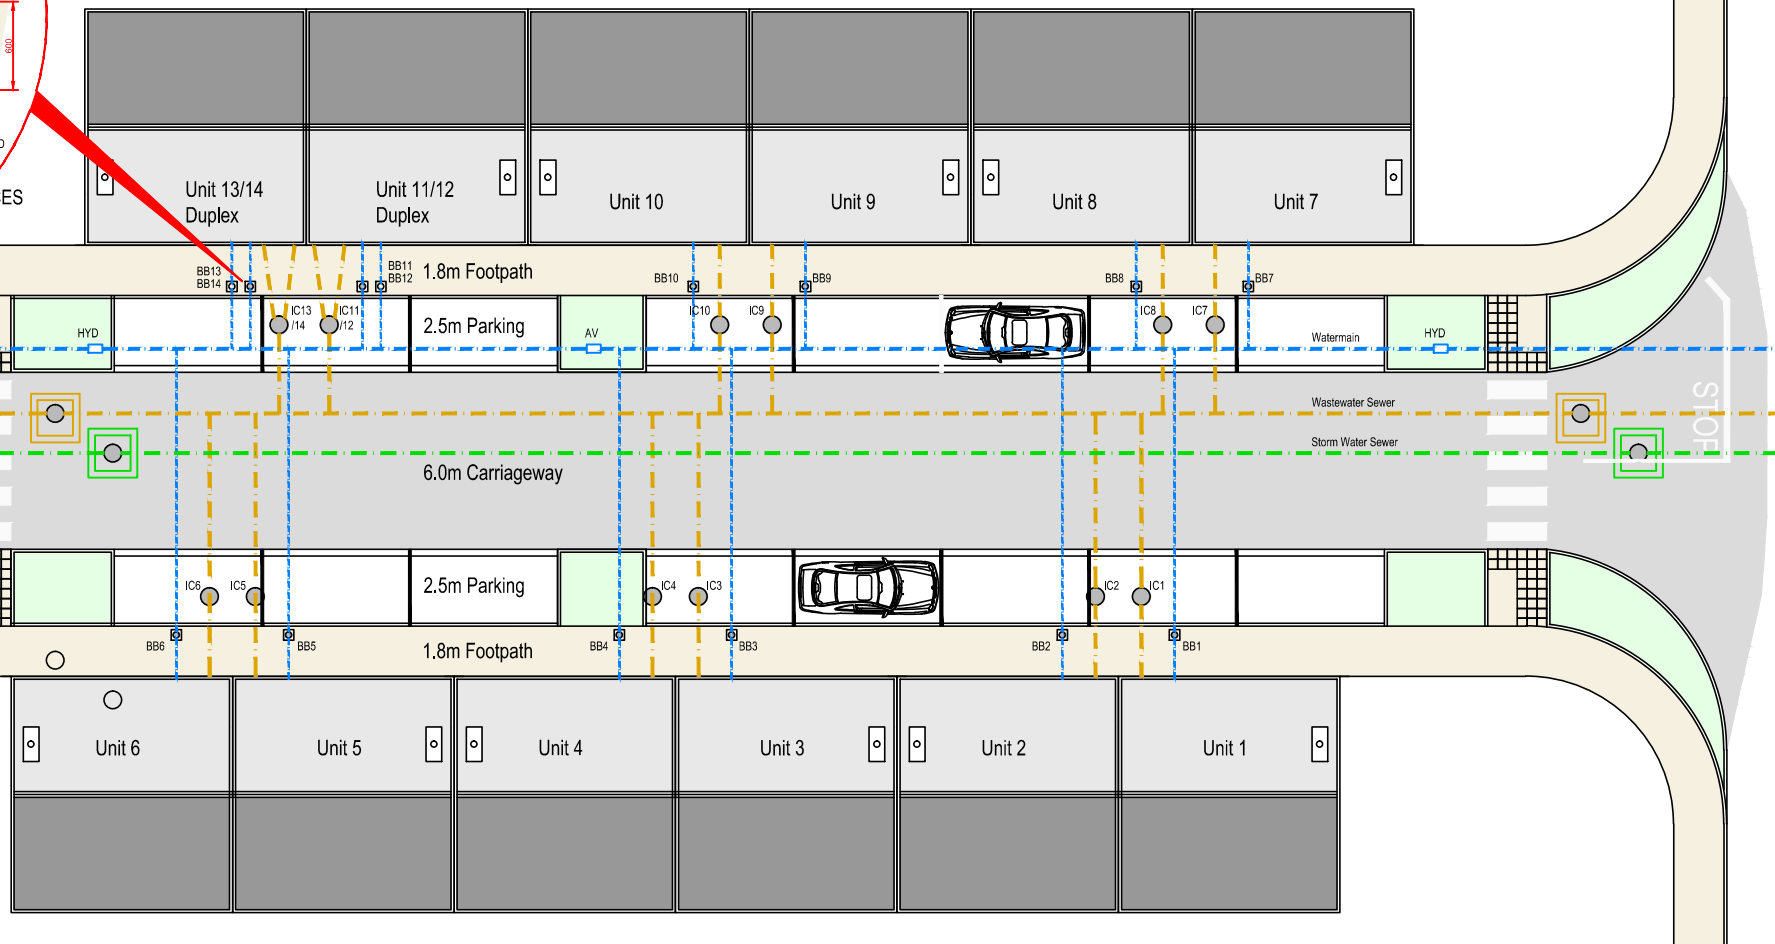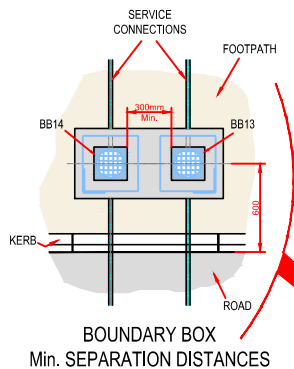

REFER TO INDEX SHEET FOR NOTES REGARDING DESIGN RESPONSIBILITY & RISK ASSESSMENT



No.	Date	Dm	Chk	Description	App
0	07/20	RH	TOC	Initial Issue	MOD

TITLE  
**STANDARD DETAILS - WATER**  
 LAYOUT PLAN SHOWING BELOW GROUND SERVICES SEPARATION DETAILS IN HIGH DENSITY DEVELOPMENTS  
 1.8m Wide Footpaths, 2.5m wide Parallel Parking Bays with 6.0m Wide Carriageway.

SCALE NOT TO SCALE	DATE APR. 2020
DRAWING No. <b>STD-W- 43</b>	REV <b>0</b>

# STANDARD DETAILS FOR WATER NETWORKS: REVISION LOG – 04 (July 2020)

Drg. No.	DRAWING TITLE	MATERIAL CHANGE	EDITORIAL CHANGE	REV	COMMENTS
STD-W-01	Water service connection responsibility	B-C ownership revised – table revised	Updated & added Notes	1	Drawing revised
STD-W-02	Typical layout for watermains within developments	Connection interface detail added, notes updated	Updated & added Notes	2	Drawing revised
STD-W-03	Customer connection and boundary box (25mm OD pipe)	Service connection ownership revised, notes added	Updated & added Notes	4	Drawing revised
STD-W-04	General pipe connections ( Sheet 1 of 7)	Dismantling joints relocated	Details Updated	4	Drawing revised
STD-W-05	General pipe connections ( Sheet 2 of 7)	Dismantling joints relocated, separation pipe material added, notes updated	Updated & added Notes	3	Drawing revised
STD-W-06	General pipe connections ( Sheet 3 of 7)	Dismantling joints relocated, separation pipe material added, notes updated	Updated & added Notes	3	Drawing revised
STD-W-07	General pipe connections ( Sheet 4 of 7)	Dismantling joints relocated, separation pipe material added, notes updated	Updated & added Notes	2	Drawing revised
STD-W-08	General pipe connections ( Sheet 5 of 7)	Dismantling joints relocated, separation pipe material added, notes updated	Updated & added Notes	2	Drawing revised
STD-W-09	General pipe connections ( Sheet 6 of 7)	Dismantling joints relocated, separation pipe material added, notes updated	Details Updated	2	Drawing revised
STD-W-10	General pipe connections ( Sheet 7 of 7)	Dismantling joints relocated, separation pipe material added, notes updated	Details Updated	2	Drawing revised
STD-W-11	Typical service layout indicating separation distances	Notes added	Added Notes	2	Drawing revised
STD-W-12	Restrictions on Water Infrastructure works adjacent to existing trees			2	No Change
STD-W-12A	Restrictions on new trees / shrubs planting adjacent to Water mains			0	No Change
STD-W-13	Trench Backfill / bedding & reduced cover protection slab detail	Protection slab detail added, title changed, notes added	Updated & added Notes	2	Drawing revised
STD-W-14	Sluice valve for ductile iron (D.I.) pipe (<350mm dia.) (Sheet 1 of 2)	Updated anti-torque support note, relocated thrust flange, added plan dimensions, updated notes	Updated & added Notes	4	Drawing revised
STD-W-15	Sluice valve for polyethylene (P.E.) pipe (<350mm dia.) (Sheet 2 of 2)	Updated anti-torque support note, added plan dimensions note, updated notes	Updated & added Notes	3	Drawing revised
STD-W-16	On-line hydrant for ductile iron (D.I.) pipe (Sheet 1 of 4)	Added plan dimensions note, updated brickwork bedding mortar spec, updated notes	Updated & notes revised	3	Drawing revised
STD-W-17	Off-line hydrant for ductile iron (D.I.) pipe (Sheet 2 of 4)	Added plan dimensions note, updated brickwork bedding mortar spec, updated notes	Updated & notes revised	4	Drawing revised
STD-W-18	On-line hydrant for polyethylene (P.E.) pipe (Sheet 3 of 4)	Added plan dimensions note, updated brickwork bedding mortar spec, updated notes	Updated & notes revised	3	Drawing revised
STD-W-19	Off-line hydrant for polyethylene (P.E.) pipe (Sheet 4 of 4)	Added plan dimensions note, updated brickwork bedding mortar spec, revised pipe branch to PE, updated notes	Updated & notes revised	4	Drawing revised
STD-W-20	On-line air valve for ductile iron (D.I.) pipe (Sheet 1 of 4)	Updated brickwork bedding mortar spec and updated notes	Updated & notes revised	3	Drawing revised
STD-W-21	Off-line air valve for ductile iron (D.I.) pipe (Sheet 2 of 4)	Updated brickwork bedding mortar spec. updated notes	Updated & notes revised	4	Drawing revised
STD-W-22	On-line air valve for polyethylene (P.E.) pipe (Sheet 3 of 4)	Updated brickwork bedding mortar spec. updated notes	Updated & notes revised	3	Drawing revised
STD-W-23	Off-line air valve for polyethylene (P.E.) pipe (Sheet 4 of 4)	Updated brickwork bedding mortar spec. updated notes	Updated & notes revised	4	Drawing revised
STD-W-24	Pressure reducing / sustaining valve chamber in-situ R.C. option	Class B brickwork coursing & thrust flange notes amended	Updated & notes revised	3	Drawing revised
STD-W-25	Booster pump station arrangement	Notes updated	Notes updated	2	Drawing revised
STD-W-26	Electromagnetic meter chamber (dn80 - dn250mm Dia.)	Notes updated and spool length table included	Updated & notes revised	4	Drawing revised
STD-W-26A	Chamber for flanged mech. meter without strainer (dn40 - dn250mm Dia.)	Notes updated and spool length table and taper details included	Updated & notes revised	1	Drawing revised
STD-W-26B	Chamber for flanged mech. meter (dn100 - dn250mm Dia.) with separate strainer chamber			0	New Detail
STD-W-26C	Threaded rotary piston flow meter chamber (dn30 - dn40mm Dia.) In-Situ Concrete Option			0	New Detail
STD-W-26D	Threaded rotary piston flow meter chamber (dn30 - dn40mm Dia.) Precast Concrete Option			0	New Detail
STD-W-26E	Threaded rotary piston flow meter chamber (dn30 - dn40mm Dia.) Blockwork Option			0	New Detail
STD-W-26F	By-pass flow meter chamber (25-32mm O.D. Dia) For developments with <20m <sup>3</sup> /day water use			0	New Detail
STD-W-26G	Flow meter chamber (25-32mm O.D. Dia.)			0	New Detail
STD-W-27	Marker posts / plates	Additional marker plates included and revised notes	Updated & notes revised	3	Drawing revised
STD-W-28	Water main thrust and support blocks			0	No Change
STD-W-29	Duct chamber	Included drain point and updated notes	Updated & notes revised	3	Drawing revised
STD-W-30	Scour chamber and head wall arrangements	Notes updated	Notes updated	4	Drawing revised
STD-W-30A	Washout hydrant	Updated noted re PE pipe branch and notes updated	Updated & notes revised	3	Drawing revised
STD-W-30B	Scour chamber to storm sewer arrangements			0	New Detail
STD-W-31	Typical ditch / stream crossing for watermain ductile iron option	Title amended	Updated	2	Drawing revised
STD-W-31A	Typical ditch / stream crossing for watermain polyethylene option			0	New Detail
STD-W-32	Typical bridge crossing for watermain (Sheet 1 of 2)			1	No Change
STD-W-33	Typical bridge crossing for watermain (Sheet 2 of 2)	Added drawing reference edits	Updated	2	Drawing revised
STD-W-33A	Typical culvert and services crossing details for water main			0	New Detail
STD-W-34	Security gate and fencing palisade option (preferred)	New drawing content	Updated & notes revised	0	New Detail
STD-W-34A	Security gate and fencing wire mesh option	Previous STD-W-34 re-numbered and updated	Updated	3	Drawing revised
STD-W-35	Pipe repair to existing mains			2	No change
STD-W-36	Flow meter kiosk	Notes and kiosk revised	Updated & notes revised	3	Drawing revised
STD-W-36A	PRV / PSV control kiosk			0	New Detail
STD-W-37	Lamp bollard and lamp standard			1	No change
STD-W-38	Watermain loop detail ductile iron option			0	New Detail
STD-W-39	Watermain loop detail polyethylene option			0	New Detail
STD-W-40	Section showing wastewater services separation details in high density developments 2.5m wide footpaths with 6.0m wide carriageway			0	New Detail
STD-W-41	Layout plan showing below ground services separation details in high density developments 2.5m wide footpaths with 6.0m wide carriageway			0	New Detail
STDW-42	Section showing wastewater services separation details in high density developments 1.8m wide footpaths, 2.5m wide parallel parking bays with 6.0m wide carriageway.			0	New Detail
STD-W-43	Layout plan showing below ground services separation details in high density developments 1.8m wide footpaths, 2.5m wide parallel parking bays with 6.0m wide carriageway.			0	New Detail
/	<b>INDEX SHEET</b>	Inclusion of STD-WW-26B, 26C, 26D, 31A, 33A, 34, 36A, 38, 39, 40, 41, 42, 43	Drawing revisions updated	July 2020	Drawing revisions updated
/	<b>Design Risk Assessment for Water Standard Details</b>	Inclusion of STD-WW-??	General Amendments	v4.01	Document revised

